

WATER TAPPING PERMIT
 issued by
 The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0216 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by J. E. Mantel
 water distribution dept. finance director

Name _____ Size of tap 1" Date 3-13-96 Street and No. 204 E. BARNES

Old Tap No. 2981 New Tap No. 9615 Size and Kind of Main 6" CIP

Location of Main 1' West of West pavement edge Depth of Main 5'

Distance from Hydrant/Valve 99' North of Hyd #371 Distance to Curb Stop from Corp. 28'

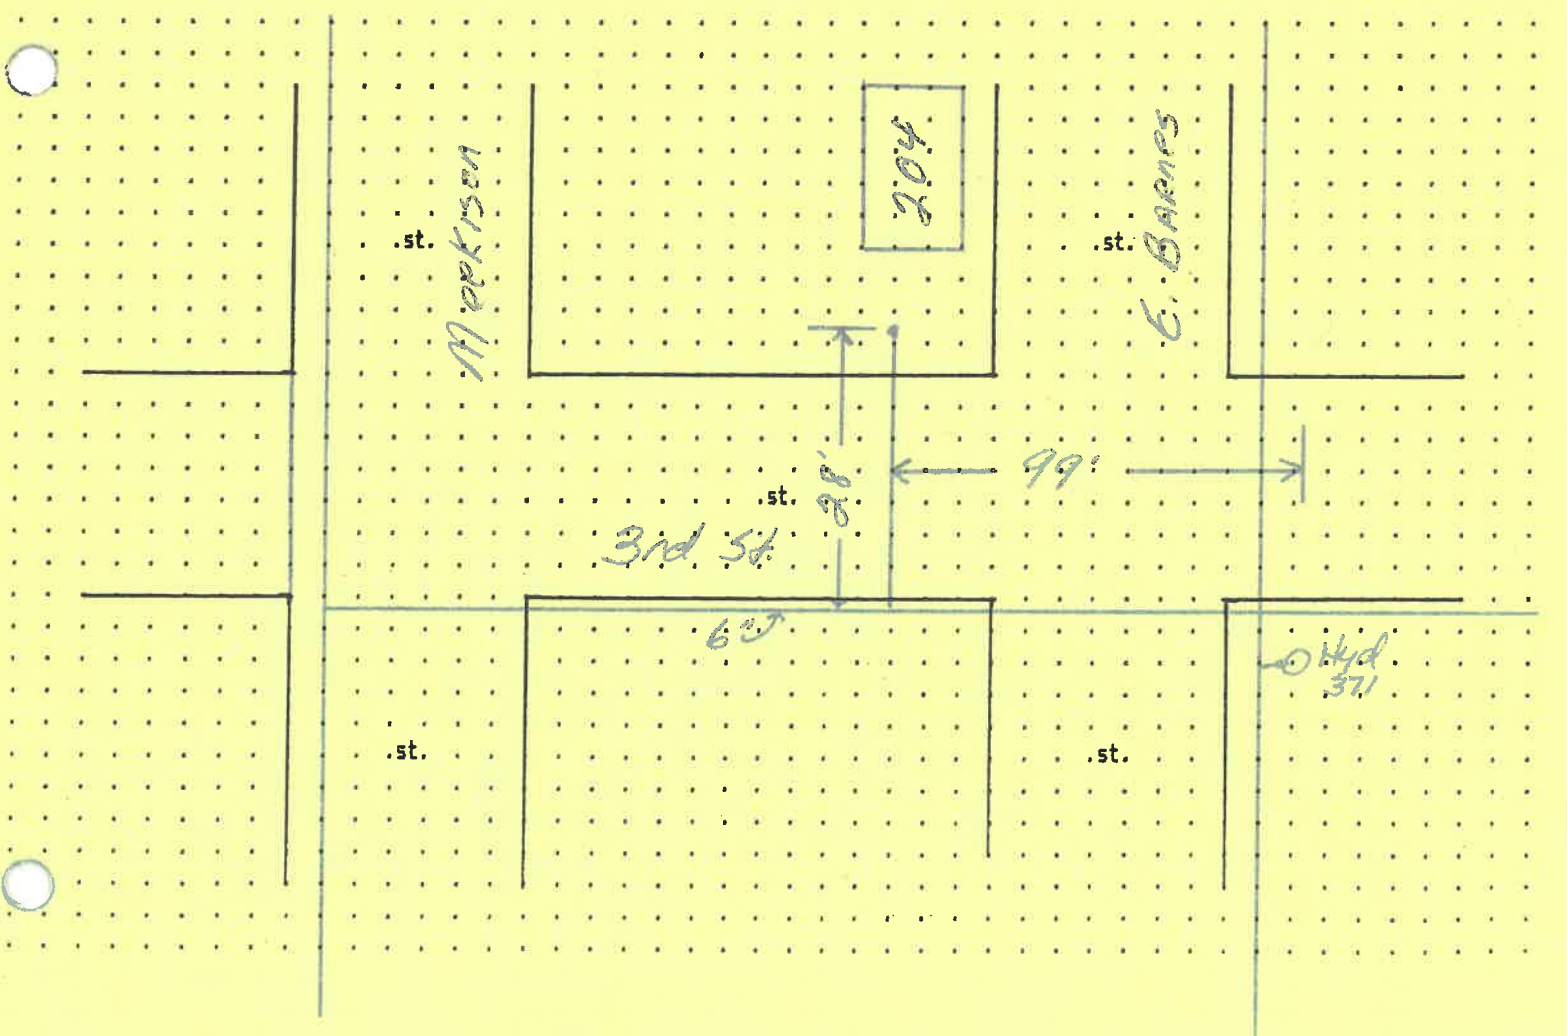

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0216 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Rubber _____

COMPLETED

Date completed _____ Approved by *J. H. ...*
water distribution dept. _____ finance director _____

Name _____ Size of tap 1" Date 3-13-96 Street and No. 204 E. BARNES

Old Tap No. 2981 New Tap No. 9615 Size and Kind of Main 6" CIP

Location of Main 1' West of West pavement edge Depth of Main 5'

Distance from Hydrant/Valve 99' North of Hyd #371 Distance to Curb Stop from Corp. 28'

