

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W- _____ Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ Cost \$ _____ .00 Plumber _____


Date completed Oct 28, 1999 Approved by [Signature]
Water distribution dept. _____ finance director _____


Name Lot 45 Size of tap 1" Date 8-99 Street and No. 622 Briarheath

Old Tap No. — New Tap No. 9925 Size and Kind of Main 8" C-900

Location of Main 17' EAST OF EAST CURB Depth of Main 5'

Distance from Hydrant/Valve 207' North of Hyd 491 Distance to Curb Stop from Corp. 15'

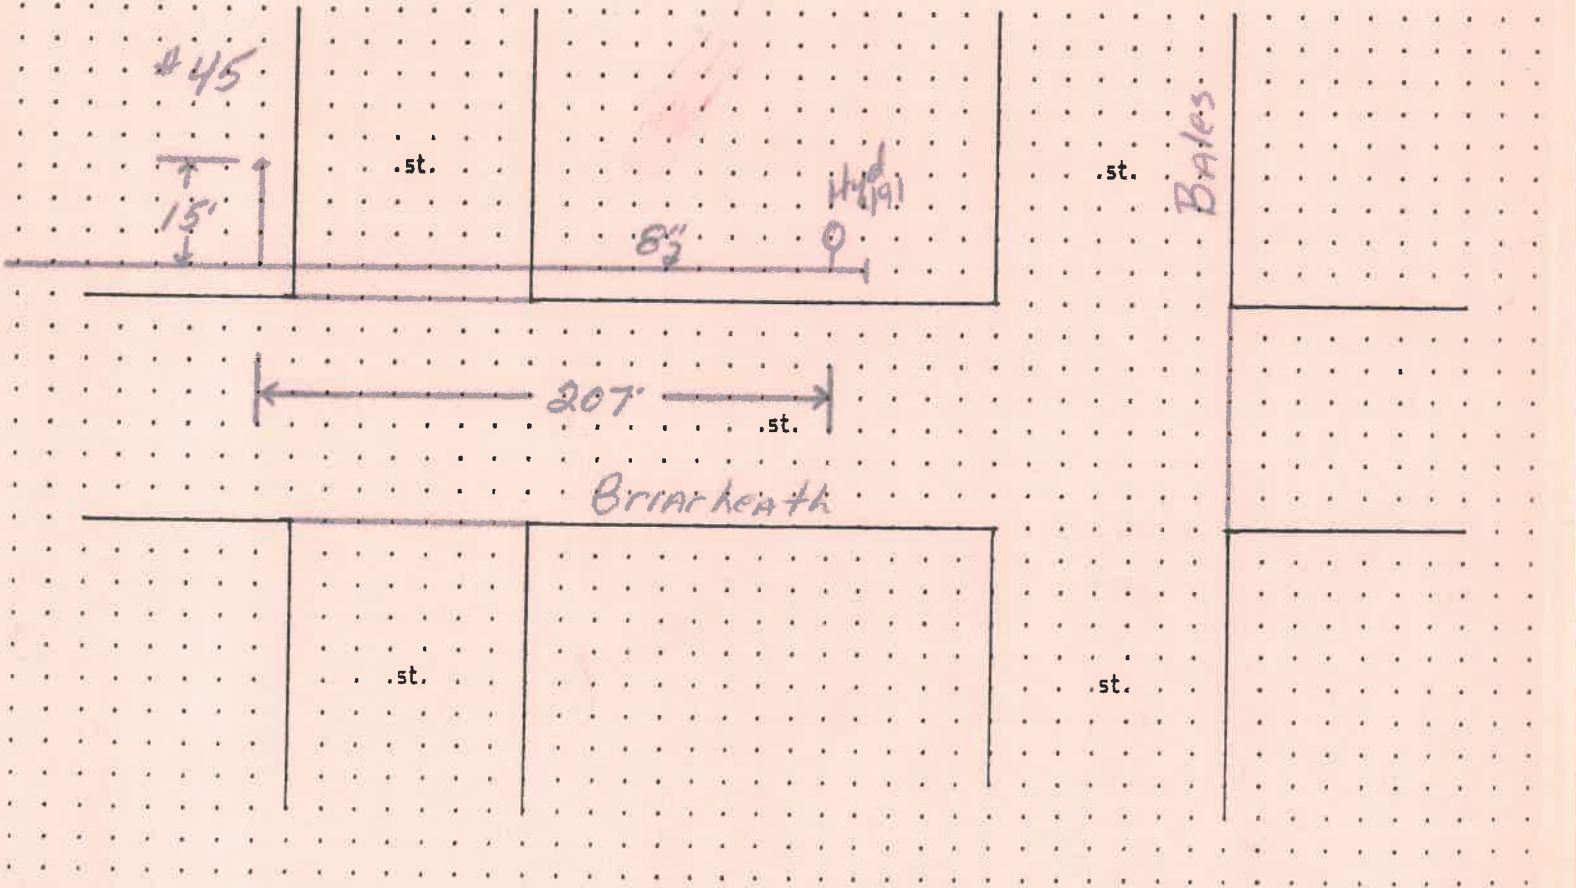

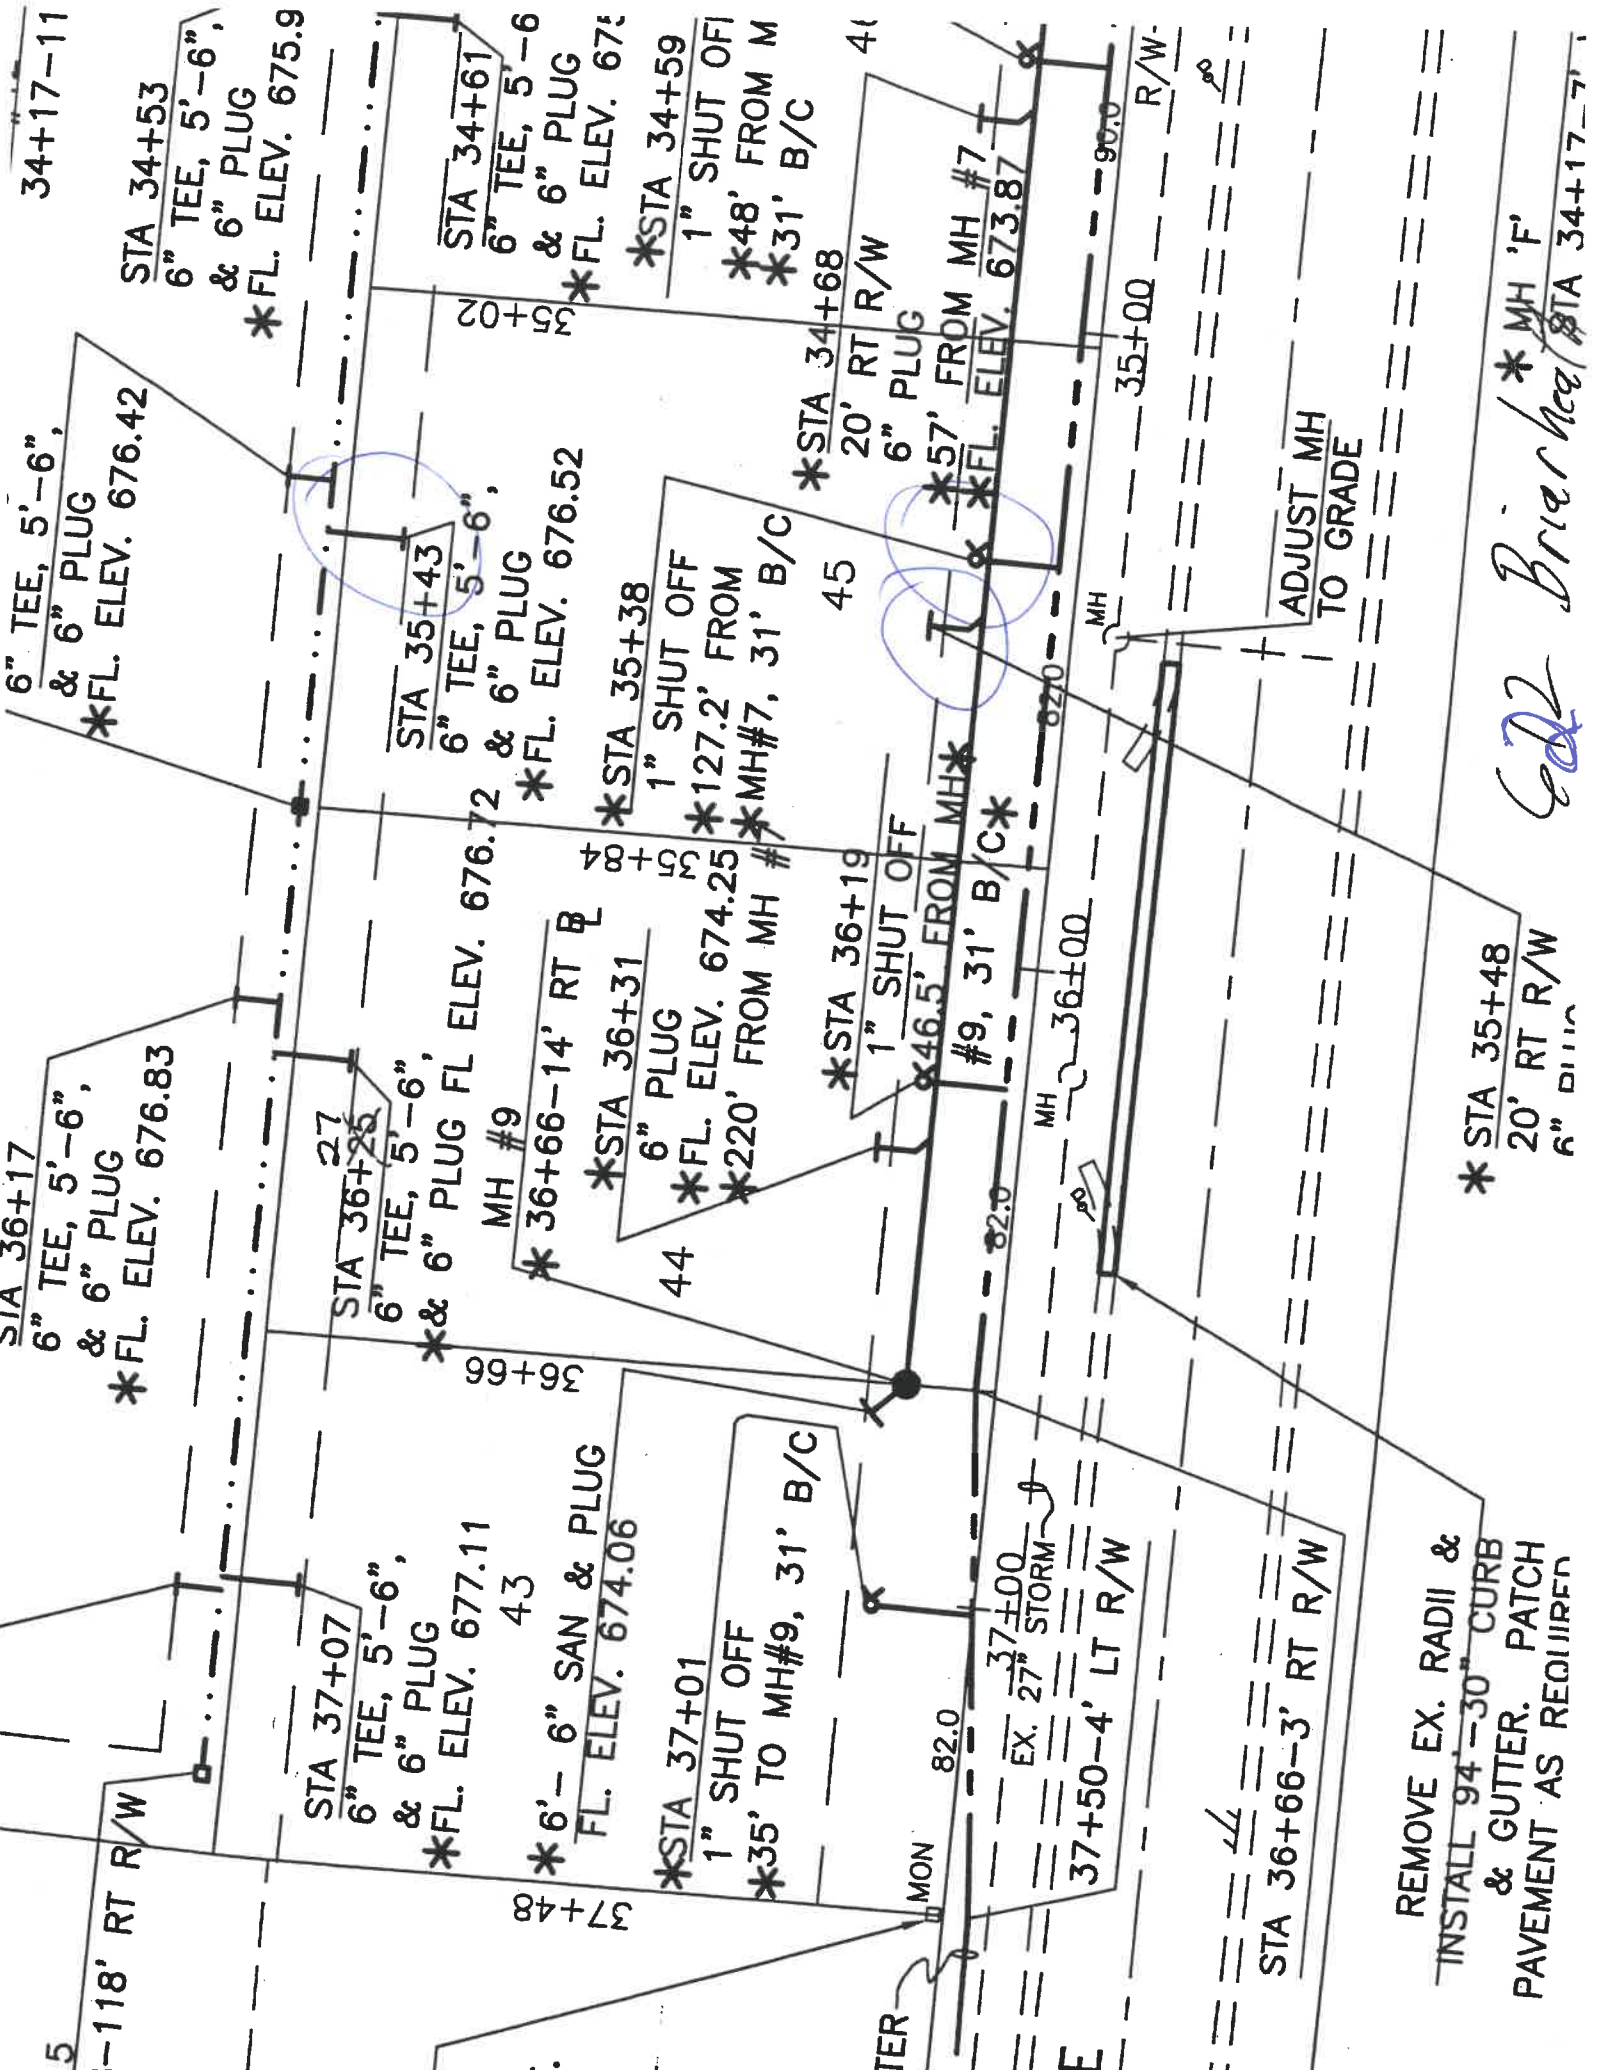

34+17-11
 STA 34+53
 6" TEE, 5'-6",
 & 6" PLUG
 *FL. ELEV. 675.9

6" TEE, 5'-6",
 & 6" PLUG
 *FL. ELEV. 676.42

SIA 36+17
 6" TEE, 5'-6",
 & 6" PLUG
 *FL. ELEV. 676.83

STA 34+61
 6" TEE, 5'-6"
 & 6" PLUG
 *FL. ELEV. 675.9

STA 35+43
 6" TEE, 5'-6",
 & 6" PLUG
 *FL. ELEV. 676.52

STA 35+38
 1" SHUT OFF
 *127.2' FROM
 *MH#7, 31' B/C

STA 36+19
 1" SHUT OFF
 *46.5' FROM MH#
 #9, 31' B/C*

STA 37+01
 1" SHUT OFF
 *35' TO MH#9, 31' B/C

*STA 34+59
 1" SHUT OFF
 *48' FROM M
 *31' B/C

*STA 34+68
 20' RT R/W
 6" PLUG
 *57' FROM MH #7
 *FL. ELEV. 673.87

*STA 36+25
 6" TEE, 5'-6",
 & 6" PLUG
 *FL. ELEV. 676.72

36+66-14' RT B
 MH #9
 *STA 36+31
 6" PLUG
 *FL. ELEV. 674.25
 *220' FROM MH #

6'-6" SAN & PLUG
 FL. ELEV. 674.06

37+48
 MON
 82.0
 EX. 27" STORM
 37±00
 37+50-4' LT R/W

ADJUST MH
 TO GRADE

36±00
 MH
 82.0

35±00
 MH
 82.0

35±00
 MH
 82.0

35±00
 R/W

35±00
 R/W

36±00
 MH

36±00
 MH

37±00
 EX. 27" STORM

STA 36+66-3' RT R/W

REMOVE EX. RADII &
 INSTALL 94'-30" CURB
 & GUTTER. PATCH
 PAVEMENT AS REQUIRED

* STA 35+48
 20' RT R/W
 6" PLUG

CD Brierley *MH 'F'
 STA 34+17-7'