

Napoleon High School Fire Line


Installed by: S.A. Comunale

AN Emcor Company

Full Service Fire Protection

Inspected by:
Ken Moll

Date Installed: 4-9-14

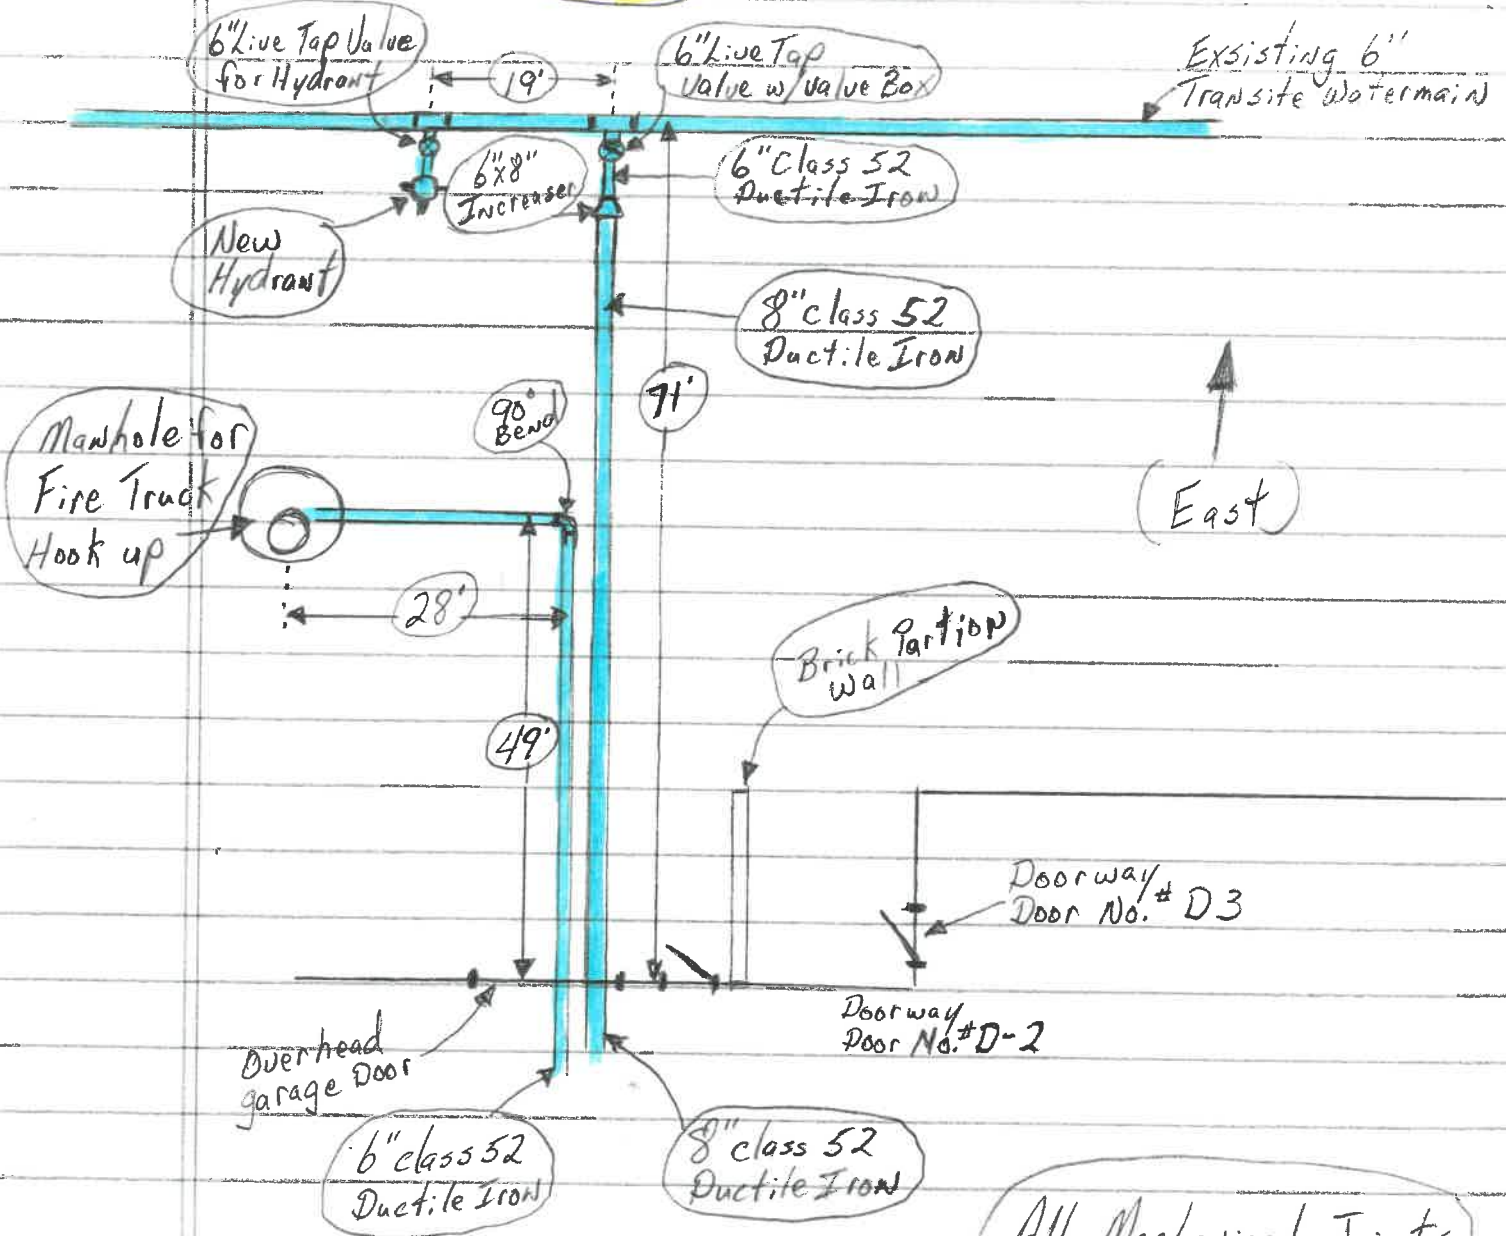

Water mains 8" x 6"
6.25' to Top of Pipe

All Mechanical Joints
Installed with Mega-Lug
Restraints and concrete
Thrust Blocks

Napoleon High School Fire Line


Installed by: S.A. Comunale

AN Emcor Company

Full Service Fire Protection

Inspected by:
Rex Moll

Date Installed: 4-9-14

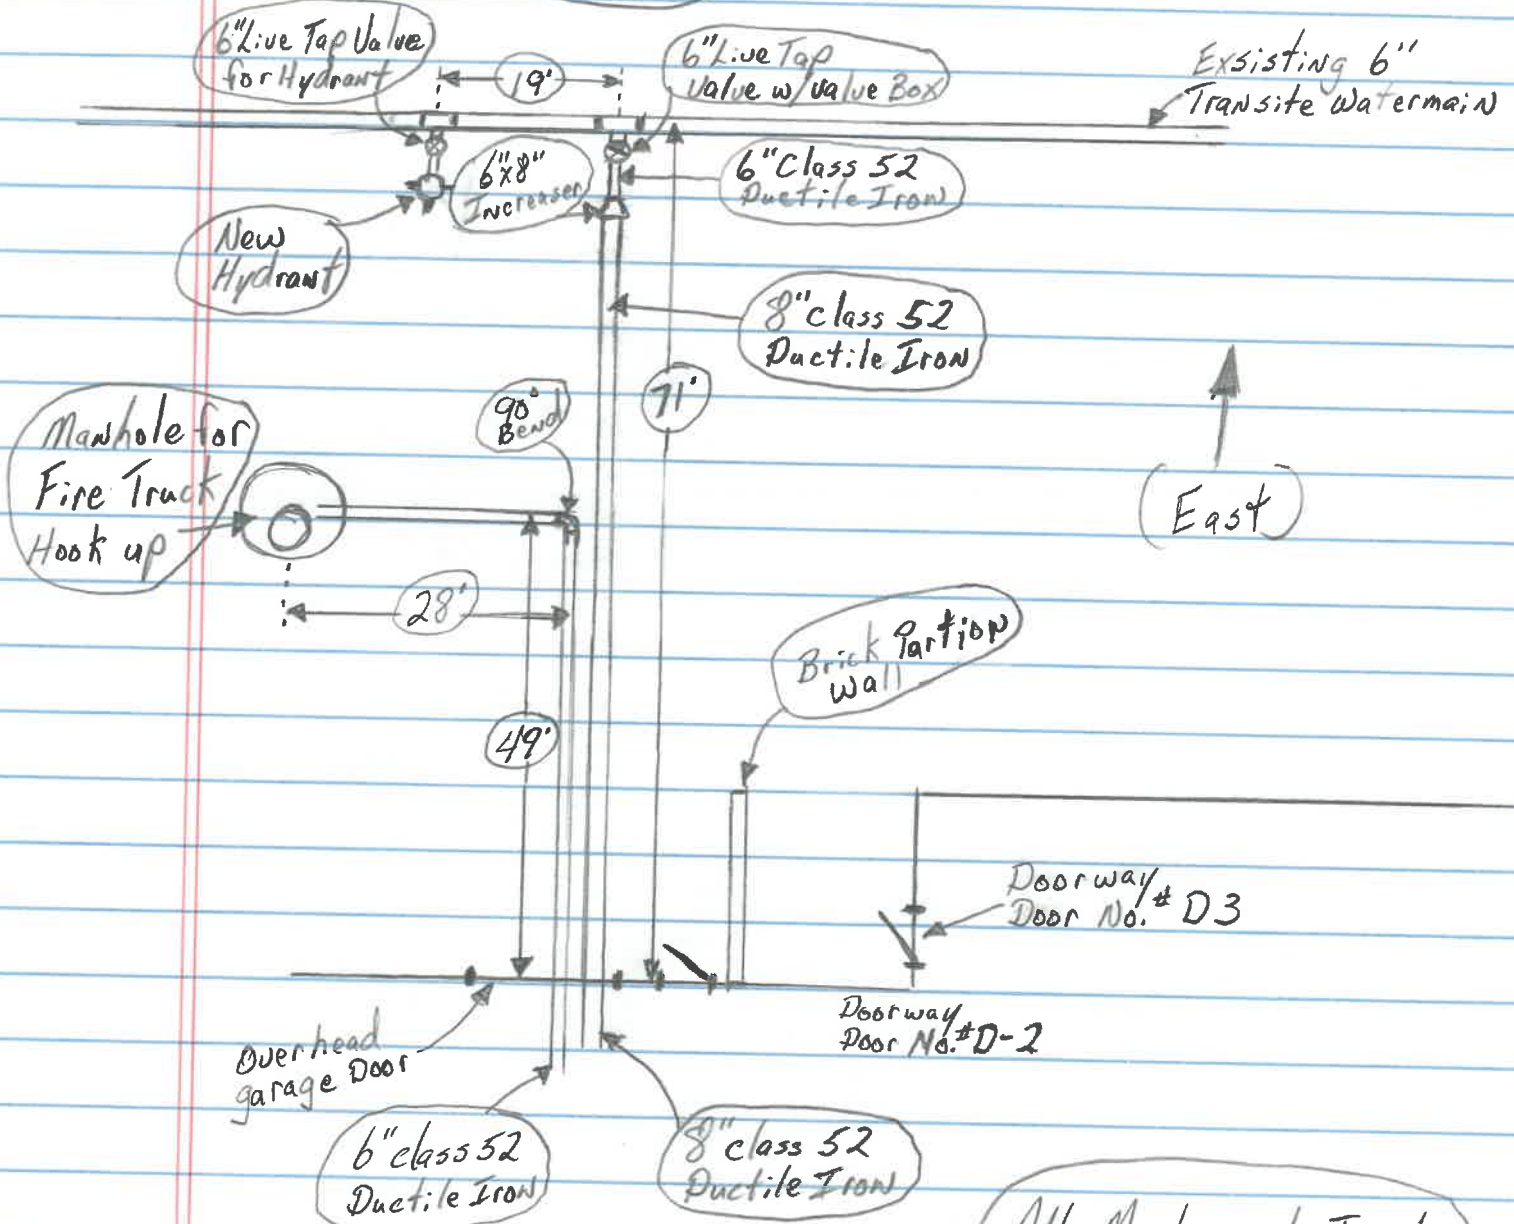

Watermains 8" + 6"
6.25' to Top of Pipe

All Mechanical Joints
Installed with Mega-Lug
Restraints and concrete
Thrust Blocks