

3 Ton
outside
heat pump
section


3 Ton
Indoor Section
w/ 15 KW
Resistance Heat.

All 2" x 14" Supply Registers
2 - 6 x 30 R.R.
3 - 6 x 16 R.R.

RECEIVED
MAR 3 1977
CITY OF NAPOLEON
BUILDING DEPT
BY: *[Signature]*
CITY OF NAPOLEON
BUILDING DEPT.
Plan Approval
By: *[Signature]* Date 3/3/77
WITH ADDENDUM

R.L. Zehrich
Lot 101 Buckeye Ln
Heating Layout
Standard Phba + HTing
Heat loss 43,600
Heat Supply 15 KW 46,062 BTU
+ Heat Pump 12,000 min

535 Buckeye Ln

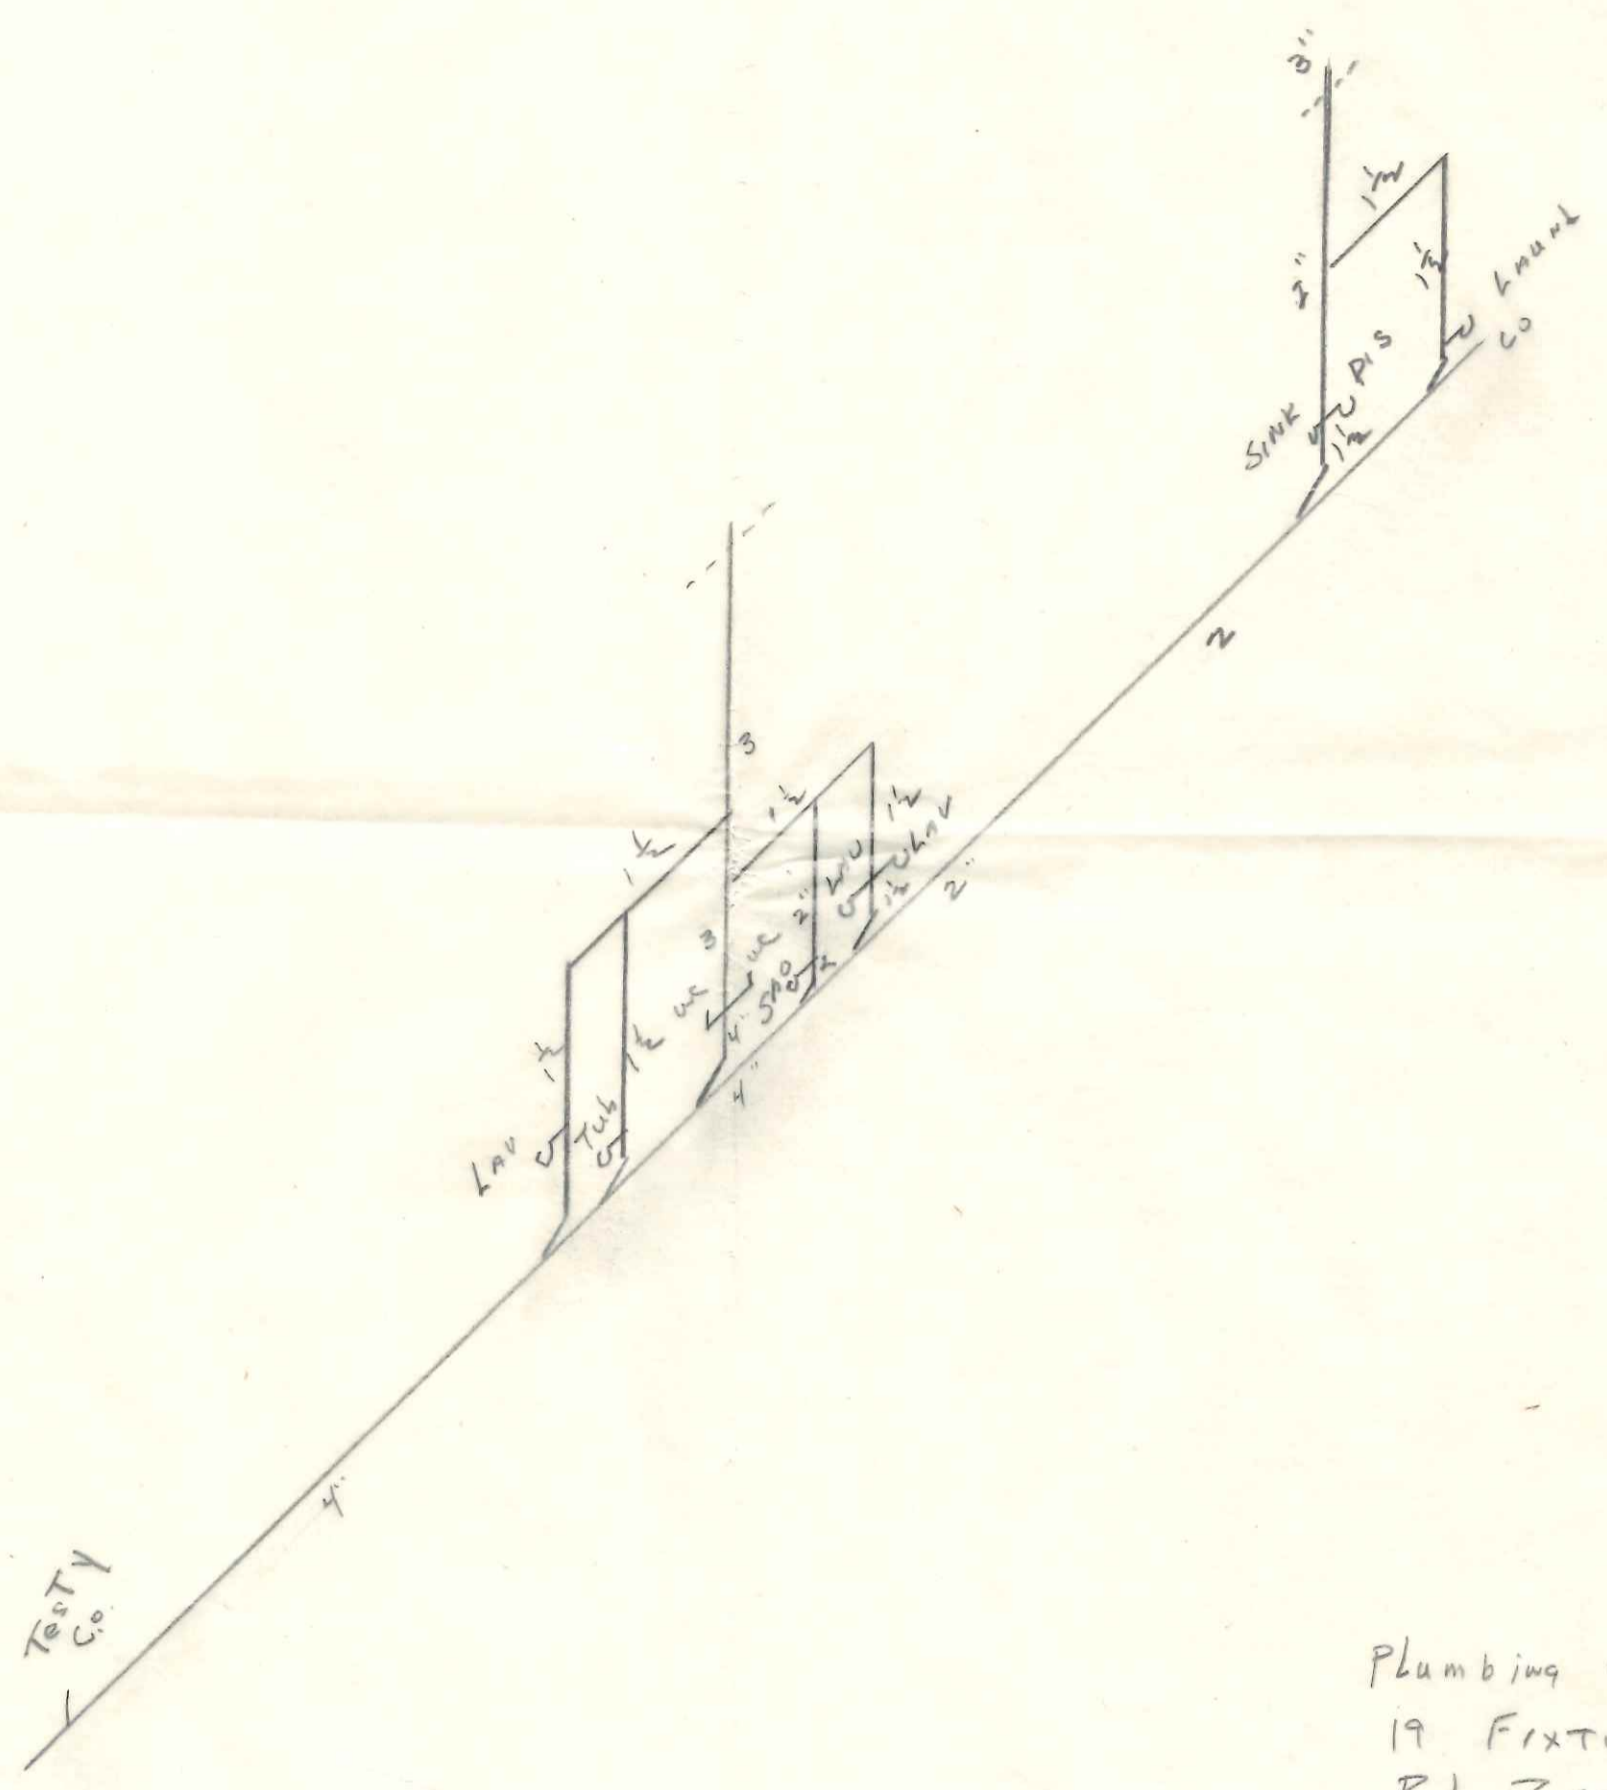

Plumbing Isometric
 19 Fixture Units
 R.L. Zschvich
 Lot 101 Buckeye LN
 Napoleon, Ohio
 Standard Pbg + Wtg

RECEIVED

MAR 2 1977
 CITY OF NAPOLEON
 BUILDING DEPT
 BY: *[Signature]*

CITY OF NAPOLEON
BUILDING DEPT.

Plan Approval
 By: *[Signature]* Date: 3/2/77

WITH ADJUST