

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #:

ISSUED:

JOB LOCATION: _____

SUBDIVISION NAME: _____ LOT #: _____

OWNER:

ADDRESS: 450 Cambridge

CONTRACTOR: _____ PHONE: _____

TAP SIZE: 1" X 1.5" _____ 2" _____ OTHER _____

AMOUNT PAID: _____ YOKE SIZE: _____

PLUMBING CONTRACTOR: _____ PH: _____

DATE OF TAP: 10-15-01 OLD TAP #: — NEW TAP #: 0188


SIZE AND KIND OF MAIN: 8" C-900

LOCATION OF MAIN: 7' South of South curb DEPTH OF MAIN: 5'

DIST FROM HYDRANT\VALVE: 77' W of Hyd 513 DIST TO CURB STOP FROM CORP: 15'

450

Hyd 513

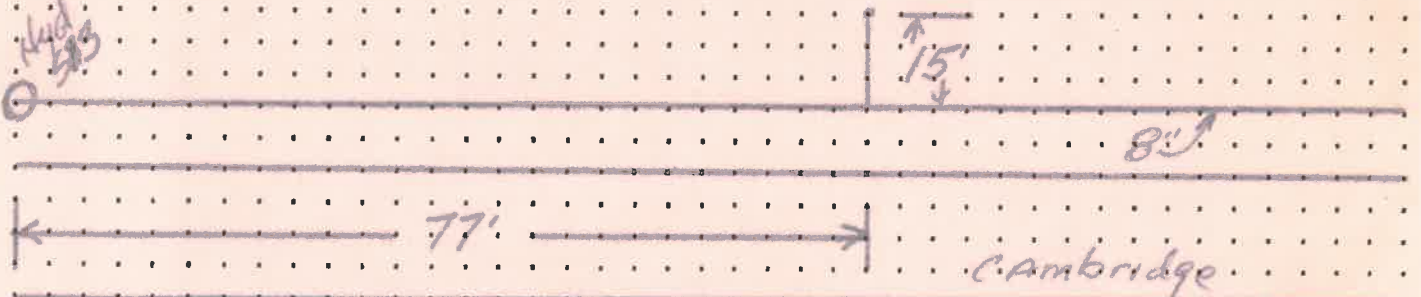

DATE APPROVED: Nov 29, 2001 BY: Jeffrey C. Mantigh

City of Napoleon

Water Meter Yoke Release Form

THIS DOCUMENT ENTITLES THE HOLDER TO "ONE" WATER METER YOKE ASSEMBLY
(Please pickup at City Operations Department 1775 Industrial Drive).

Permit #002055

Date Issued: 03-09-2004

Job Location: 450 CAMBRIDGE ST

Owner: BECKS CONSTRUCTION

Address: PO BOX 583 NAPOLEON, OH 43545

Owner Phone: _____

Contractor: BECKS CONSTRUCTION CO

Address: PO BOX 583 NAPOLEON, OH 43545

Phone: 419-592-8307

Water Tap Size 1" X 1.5" _____ 2" _____ Other _____

Water Meter Yoke Size 5/8" X 3/4" _____ 1" _____ Other _____

New Structure X Existing Structure _____ Lawn Meter _____

WATER SERVICE LINE TO BE TYPE "K" COPPER OR "CTS" POLYETHELENE TUBING OF 1" MINIMUM SIZE.

Backflow Device Required Yes X No _____

Type of Backflow Required: DCUA

Water Meter Yoke Installation is subject to the following conditions

- 1.) Must be located in an accessible area.
- 2.) Must be in an area which is not subject to freezing temperatures.
- 3.) Must be at least 18" above floor level (no crawl space installations).
- 4.) Must comply with minimum mounting requirements (drawing available)

Issued By _____ Received By _____

1 Copy to: Building Dept, Water Dept, and Utilities Dept

City of Napoleon

Water Meter Yoke Release Form

THIS DOCUMENT ENTITLES THE HOLDER TO "ONE" WATER METER YOKE ASSEMBLY
(Please pickup at City Operations Department 1775 Industrial Drive).

Permit #002055

Date Issued: 03-09-2004

Job Location: 450 CAMBRIDGE ST

Owner: BECKS CONSTRUCTION

Address: PO BOX 583 NAPOLEON, OH 43545

Owner Phone:

Contractor: BECKS CONSTRUCTION CO

Address: PO BOX 583 NAPOLEON, OH 43545

Phone: 419-592-8307

Water Tap Size 1" X 1.5" _____ 2" _____ Other _____
Water Meter Yoke Size 5/8" X 3/4" _____ 1" _____ Other _____
New Structure X Existing Structure _____ Lawn Meter _____

WATER SERVICE LINE TO BE TYPE "K" COPPER OR "CTS" POLYETHELENE TUBING OF 1" MINIMUM SIZE.

Backflow Device Required Yes X No _____

Type of Backflow Required: DC UA

Water Meter Yoke Installation is subject to the following conditions

- 1.) Must be located in an accessible area.
- 2.) Must be in an area which is not subject to freezing temperatures.
- 3.) Must be at least 18" above floor level (no crawl space installations).
- 4.) Must comply with minimum mounting requirements (drawing available)

Issued By _____ Received By _____

1 Copy to: Building Dept, Water Dept, and Utilities Dept