

**CITY OF NAPOLEON
BUILDING CONSTRUCTION PERMIT
(1, 2 or 3 Family Dwelling)**

Owner Name J.F. Hefflinger

Address 321 Cliff St.

Builder Name Harold Bostelman Electric Co.

Address 618 Park St. Tel. 592-2383

Lot Information:

Street No. 321 Cliff St.

Lot #88 Subdivision L.G. Randalls Add'n.

Lot Dimensions Lot Area Sq. Ft.

Yard Set Back: Front Rear

Side Side

Zoning "C1" Intended use of Building: Installing on existing building a new 100amp. service entrance, main disconnect and a new d/p inside building.

Building Information:

Single Double Multiple New Construction Addition Remodel

Size: Length Width No. of Stories

Floor Area: 1st Floor 2nd Floor 3rd Floor Basement

Unfinished Attic Garage

Foundation: Piers Full Basement Part Basement

Concrete Block

Walls: Frame Block Brick Other

Electrical: Wiring New 100amp. Electric Heating Electrical Appliances

Plumbing: Fixtures or Traps Warm Air Heating Hot Water Heating

Additional Information: This permit requires compliance with the attached addendum marked exhibit "A" and made a part here-of.

Date 12-4-74 Applicant Signature Harold Bostelman

Owner - Builder - Agent

Inspection Record:

Work Started 12/5/74 Foundations Plumbing, Heating

Set Back, Side Lines Plumbing (Rough In) And Air Conditioning

Excavation Erecting Frame Roof

Footing Electrical Work Inspected & approved by N. Howes 12/19/74

Comments:

Certificate of Occupancy Issued

Permit No. 180-74

Issued 12/3/74

By Thomas W. Swanson
Building Inspector

Valuation \$250.00

Fees	Base	Plus	Total
Construction			
Plumbing			
Electrical	\$3.00	\$2.00	\$5.00
Heating			
Water Tap			
Sewer Tap			
Temporary Elec.			
TOTAL	\$3.00	\$2.00	\$5.00

Received 12/2/74 f.w.f.

CITY OF COLUMBUS, OHIO
ELECTRICAL PERMIT APPLICATION

OWNER J. F. HEFFLING CONTRACTOR HAROLD-BOSTELMAN
ADDRESS 327 ~~Cliff~~ St ADDRESS 618 PARK S
LOT NO. 83 ADDITION L.G. Randalls TELEPHONE NO. 592-2383

PANEL INFORMATION

GROUNDING INFORMATION

NO.	SIZE IN AMPS	Total NUMBER CIRCUITS	SIZE OF SERVICE WIRE	GROUNDING
No. 1	100	12	#2 copper	SLEE WIRE # 2
No. 2				GROUND ROD ONLY

Harold aware two grounding methods required. 12-3-74

COST OF PERMIT FIGURED AS FOLLOWS

PERMITTING	COST PER UNIT	NUMBER UNIT	DOLLAR VALUE
<u>Not New circuits, existing</u>			
One (1) Circuit	\$1.00		
Next (9) Circuits	.75		
Each additional circuit	.50		
<u>Harold will contact me for arrangements with City. 12-3-74 f.w.f.</u>			
<u>ELECTRIC PERMITTING</u>			
Each thermostatically heating zone	1.00		
Electric Furnace (See back of Sheet) Incl. 9			
Hot Air Ducts	6.00		
Each additional duct over nine (9)	.75		
<u>ELECTRICAL APPLIANCES</u>			
Electric ranges	1.00		
Range top	1.00		
Oven/Dryer	3.00		
Dishwasher	1.00		
Air Conditioner	1.00		
Attic fan blower	1.00		
Room Exhaust Fan	1.00		
Disposal	1.00		
Water Heater	1.00		
Change Entrance (Only)	5.00	1	\$5.00
<u>GRAND TOTAL (Minimum \$8.00)</u>			

Ken Lange ok'd installation in same location. 12-3-74 f.w.f.


Total \$5.00

For each additional reinspection trip there will be a cost of \$5.00

I, the undersigned, states that I am well informed on the current NATIONAL ELECTRIC CODE (National Fire Protection Association) and agree that all wiring, fixtures and electrical appliances will meet the minimum requirements of the above mentioned Code.

Date Dec. 2, 1974 Signature Harold Bostelman
(Owner or Contractor)

Cost of Job \$250.00

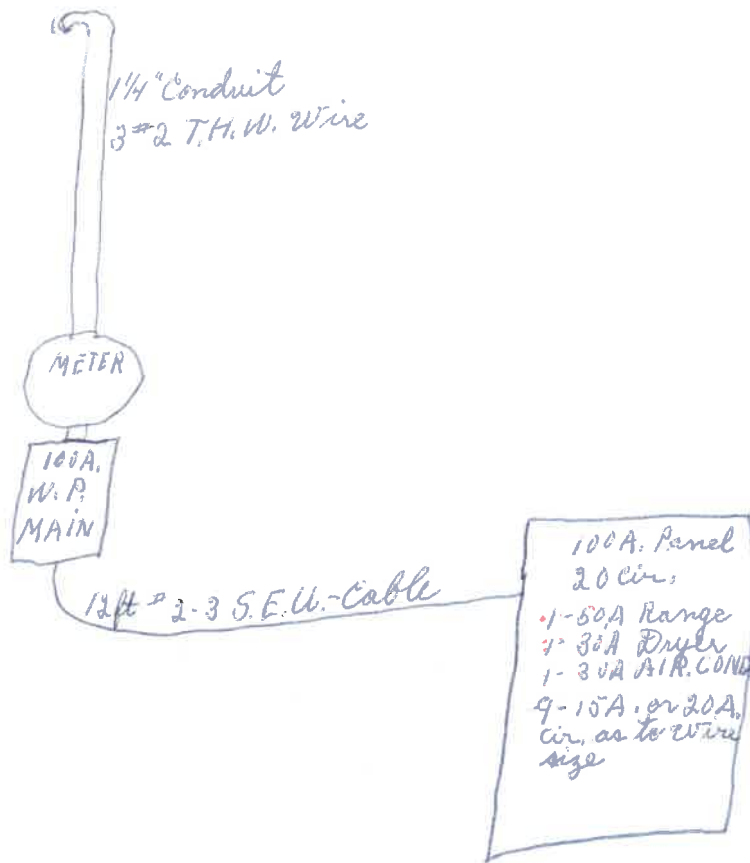

DATE	Dec 9, 1974	JOB NO.	Permit No. 180-74
PROJECT	Electrical - 100AMP Service		
LOCATION	321 Cliff St.		
CONTRACTOR	Harold Bostelman	OWNER	J.F. Hefflinger
WEATHER	_____	TEMP.	_____° at _____ AM _____° at _____ PM
PRESENT AT SITE	Norman Howes - Elect. Inspect. Tom Terranova - Bldg. Inspect. Harold Bostelman - Contractor		

TO Harold Bostelman Electric Co.
618 Park St.
Napoleon, Ohio 43545

THE FOLLOWING WAS NOTED:

On Dec. 5, 1974 the following condition was noted:

- Must replace with ^{10/1/74} ~~10~~ ¹⁰ days of Dec 5, 1974
 12' length of #2-3 S.E.U. cable from main disconnect
 to Distribution Panel with S.E.R. cable to
 conform with ^{Article} ~~with~~ Article 338-2 and 338-3 of
 National Electrical Code, 1971

- Please contact the Engineering Dept. when
 this condition has been corrected for re-inspection.
 Phone No. 592-4010

COPIES TO Harold Bostelman Co. &
on record with permit No. 180-74

FIELD REPORT
 SIGNED Norman W. Howes
 City Bldg. Inspector

