

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #:

ISSUED:

JOB LOCATION: _____

SUBDIVISION NAME: _____ LOT #: _____

OWNER: Spec. Building

ADDRESS: 1650 Commerce Dr.

CONTRACTOR: _____ PHONE: _____

TAP SIZE: 1" _____ 1.5" _____ 2" X OTHER _____

AMOUNT PAID: _____ YOKE SIZE: 5/8


PLUMBING CONTRACTOR: _____ PH: _____

DATE OF TAP: 6-2002 OLD TAP #: _____ NEW TAP #: 0222

SIZE AND KIND OF MAIN: 8" C-900 (tapped fire line)

LOCATION OF MAIN: South edge of building DEPTH OF MAIN: 5'

DIST FROM HYDRANT VALVE: 86' E. of Hyd 534 DIST TO CURB STOP FROM CORP: 6'

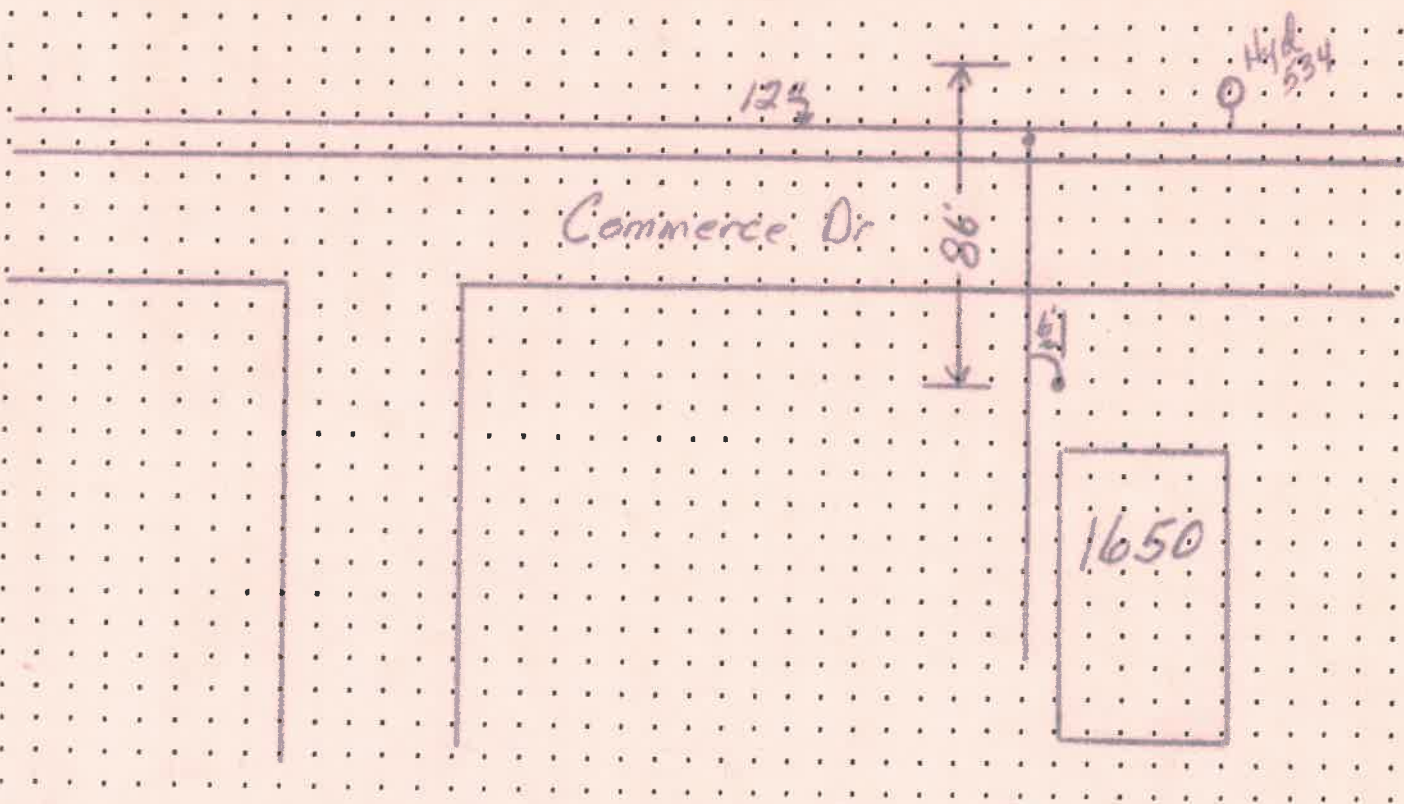

DATE APPROVED: Aug 15, 02

BY: Jffrey C. Mat...