

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department  
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

COMPLETED

Permit No. W-0121 Issued \_\_\_\_\_ Received of Tom Moriarty (\$ 975 ) .00

(Charge for tapping permit to supply water service to) Lot No. 2 Sub Div. Krupp Subdivision  
Street No. Co. Rd. 15 Tap Size 1" Cost \$ \_\_\_\_\_ .00 Plumber Billig RCH

Date completed \_\_\_\_\_ Approved by Jeffrey P. Maitland water distribution dept. \_\_\_\_\_ finance director


Name \_\_\_\_\_ Size of tap 1" Date 11-20-95 Street and No. \_\_\_\_\_

Old Tap No. \_\_\_\_\_ New Tap No. 9593 Size and Kind of Main 8" C-900

Location of Main 12' West of F West pavement Depth of Main 5'

Distance from Hydrant/Valve 1,105' N of Hyd #442 Distance to Curb Stop from Corp. 26'

(10" storm 14x5 15' W. of pavement)  
4 1/2' Deep

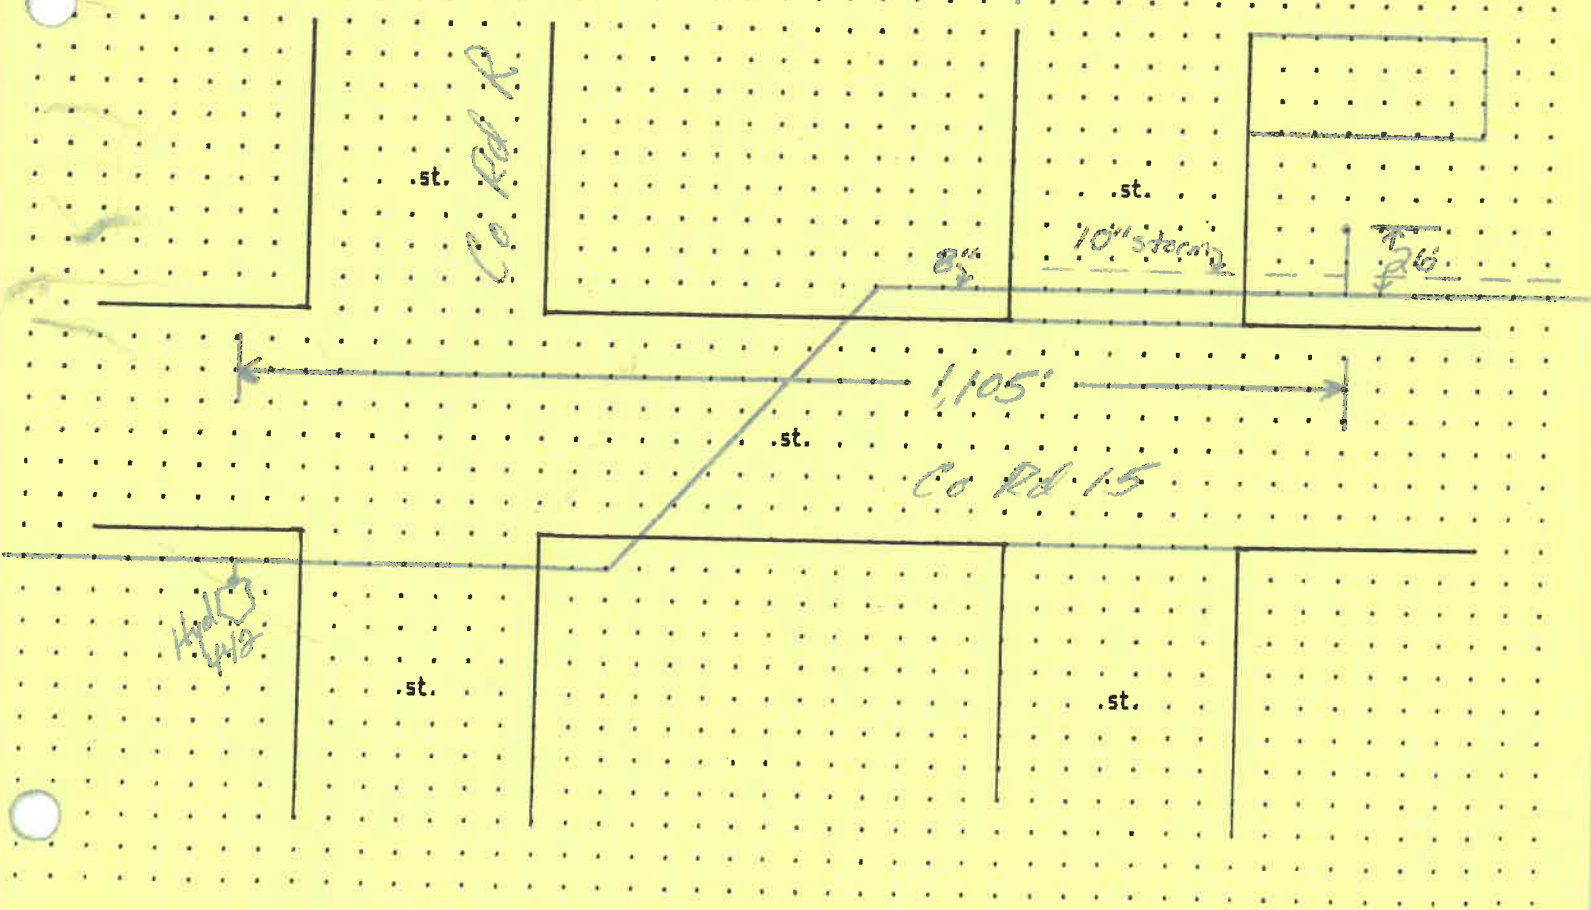

# METER YOKE RELEASE

COMPLETED

This document is for the release of **one (1)** Water Meter Yoke for Residential water service lines.

RELEASE NO. 185  
PERMIT NO. 3668 ISSUED 1-31-96  
JOB LOCATION R-195 Co. Rd. 15 Napokona  
( ) - Inside City Limits (X) - Outside City Limits  
ISSUED BY BMD  
OWNER Tom Moriarty  
ADDRESS 55 Schutte Dr. Nap.  
CONTRACTOR Billing P & H  
ADDRESS T-487 St. Rt. 108 Napokona  
CONTRACTOR'S PHONE NO. 598-8991  
WATER TAP SIZE: (X) = 1" ( ) = 1-1/2" ( ) = 2"  
WATER METER s# \_\_\_\_\_  
(X) - New Dwelling ( ) - Existing Dwelling  
( ) - Lawn Meter

COMPLETED

Water Service Line to be Type (K) Copper or (CTS) Polyethelene Tubing of one inch (1") minimum.

Watts No. 007 Dual check required (X) = Yes ( ) = No

Water Meter Yoke installation is subject to the following conditions:

- 1.) Must be located in an accessible area.
- 2.) Must be in an area not subject to freezing temperatures.
- 3.) Must be eighteen inches (18") above floor level, **not in crawl spaces.**
- 4.) Must comply with the mounting criteria and clearances as set forth in **DRAWING #04403901.**