

SEWAGE SYSTEM INSTALLATION PERMIT

Permit No. 2004429

Date: 07/09/2004

HENRY COUNTY HEALTH DEPARTMENT
104 E. WASHINGTON ST.
NAPOLEON, OH 43545

Installer: SONNENBERG FARM DRAINAGE

6646 COUNTY ROAD A
Address: LIBERTY CENTER, OH 43532

IS GRANTED A PERMIT TO INSTALL A:

NEW Sewage Disposal System () REPAIR to Existing Sewage Disposal System

Owned by: TODD KNIPP

Q726 COUNTY ROAD 15A
Address: NAPOLEON, OH 43545

This permit is issued for a 3 bedroom home located at Q726 COUNTY ROAD 15A, in NAPOLEON TWP.

The sewage system will consist of a:

1500 GALLON SEPTIC TANK

900 FEET OF ELEVATED LEACH FIELD

CURTAIN DRAIN: N

This permit is issued upon the condition that all work will be carried out according to the legal provisions regulating the installation and operation of sewerage and sewage disposal equipment. It may be revoked at any time for failure to comply with the orders and regulations of the Board of Health.

PERMIT VALID TWELVE (12) MONTHS FROM DATE OF ISSUE




, Health Commissioner

Acreage 2 1/2 acre(s)
 Size of Septic Tank(s) 1500 gallons
 Leaching Tile Field _____ Lineal ft.
 Elevated Leach Trench 900 Lineal ft.
 Benchmark Location pin lower south
 Elevation of Fill 24" ~~24"~~ Above/Below Benchmark
 Fill Material Yellow sand (12")
 Trench Dimensions 18" deep 18" wide
 Subsurface Sand Filter _____ sq. ft.
 Discharge to _____

PLAT DRAWING BELOW MUST SHOW THE FOLLOWING:

1. Lot and right-of-way Lines
2. Location of the Dwelling and Other Buildings
3. Location of all Water Supplies within 100 ft. of Sewage System
4. Location of Proposed Sewage Disposal System
5. Location of Ponds and Streams
6. All Drainage Lines within 100 ft. of the Sewage System
7. Area for Replacement Field

DRAW TO SCALE

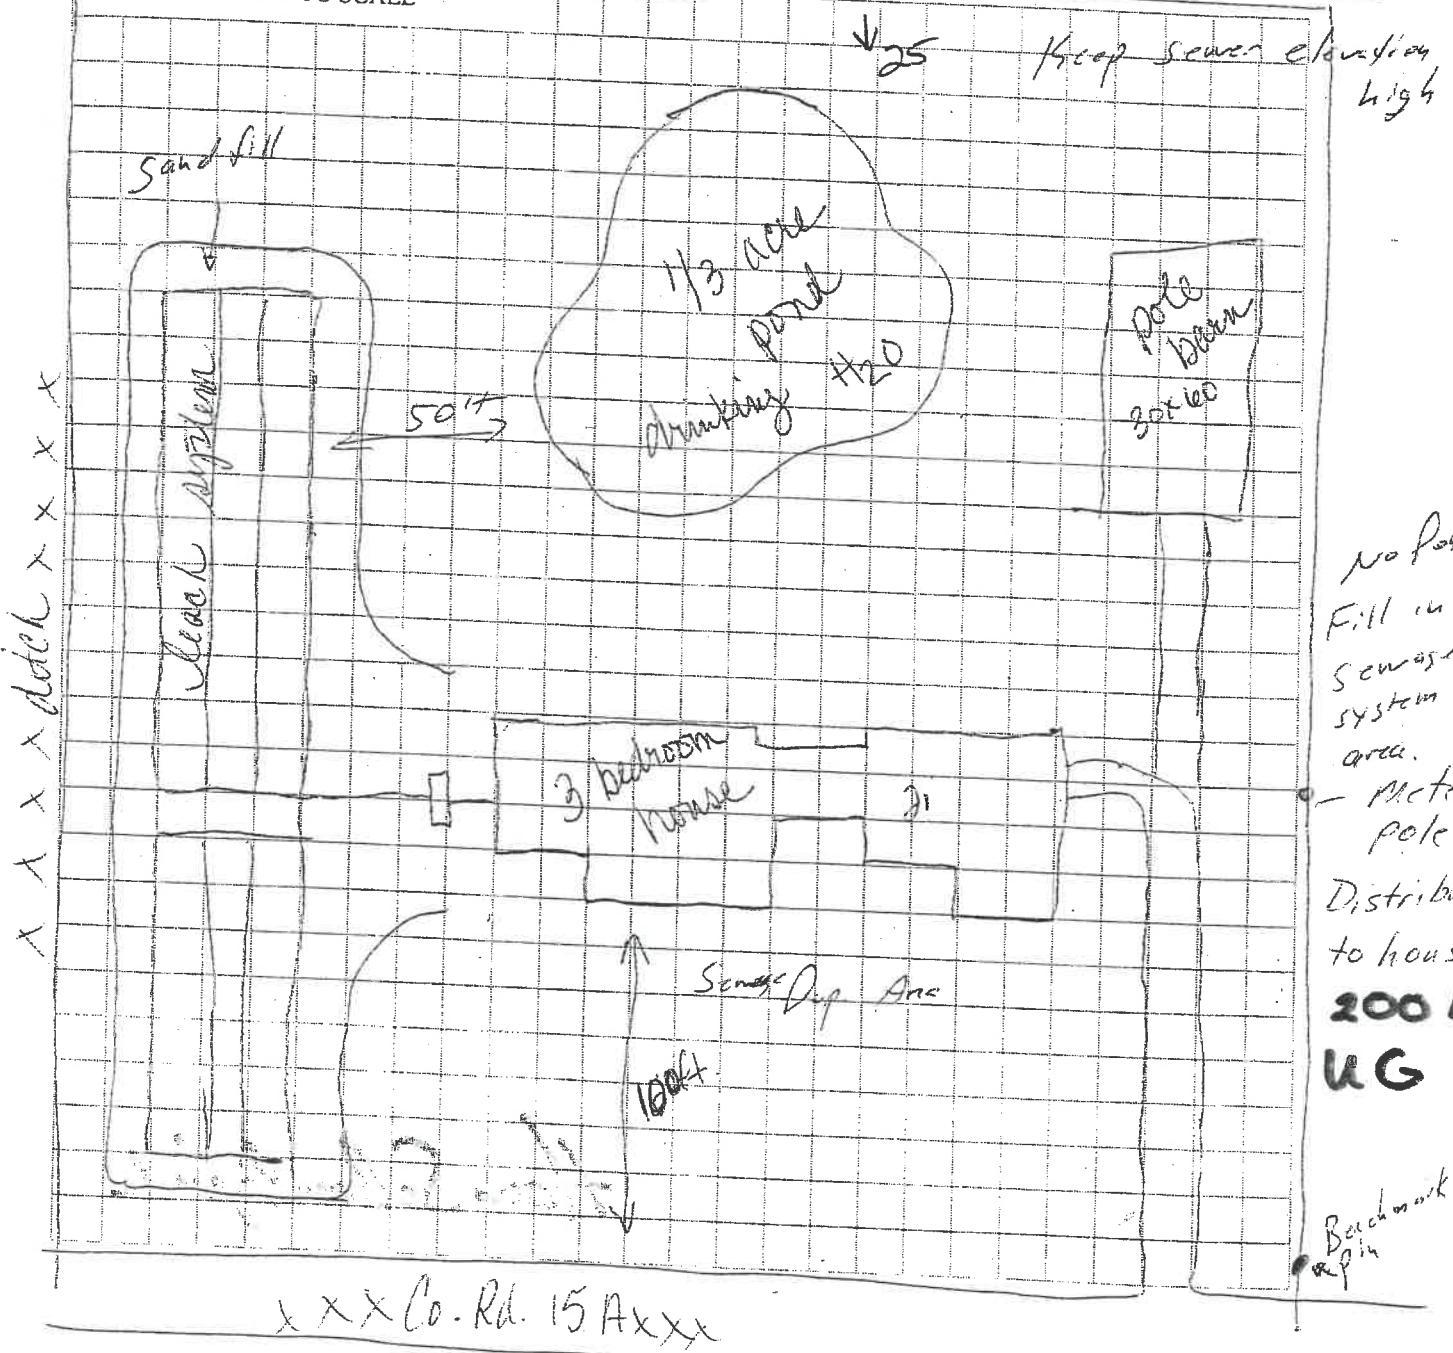

X X X Co. Rd. 15 A X X X

