

P E R M I T

CITY OF NAPOLEON
255 W. RIVERVIEW AVE
NAPOLEON, OHIO 43545

DIVISION OF BUILDING & ZONING
PH (419) 592-4010
FAX (419) 599-8393

PERMIT NO: 583

DATE ISSUED: 05-08-01

ISSUED BY: BND

JOB LOCATION: 16918 CO RD U

EST. COST:

LOT #:

SUBDIVISION NAME:

OWNER: GRIGGS, JEFF
ADDRESS: T768 CO RD 16
CSZ: NAPOLEON, OH 43545
PHONE: 419-598-8836

AGENT: SELF
ADDRESS:
CSZ:
PHONE:

USE TYPE - RESIDENTIAL:

OTHER:

ZONING INFORMATION

DIST: LOT DIM: AREA: FYRD: SYRD: RYRD:
MAX HT: # PKG SPACES: # LOADING SP: MAX LOT COV:

BOARD OF ZONING APPEALS:

WORK TYPE - NEW: REPLMNT: ADD'N: ALTER: REMODEL:

WORK INFORMATION

SIZE - LGTH: WIDTH: STORIES: LIVING AREA SF:
GARAGE AREA SF: HEIGHT: BLDG VOL DEMO PERMIT:

WORK DESCRIPTION
NEW HOME (OUTSIDE)

FEE DESCRIPTION	PAID DATE	FEE AMOUNT DUE
ELECTRICAL PERMIT		0.00

TOTAL FEES DUE 0.00

DATE

APPLICANT SIGNATURE

CITY OF NAPOLEON

ELECTRIC METER BASE RELEASE FORM

THIS DOCUMENT ENTITLES THE HOLDER TO "ONE" ELECTRIC METER BASE
(Please pickup at the City operations garage 1775 Industrial Drive).

PERMIT #: 583

ISSUED: 05-08-2001

JOB LOCATION: 16918 CO RD U

WORK DESCRIPTION: NEW HOME (OUTSIDE)

OWNER: GRIGGS, JEFF

ADDRESS: T768 CO RD 16 NAPOLEON, OH 43545

OWNER PHONE: 419-598-8836

CONTRACTOR: SELF

ADDRESS:

CONTRACTOR PHONE:

ELECTRIC SERVICE UPGRADE _____ NEW SERVICE INSTALLATION X

INDUSTRIAL _____ COMMERCIAL _____ RESIDENTIAL X 1PHASE X 3PHASE _____

SIZE OF SERVICE 100AMP _____ 150AMP _____ 200AMP X 400AMP _____ OTHER _____

HUB SIZE - 1 1/4" _____ 1 1/2" _____ 2" _____

DESIRED VOLTAGE 120/240 X OTHER _____

UNDERGROUND SERVICE X OVERHEAD SERVICE _____

=====


DATE COMPLETED: _____ APPROVED BY: _____

OLD METER NUMBER: _____ NEW METER NUMBER: _____

COMMENTS:

WATER SUPPLY — SEWAGE DISPOSAL SITE EVALUATION

This is Not A Permit — Obtain Permit(s) Before Construction

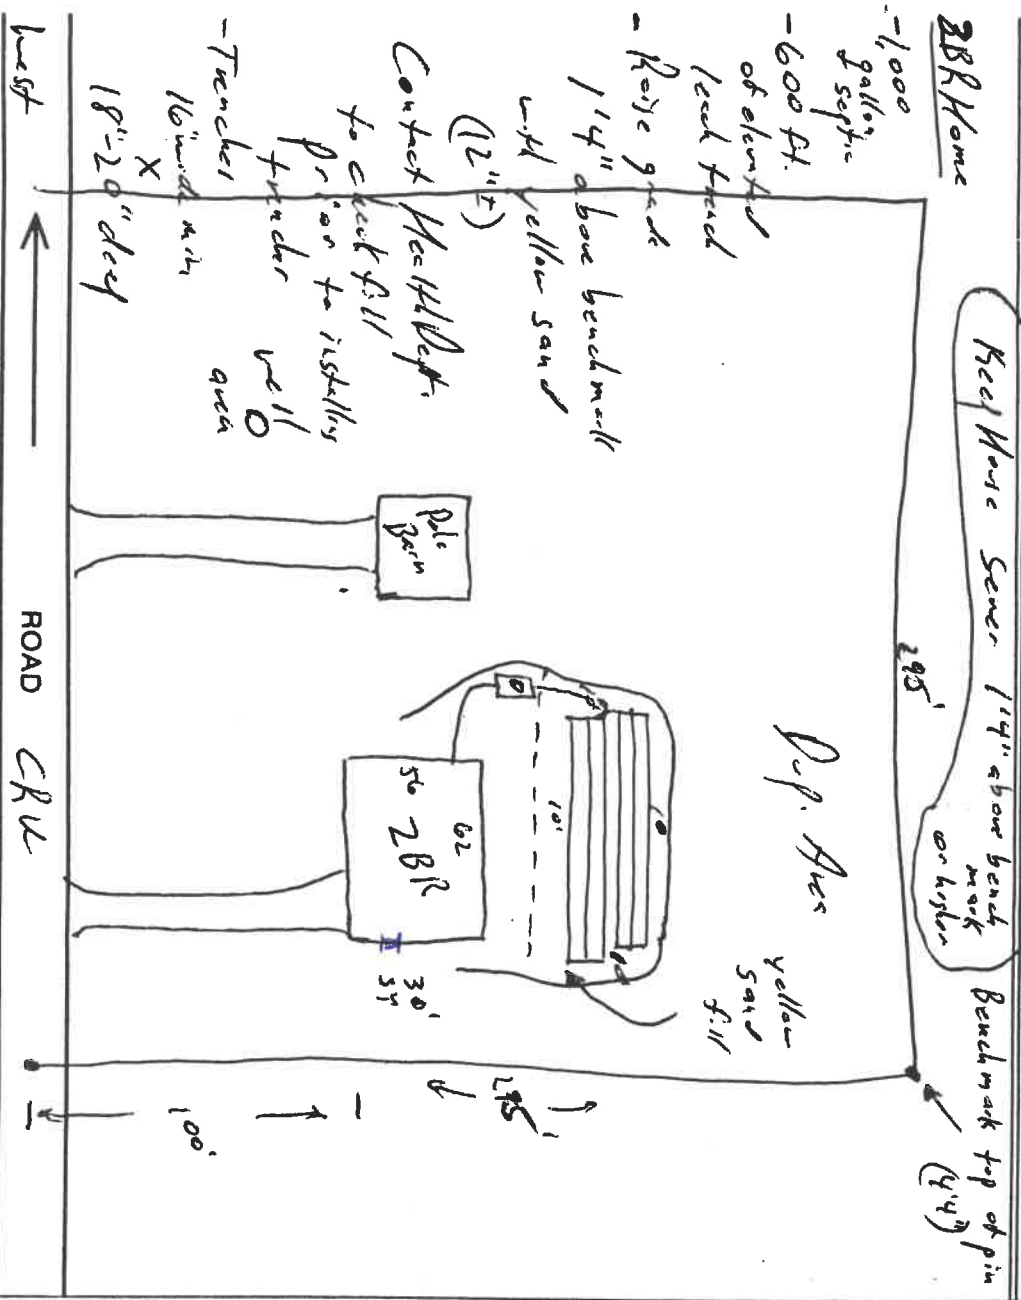

Jeff Gm 6/19/91

OWNER 1768 Co. Rd. 16

LOCATION 16918 CRU

PHONE 598-8836 598-0817

SEWAGE DISPOSAL
Leaching ability of the soil
Slight Moderate
Severe Not Suitable
Ground Water Table Ft.

12" yellow sand Approved
6" + 6" + 6" + 6" Approved
Sewage Disposal Site: Disapproved Existing

WATER SUPPLY
Drilled Dug Pond Other
Public Other

Water Supply Site: Disapproved Approved Existing

HENRY COUNTY HEALTH DEPT.
104 E. Washington, Suite 302
Napoleon, Ohio 43545
PHONE (419) 599-5545
FAX (419) 599-1714

Sanitarian Jon L. Lidger
Date 3-30-01
VOID ONE YEAR AFTER DATE