

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0339 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ " Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_


Date completed \_\_\_\_\_ Approved by Walter Marshall water distribution dept. \_\_\_\_\_ finance director

Name \_\_\_\_\_ Size of tap 1" Date 5-21-98 Street and No. 1220 Detroit

Old Tap No. 2192 New Tap No. 9824 Size and Kind of Main 8" C-900

Location of Main 16' West of West curb Depth of Main 5'

Distance from Hydrant/Valve 102' South of Hyd 165 Distance to Curb Stop from Corp. 46'

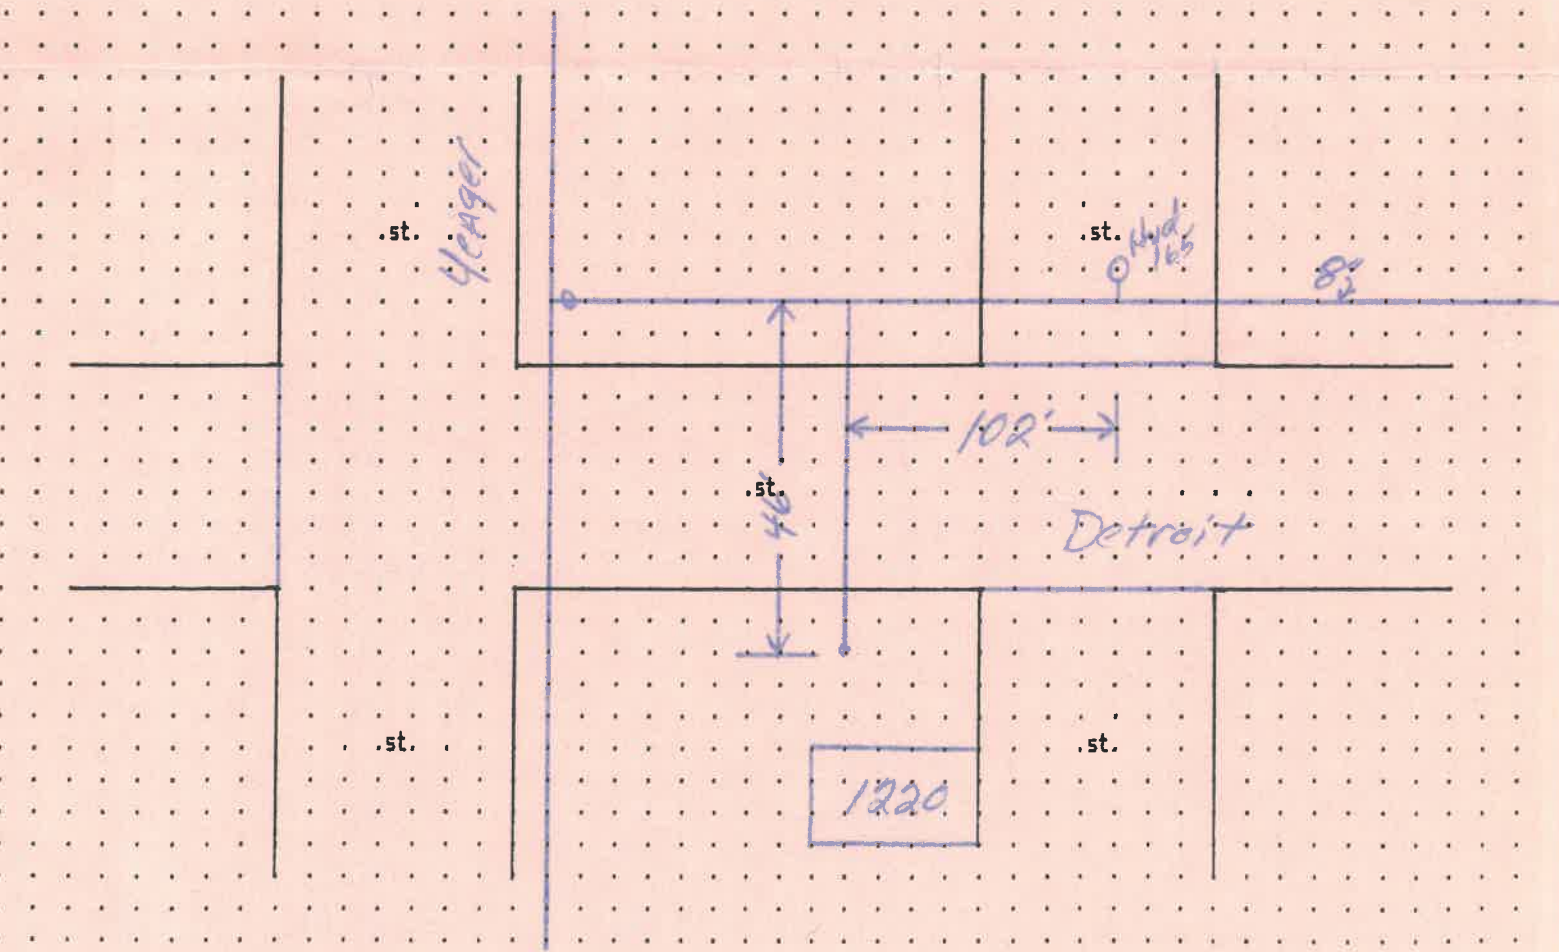

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department  
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0339 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Alfred E. Marchant \_\_\_\_\_

water distribution dept.

finance director

Name \_\_\_\_\_ Size of tap 1" Date 5-21-98 Street and No. 1220 Detroit

Old Tap No. 2192 New Tap No. 9824 Size and Kind of Main 8" C-900

Location of Main 16' West of F West curb Depth of Main 5'

Distance from Hydrant/Valve 102' South of Hyd 165 Distance to Curb Stop from Corp. 46'

