

PERMIT

CITY OF NAPOLEON - BUILDING DEPARTMENT
255 West Riverview Avenue, Napoleon, Ohio 43545 - 419-592-4010

Permit No. 46-79 Issued 5-10-79
date

Job Location 1025 Dodd St.
address

Lot _____ n/a
sub-div or legal discript

Issued By R.P. Johnson
building official

Owner Steve Wilmont
name tel.

Address 1025 Dodd St.

Agent Mike Auster Miller 592-1360
builder-eng.-etc. tel.

Address 1079 Dodd St.

Description of Use New service & wiring

Residential one
no. dwelling units

Commercial _____ Industrial _____

New _____ Add'n. _____ Alter _____ Remodel XX

Mixed Occupancy _____

Change of Occupancy _____

Estimated Cost \$ 800.00

FEE	BASE	PLUS	TOTAL
BUILDING			
ELECTRICAL	\$5.00	7.00	\$12.00
PLUMBING			
MECHANICAL			
DEMOLITION			
ZONING			
SIGN			
WATER TAP			
SEWER TAP			
TEMP. ELECT.			
ADDITIONAL PLAN REVIEW	Struct. _____ hrs		
	Elect. _____ hrs		
TOTAL FEES.....			\$12.00
LESS MIN. FEES PAID _____			0
			<small>date</small>
BALANCE DUE.....			\$12.00

ZONING INFORMATION

district	lot dimensions	area	front yd	side yds	rear yd
max hgt	no pkg spaces	no ldg spaces	max cover	petition or appeal req'd	date appr

WORK INFORMATION:

Size: Length _____ Width _____ Stories _____ Ground Floor Area _____

Height _____ Building Volume (for demo. permit) _____ cu. ft.

Electrical: new 100 amp service & 7 circuits.
brief description

Plumbing: _____
brief description

Mechanical: _____
brief description

Sign: _____ Dimensions _____ Sign Area _____
type

Additional Information: Call for service & final electrical inspections.

PAID
MAY 23 1979
CITY OF NAPOLEON

Date 5-23-79 Applicant Signature Mike Auster Miller
owner-agent

B-29

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(PLEASE PRINT OR TYPE)

The undersigned hereby makes application for the installation, replacement, or alteration of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Code for 1, 2 and 3 Family Buildings.

Owner's Name Steve Wilmont Address 1025 DODD Tel 592-2344
Contractor's Name Mike Austermitter Address 1879 DODD Tel 592-1360

LOT INFORMATION:

Location of Project 1025 DODD ST. Zoning District C

BUILDING INFORMATION:

Single Family Double Family _____ Multiple Family _____
New Construction _____ Existing Addition _____
Replacement _____ Remodel Service Change _____
Size: Total Square Foot Per Floor _____ No. of Stories 2

DESCRIPTION OF WORK

Size of Service 100 AMP. Service Change Only NO (Yes or No)

Total Number of New Circuits 7 Total Number of New Circuits Excluding Appliance Circuits 1 GFCI

APPLIANCE CIRCUITS: (Indicate quantity)

Electric Range _____ Range Hood _____ Clothes Dryer 1 Dishwasher 1
Air Conditioner _____ Attic Fan Blower _____ Room Exhaust Fan 1
Disposal 1 Hot Water Heater _____ Electric Oven _____

Require Temporary Electric NO (Yes or No)

Note: G.P.I.C. required for all temporary electric with approved ground rod at service

APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELECTRICAL LAY-OUT AND RISER DIAGRAM.


ESTIMATED COST OF COMPLETED PROJECT: \$ 800

DATE May 7, 1979 APPLICANT'S SIGNATURE Mike Austermitter
OWNER-CONTRACTOR-AGENT

46-79

12.98

Steve Wilmont Residence
1025 DODD ST.
NAPOLÉON, OHIO
43545

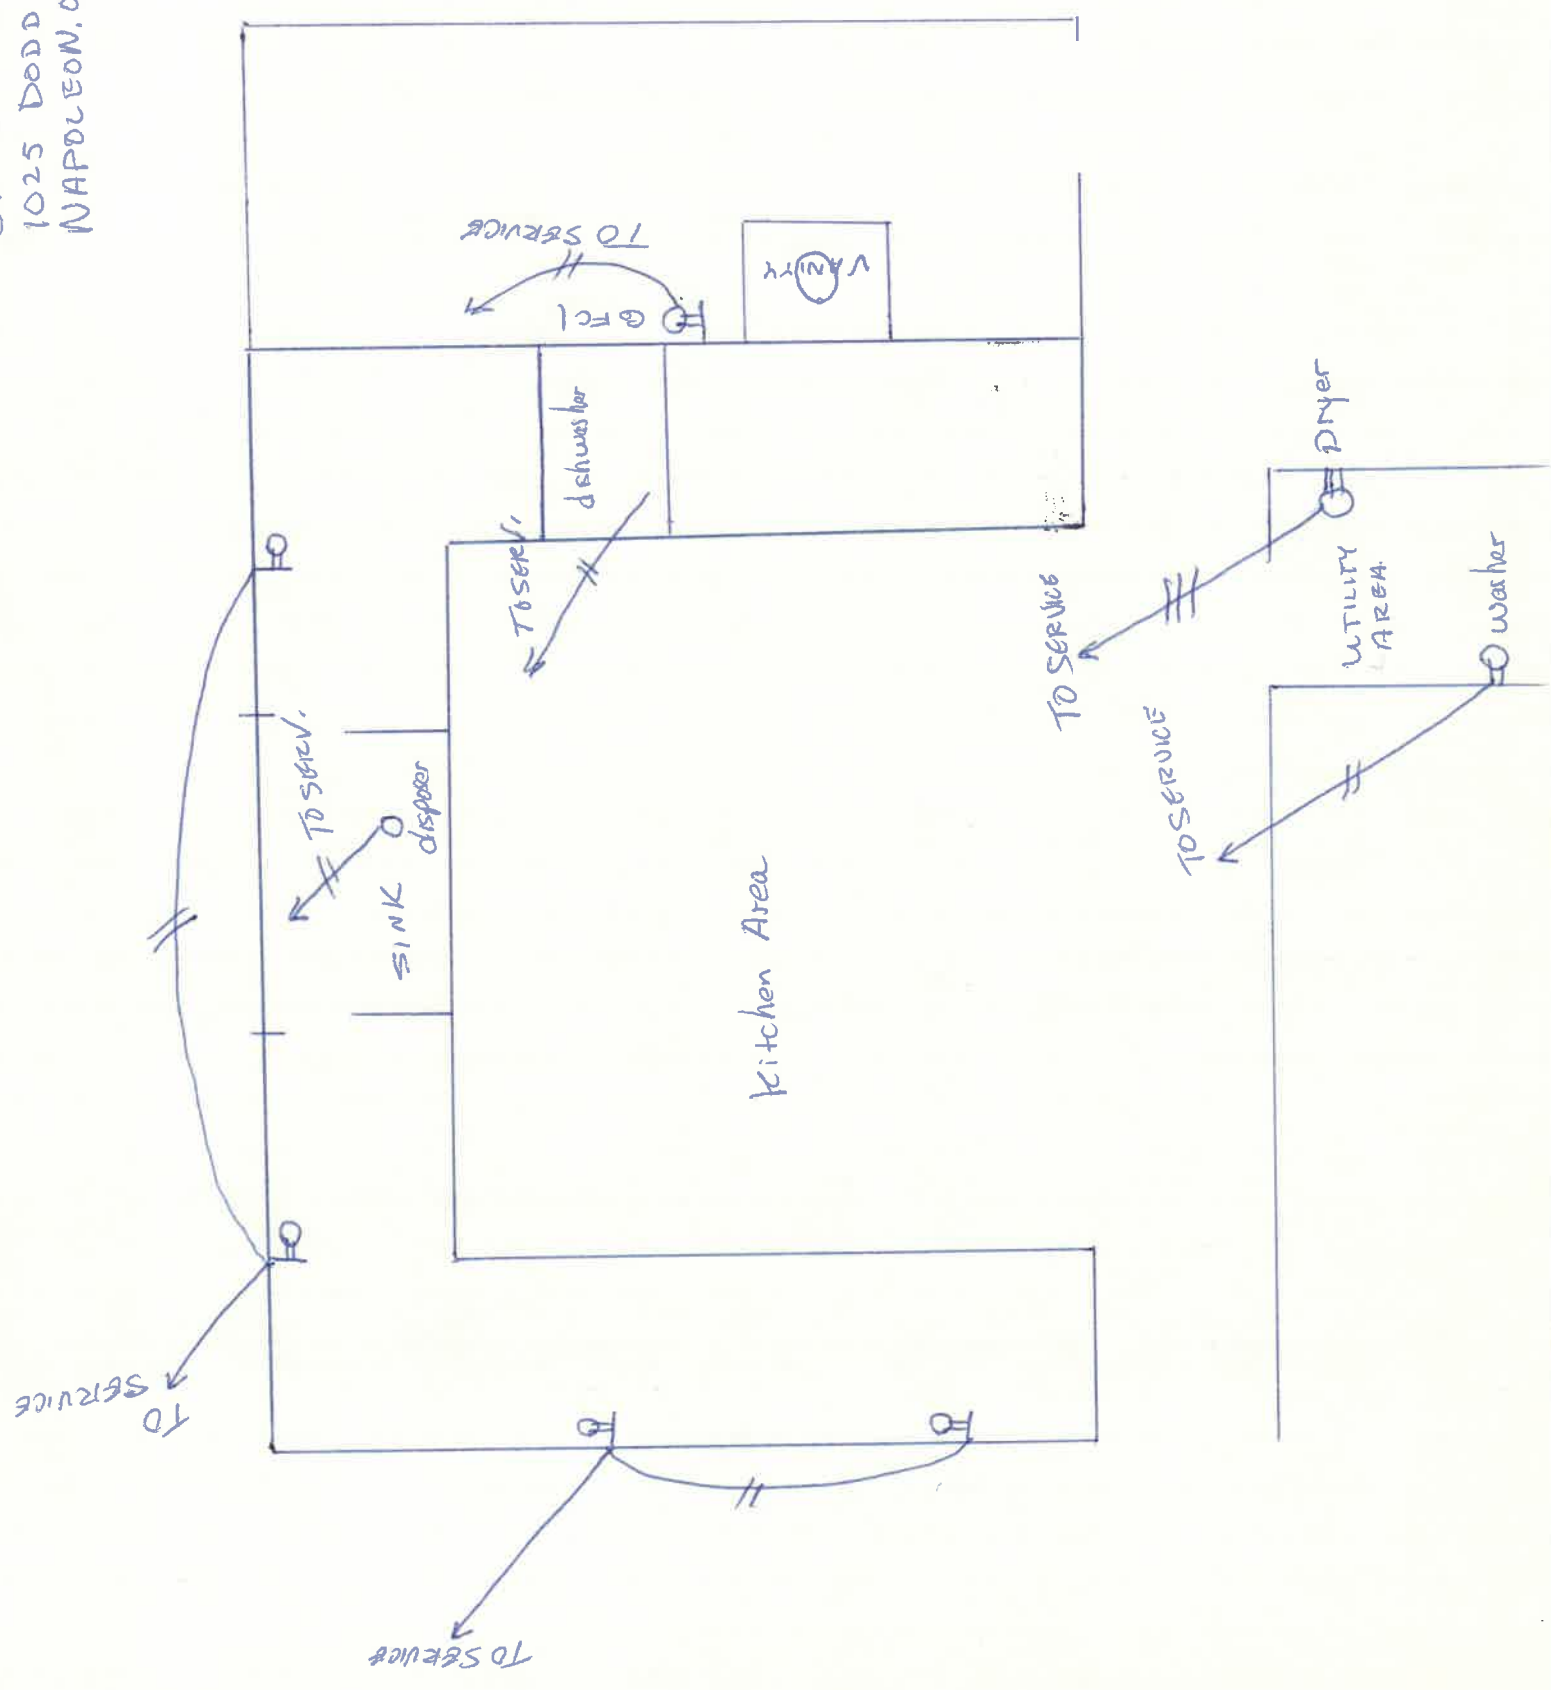



NORM: THIS HAS BEEN TAKEN CARE OF - PLEASE CHECK IT.

CITY OF NAPOLEON

Engineering Department

ELECTRICAL INSPECTION FIELD REPORT

255 Riverview Avenue Napoleon, Ohio 43545

(Please Print or Type)

Project Name WILMONT

Address 1025 DADD ST.

City NAP. State OHIO

Approved _____

Violation

Electrical Contractor AUSTERMULLER

Remarks:

Code Reference

<u>NORM: APPOINTMENT FOR 9:30 A.M.</u>	
<u>① Grounding conductors from service ground must be connected on bus or neutral bus at the main distribution means.</u>	<input checked="" type="checkbox"/>
<u>② Neutral bus in sub panel is a panel neutral (not grounded)</u>	<input checked="" type="checkbox"/>
<u>③ Bare grounding conductors in sub panel will not be connected to neutral bus</u>	<input checked="" type="checkbox"/>

Corrected

31-79

Compliance Time at once

Inspectors Signature M. Thomas

Copies To: _____

CITY OF NAPOLEON

Engineering Department

ELECTRICAL INSPECTION FIELD REPORT

255 Riverview Avenue Napoleon, Ohio 43545

(Please Print or Type)

Project Name *lum. work*

Address *1025 Dodd St*

City *NAP* State *OH*

Approved

Violation *V*

Electrical Contractor *Austermiller*

Remarks:

Code Reference

✓ 1- Grounding to driven rod and metal underground water lines *350-81(a)*

✓ 2- Feed to sub Panel requires insulated neutral *250-61(b)*

✓ 3- NM Cable in unfinished basement to be run through bored holes in joists or on running boards *336-8*

✓ 4- Electrical work to be installed in a neat & workmanlike manner *110-12*

Compliance Time *at once*

Inspectors Signature *Norman Jones*

Copies To: *Mike Austermiller 1079 Dodd St. Nap, O.*

