

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

COMPLETED

Permit No. W-0299 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by William E. Montgomery
water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 2-14-96 Street and No. 424 Euclid

Old Tap No. 2666 New Tap No. 9603 Size and Kind of Main 8" C-900

Location of Main 8' South of South pavement Depth of Main 5'

Distance from Hydrant/Valve 278' East of Hyd 197 Distance to Curb Stop from Corp. 42'

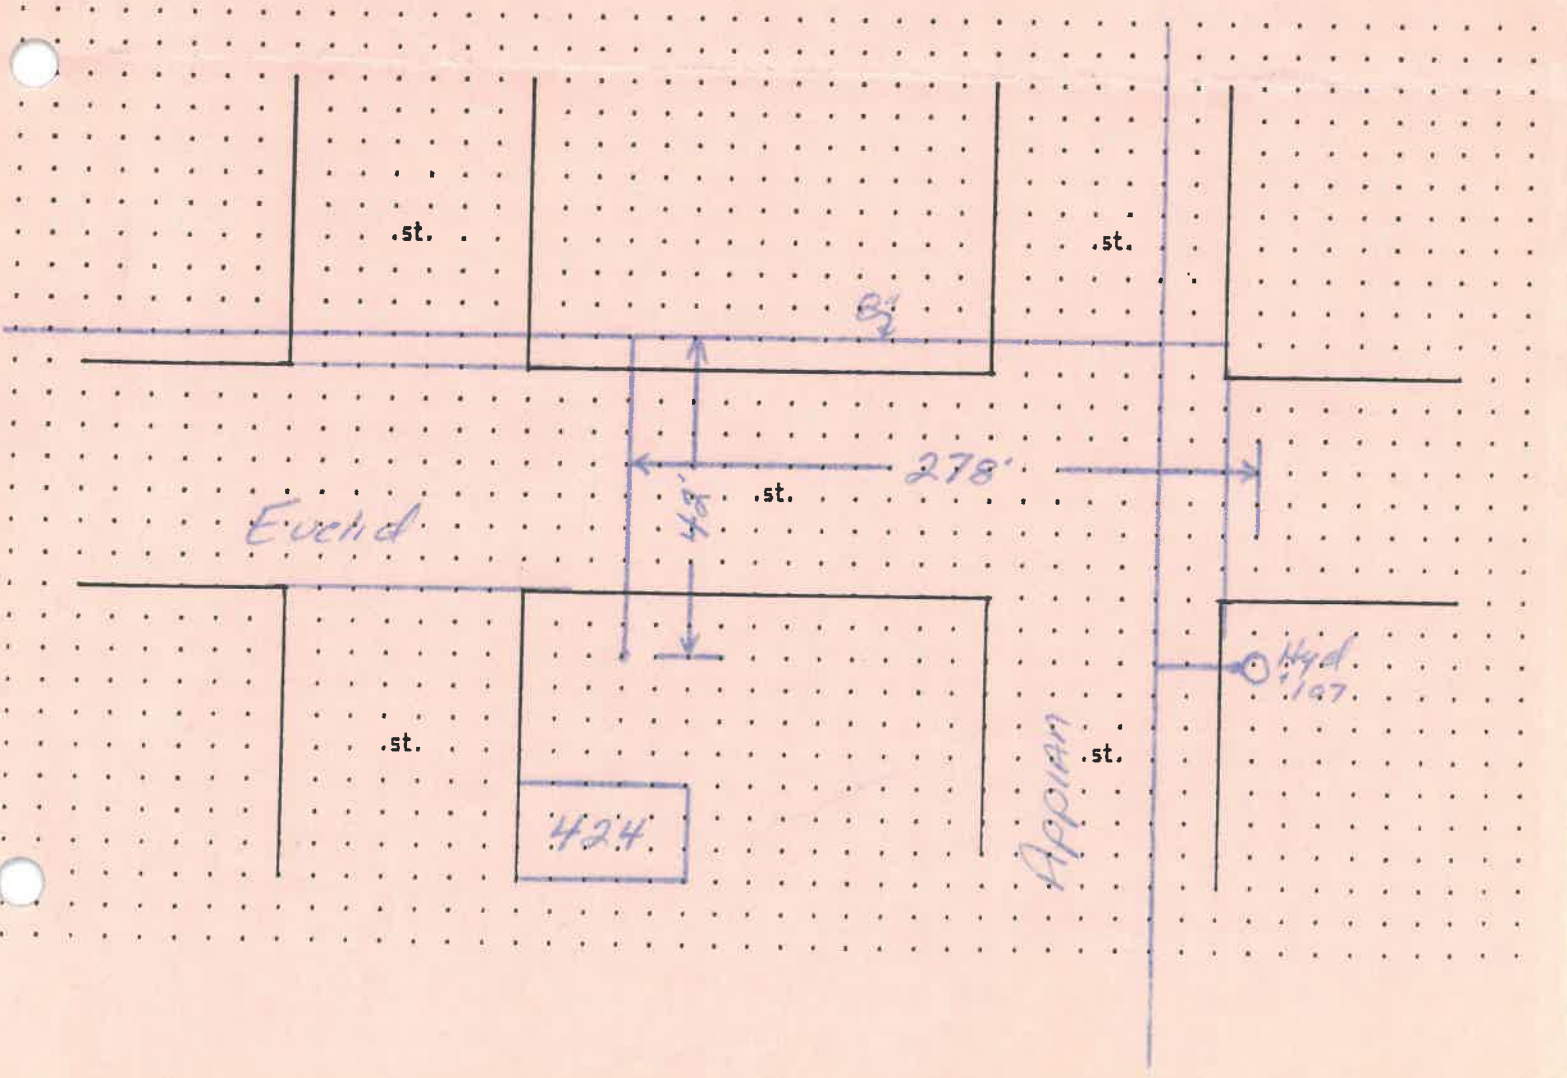

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0299 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by William E. Montague
water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 2-14-96 Street and No. 424 Euclid

Old Tap No. 2666 New Tap No. 9603 Size and Kind of Main 8" C-900

Location of Main 8' South of South pavement Depth of Main 5'

Distance from Hydrant/Valve 278' East of Hyd #197 Distance to Curb Stop from Corp. 42'

