

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W- 0297 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Jeffrey C. Mantz water distribution dept. _____ finance director


Name _____ Size of tap 1" Date 12/15/95 Street and No. 505 Euclid

Old Tap No. 1042 New Tap No. 95117 Size and kind of Main 8" C-900

Location of Main 5' South of South Ave Depth of Main 5'

Distance from Hydrant/Valve 121' West of Hydrant Distance to Curb Stop from Corp. 17'

COMPLETED

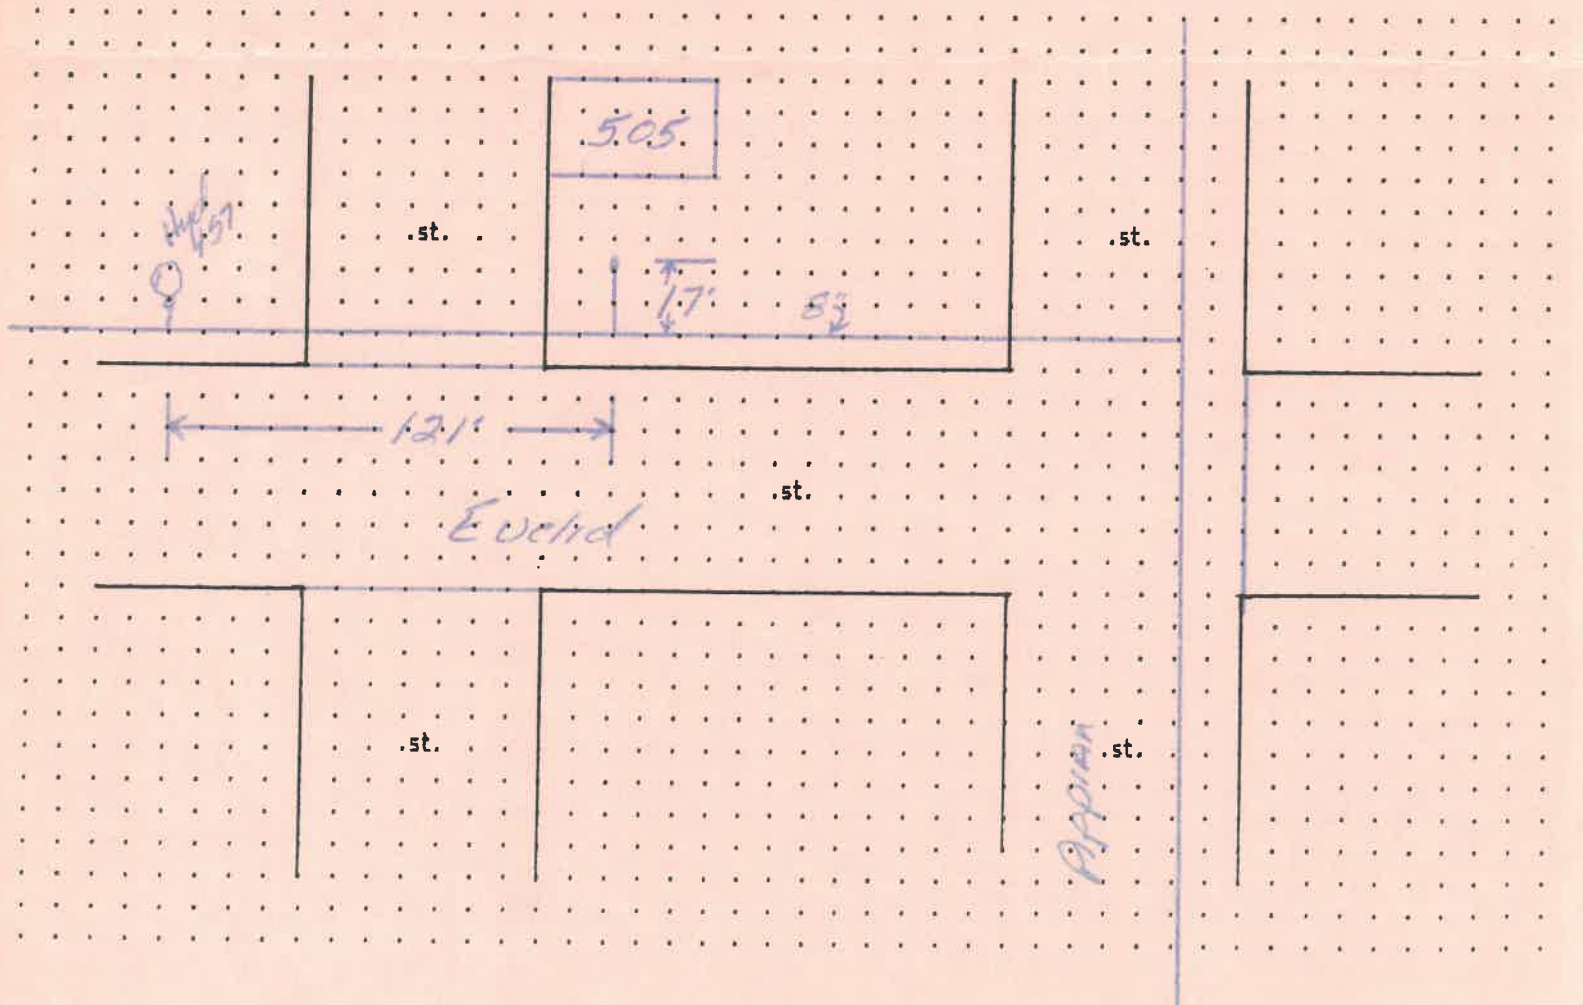

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0297 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by *Jeffrey C. M... [Signature]* water distribution dept. _____ finance director

Name _____ Size of tap *1"* Date *12-15-95* Street and No. *505 Euclid*

Old Tap No. *1042* New Tap No. *95117* Size and Kind of Main *8" C-900*

Location of Main *5' South of South pavement* Depth of Main *5'*
(outside pit)

Distance from Hydrant/Valve *131' West of Hyd #457* Distance to Curb Stop from Corp. *17'*

