

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0279 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_) .00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ \* Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_


Date completed \_\_\_\_\_ Approved by \_\_\_\_\_  
water distribution dept. \_\_\_\_\_ finance director \_\_\_\_\_

Name \_\_\_\_\_ Size of tap 1" Date 12-19-95 Street and No. 542 Euclid

Old Tap No. 9349 New Tap No. 95116 Size and Kind of Main 8" C-700


Location of Main 11' South of South pavement Depth of Main 5'

Distance from Hydrant/Valve 286' East of Hyd 457 Distance to Curb Stop from Corp. 46'

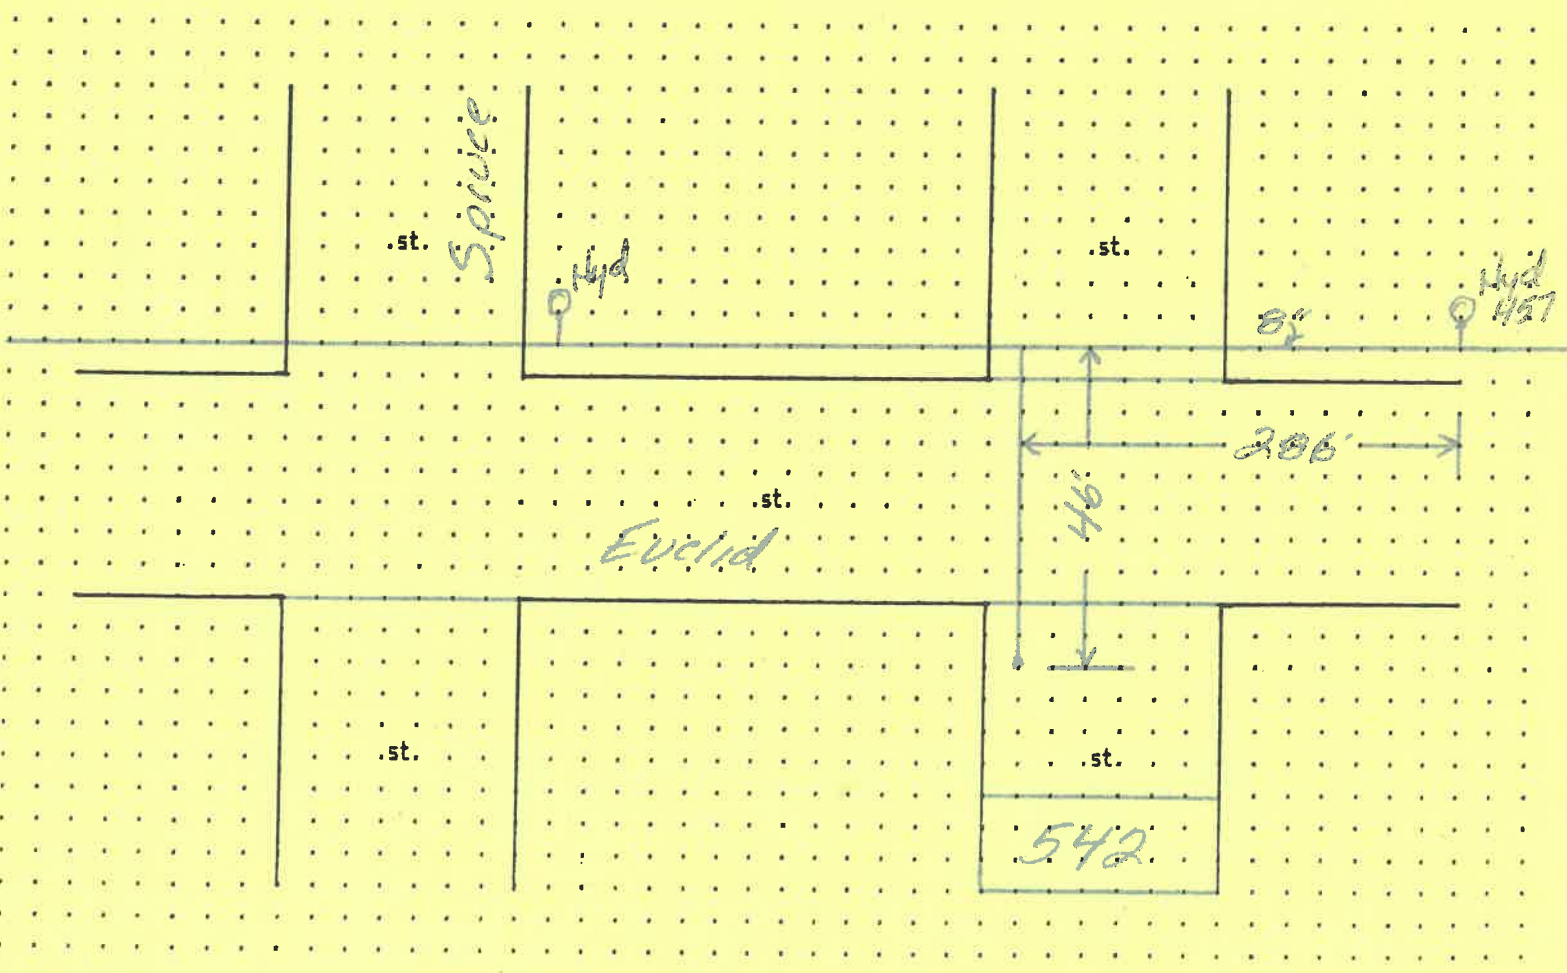

10-3-92

Dwight Kym Wachtmann

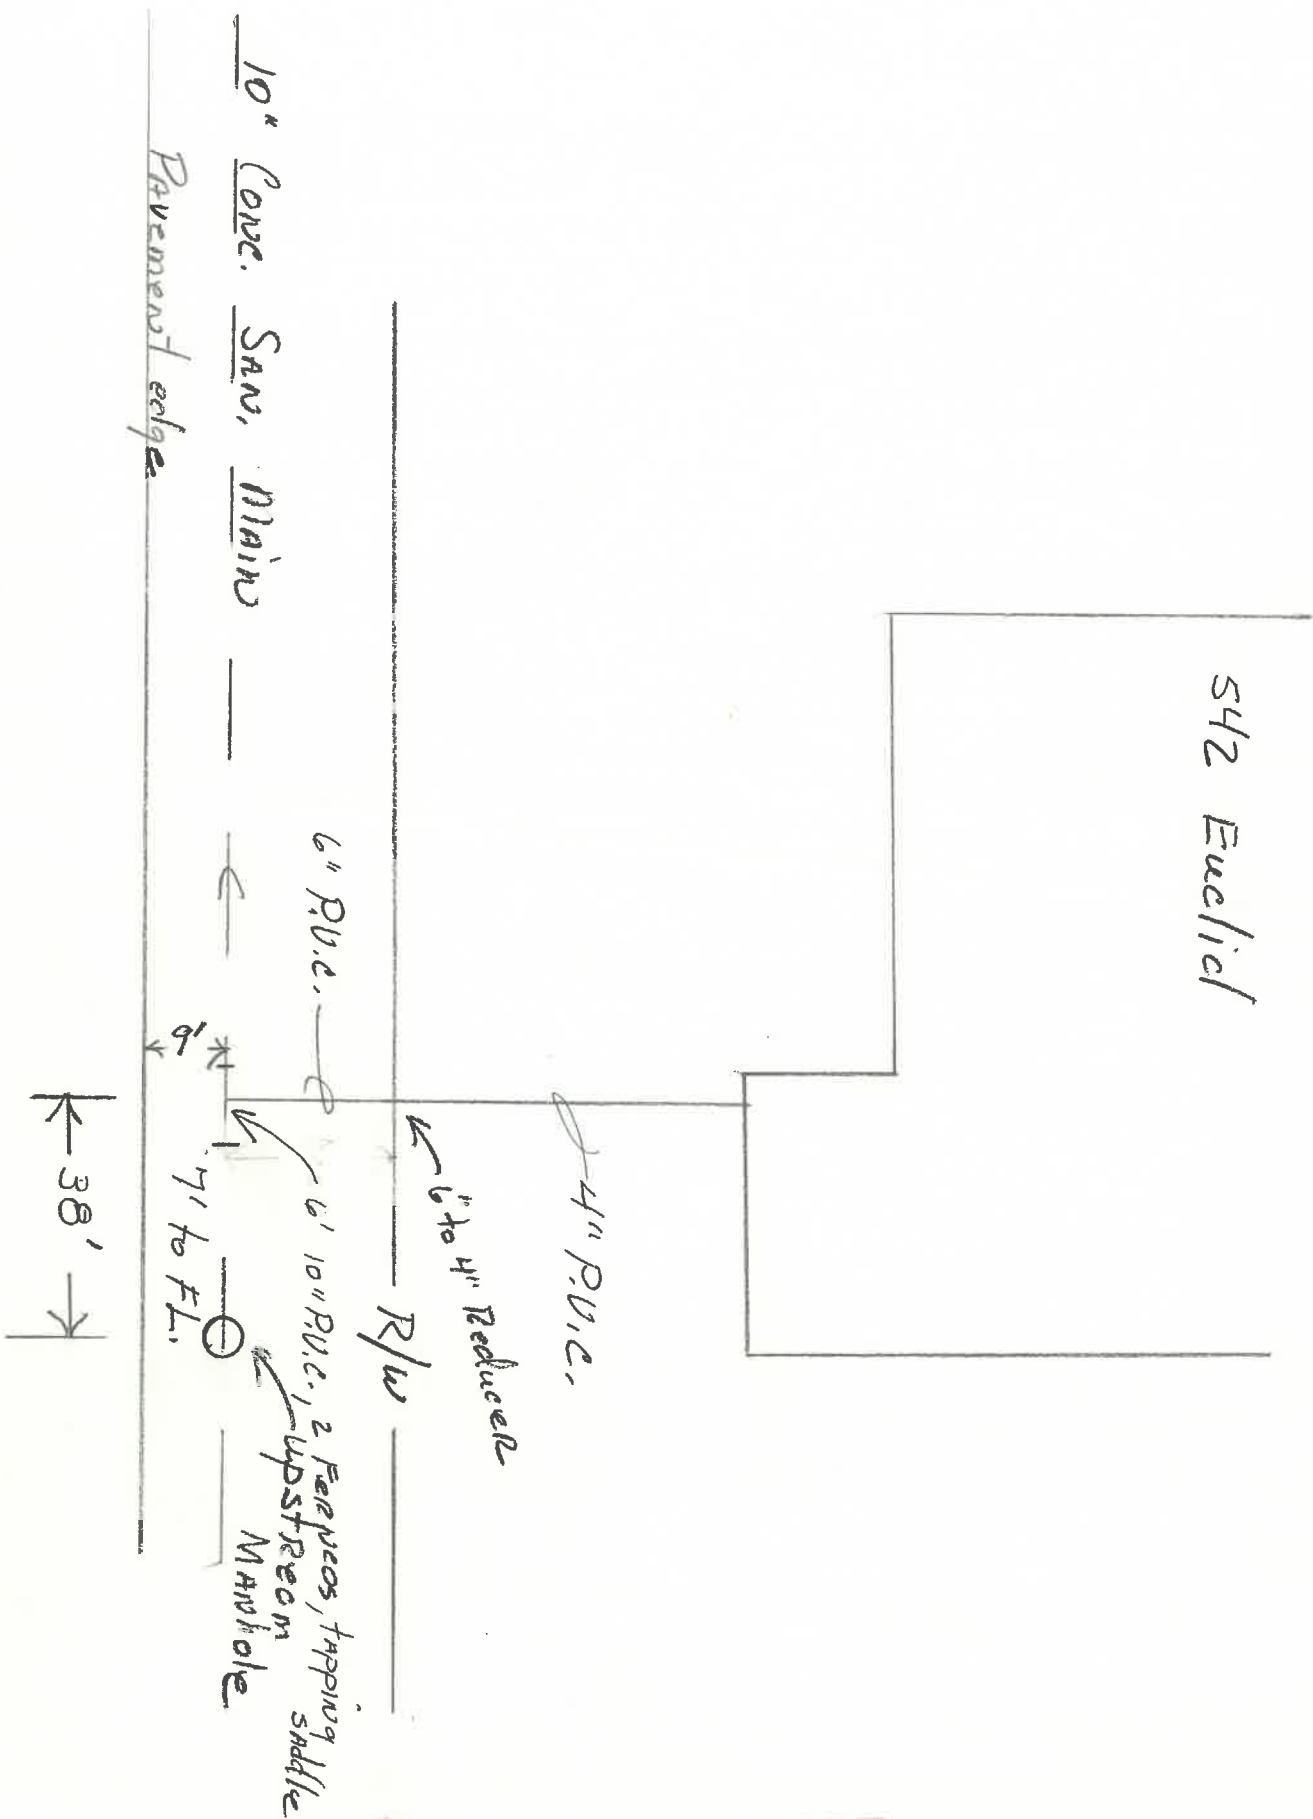

Malcolm Helberg