

WATER TAPPING PERMIT
 issued by
 The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0193 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey E. Mantel water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 6-4-97 Street and No. 195 FAIR

Old Tap No. 8033 New Tap No. 9710 Size and Kind of Main 6" AC

Location of Main 3' South of North curb Depth of Main 5'

Distance from Hydrant/Valve 102' W of Hyd 467 Distance to Curb Stop from Corp. 44'
 (Their end 1" plastic w/ no tracing wire)

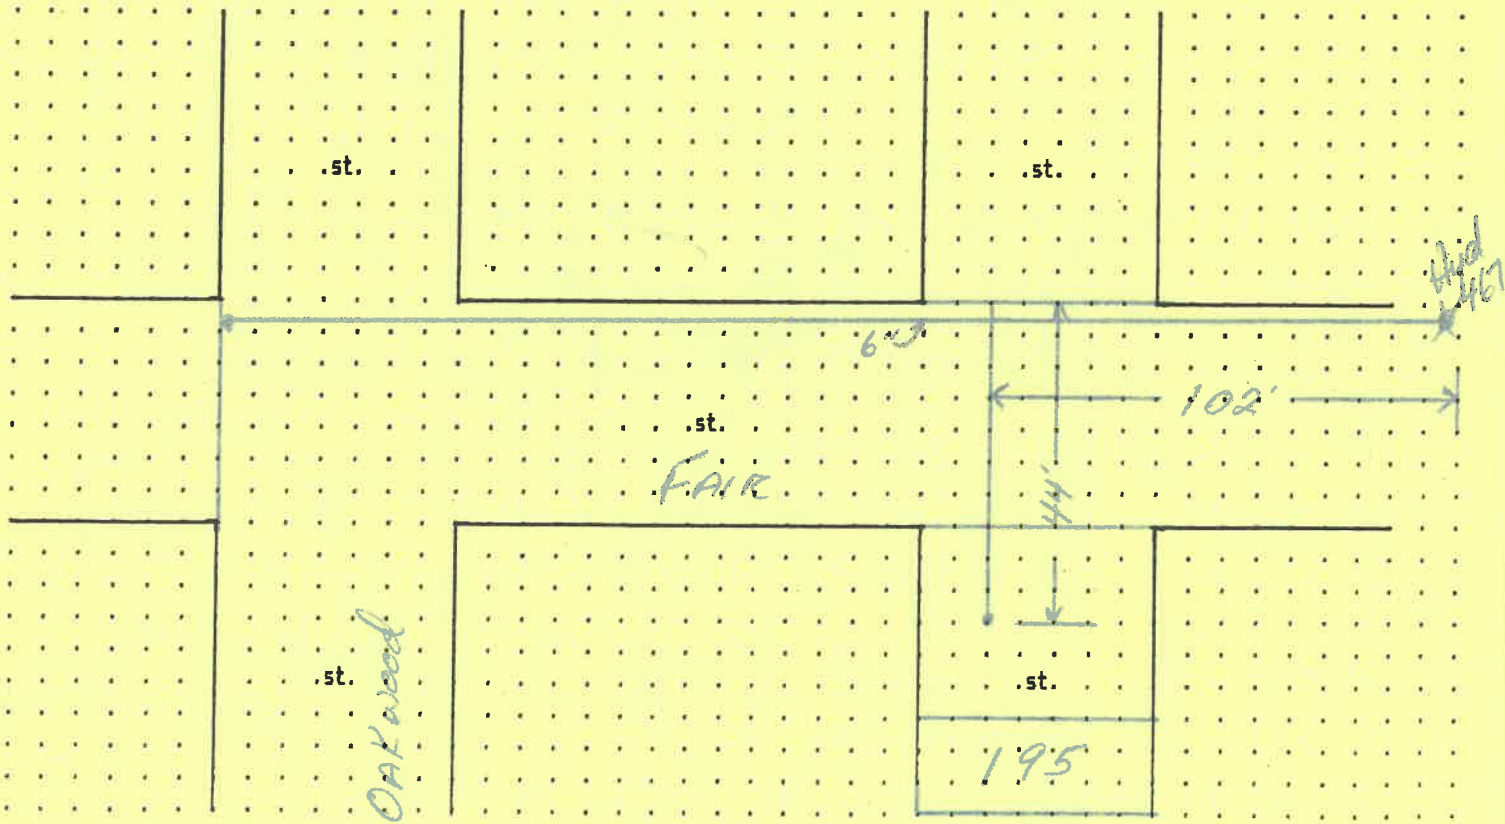

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W- 0193 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Jeffrey C. Mantel _____
 water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 6-4-97 Street and No. 195 FAIR

Old Tap No. 8033 New Tap No. 9710 Size and Kind of Main 6" AC

Location of Main 3' South of North curb Depth of Main 5'

Distance from Hydrant/Valve 102' W of Hyd 467 Distance to Curb Stop from Corp. 44'
 (Their end 1" plastic w/ no tracing wire)

