

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #:

ISSUED:

JOB LOCATION: _____

SUBDIVISION NAME: _____ LOT #: _____

OWNER:

ADDRESS: 1020 FAIRVIEW

CONTRACTOR: _____ PHONE: _____

TAP SIZE: 1" X 1.5" _____ 2" _____ OTHER _____

AMOUNT PAID: _____ YOKE SIZE: _____


PLUMBING CONTRACTOR: _____ PH: _____

DATE OF TAP: 11-15-02 OLD TAP #: 2982 NEW TAP #: 0243

SIZE AND KIND OF MAIN: 8" C-900

LOCATION OF MAIN: 8' West of EAST CURB DEPTH OF MAIN: 5'

DIST FROM HYDRANT VALVE: 146' N of Hyd 539 DIST TO CURB STOP FROM CORP: 22'
(outside pit)

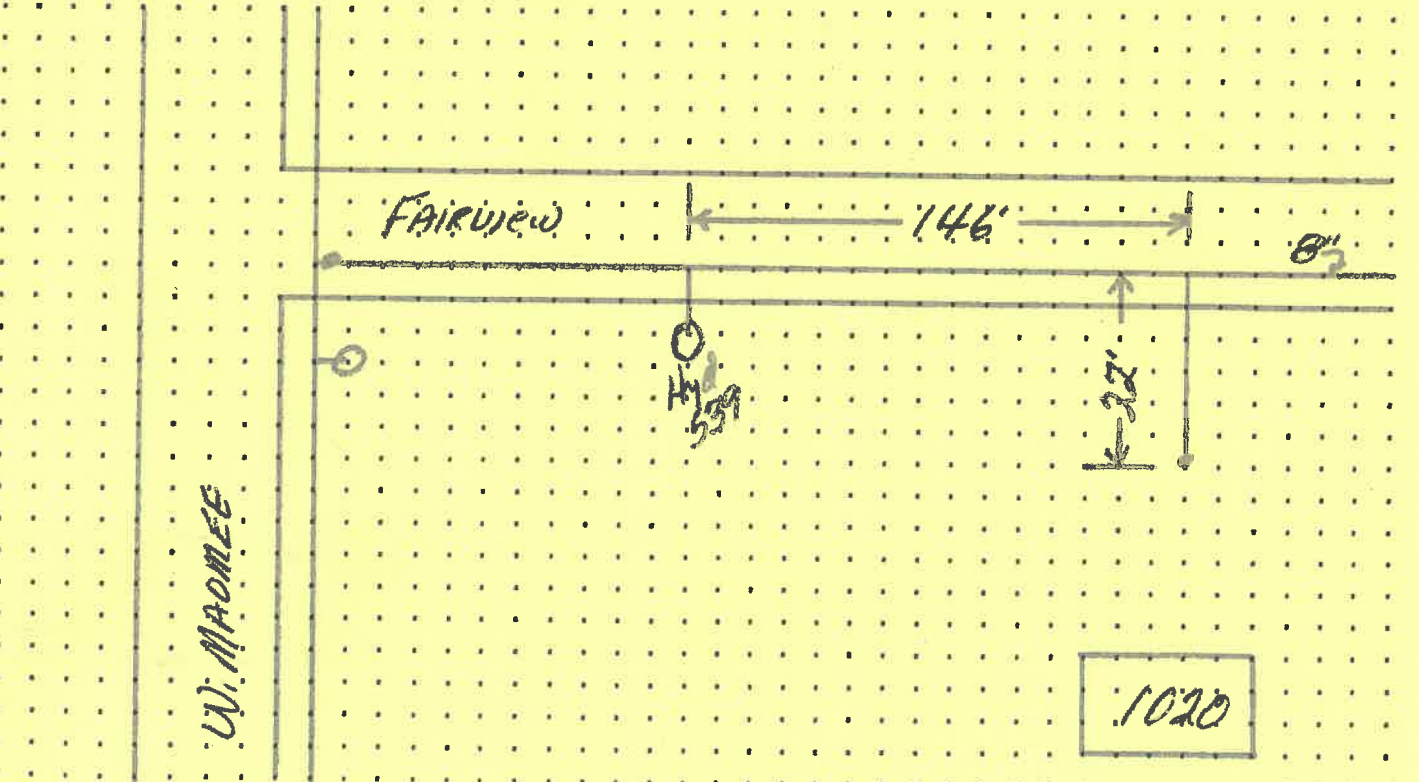

DATE APPROVED: Jan 13, 03

BY: Jeffrey E. Mantel

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #:

ISSUED:

JOB LOCATION: _____

SUBDIVISION NAME: _____ LOT #: _____

OWNER:

ADDRESS: 1020 FAIRVIEW

CONTRACTOR: _____ PHONE: _____

TAP SIZE: 1" X 1.5" _____ 2" _____ OTHER _____

AMOUNT PAID: _____ YOKE SIZE: _____


PLUMBING CONTRACTOR: _____ PH: _____

DATE OF TAP: 11-15-02 OLD TAP #: 3982 NEW TAP #: 0243

SIZE AND KIND OF MAIN: 8" C-900

LOCATION OF MAIN: 8' West of East curb DEPTH OF MAIN: 5'

DIST FROM HYDRANT\VALVE: 146' N. FAIRVIEW DIST TO CURB STOP FROM CORP: 22' (outside pit)

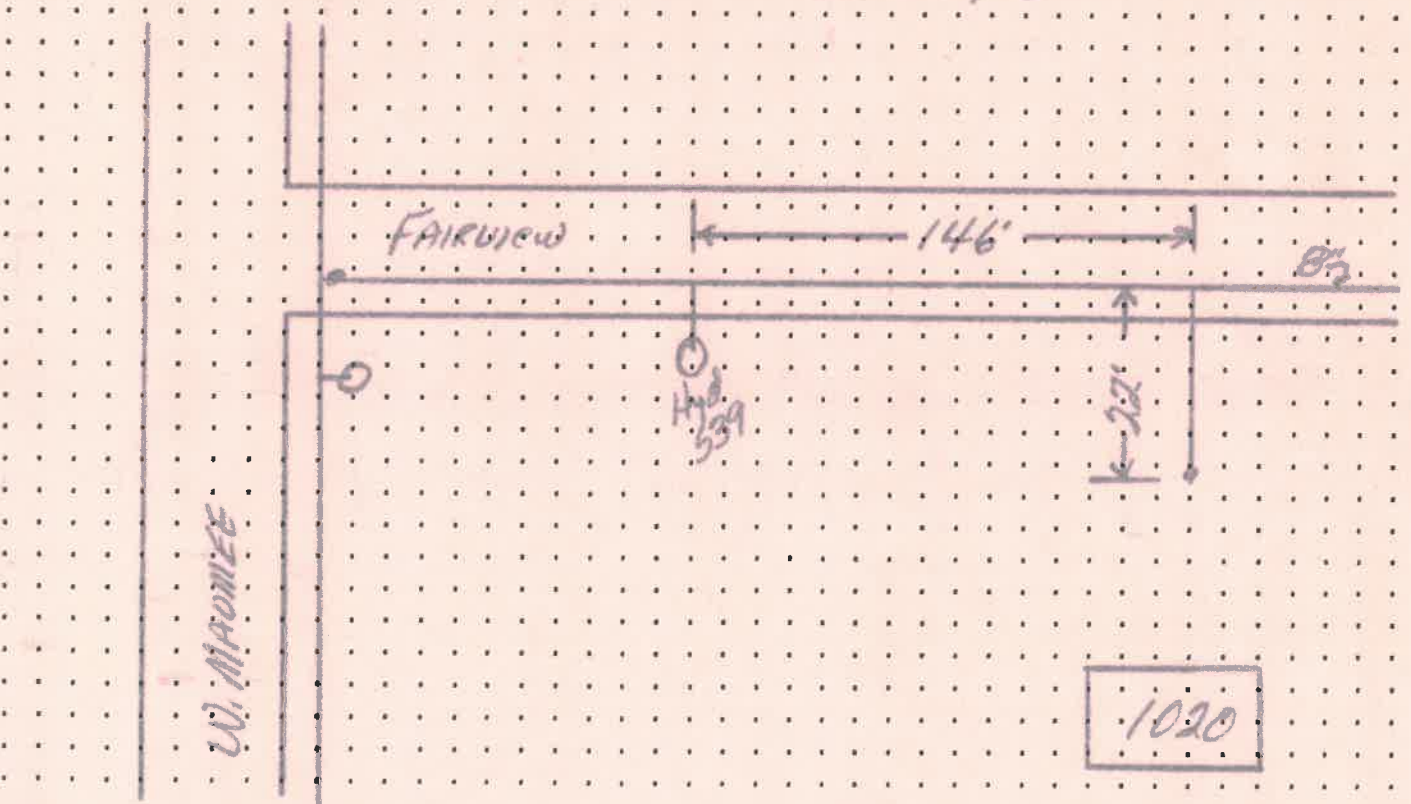

DATE APPROVED: Jan 13, 03

BY: Jeffrey E. Mankin

