

P E R M I T

CITY OF NAPOLEON
255 W. RIVERVIEW AVE
NAPOLEON, OHIO 43545

DIVISION OF BUILDING & ZONING
PH (419) 592-4010
FAX (419) 599-8393

PERMIT NO: 873

DATE ISSUED: 11-02-01

ISSUED BY: SKE

JOB LOCATION: 599 FREEDOM DRIVE

EST. COST:

LOT #:

SUBDIVISION NAME:

OWNER: MILLER BROTHERS TRUCKING,
ADDRESS: 599 FREEDOM DRIVE
CSZ: NAPOLEON, OH 43545
PHONE: 419-599-1113

AGENT: DAVE'S PLUMBING
ADDRESS: 8229 CO RD U-3
CSZ: LIBERTY CENTER, OH 435
PHONE: 419-533-8881

USE TYPE - RESIDENTIAL:

OTHER:

ZONING INFORMATION

DIST: LOT DIM: AREA: FYRD: SYRD: RYRD:
MAX HT: # PKG SPACES: # LOADING SP: MAX LOT COV:

BOARD OF ZONING APPEALS:


WORK TYPE - NEW: X REPLMNT: ADD'N: ALTER: REMODEL:

WORK INFORMATION

SIZE - LGTH: WIDTH: STORIES: LIVING AREA SF:
GARAGE AREA SF: HEIGHT: BLDG VOL DEMO PERMIT:

WORK DESCRIPTION
NEW WATER SERV

FEE DESCRIPTION	PAID DATE	FEE AMOUNT DUE
WATER TAP PERMIT		730.00

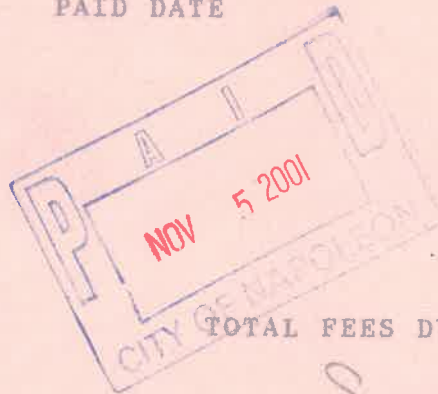

TOTAL FEES DUE 730.00

11-5-01

DATE

Susan M. Miller

APPLICANT SIGNATURE
Miller Bros. Trucking, Inc.

CITY OF NAPOLEON INSPECTION FORM

PERMIT #: 873

DATE ISSUED: 11-02-2001

JOB LOCATION: 599 FREEDOM DRIVE

OWNER: MILLER BROTHERS TRUCKING, INC.

OWNER PHONE: 419-599-1113

CONTRACTOR: DAVE'S PLUMBING

CONTRACTOR PHONE: 419-533-8881

WORK DESCRIPTION: NEW WATER SERV

PLUMBING: UNDGR _____ RGHIN _____ FINAL _____
SEWER INSP _____

MECHANICAL: UNDGR _____ RGHIN _____ FINAL _____
FURNACE REPLC _____ AIR COND _____

ELECTRICAL: UNDGR _____ RGHIN _____ FINAL _____
SERV UPGR _____

BUILDING: SITE _____ FTG _____ FNDDT _____
STRUC _____ ROOF _____ EXT _____
VENT _____ ACCES _____ EGRS _____
SMKDT _____ FINAL _____
ISSUE TEMP OCCUP _____ ISSUE OCCUP _____

STRG SHED: SITE _____ FINAL _____

SIGN: FTG _____ FINAL _____

FENCE: SITE _____ FINAL _____

MISC INSP: _____

NOTES: _____

INSPECTOR INITIALS: _____

CITY OF NAPOLEON

WATER METER YOKE RELEASE FORM

THIS DOCUMENT ENTITLES THE HOLDER TO "ONE" WATER METER YOKE ASSEMBLY
(Please pickup at City Operations Department 1775 Industrial Drive).

PERMIT #: 873

ISSUED: 11-02-2001

JOB LOCATION: 599 FREEDOM DRIVE

OWNER: MILLER BROTHERS TRUCKING, INC.
419-599-1113

PHONE:

ADDRESS: 599 FREEDOM DRIVE NAPOLEON, OH 43545

CONTRACTOR: DAVE'S PLUMBING

ADDRESS: 8229 CO RD U-3 LIBERTY CENTER, OH 43532

PHONE: 419-533-8881

WATER TAP SIZE 1" 1.5" _____ 2" _____ OTHER _____

WATER METER YOKE SIZE 5/8" _____ 3/4" _____ 1" OTHER _____

NEW STRUCTURE _____ EXISTING STRUCTURE LAWN METER _____

WATER SERVICE LINE TO BE TYPE "K" COPPER OR "CTS" POLYETHELENE TUBING OF 1" MINIMUM SIZE.

BACKFLOW DEVICE REQUIRED YES NO _____

TYPE OF BACKFLOW DEVICE REQUIRED Double check valve assembly

WATER METER YOKE INSTALLATION IS SUBJECT TO THE FOLLOWING CONDITIONS

- 1.) MUST BE LOCATED IN AN ACCESSIBLE AREA.
- 2.) MUST BE IN AN AREA WHICH IS NOT SUBJECT TO FREEZING TEMPERATURES.
- 3.) MUST BE AT LEAST 18" ABOVE FLOOR LEVEL (NO CRAWL SPACE INSTALLATIONS).
- 4.) MUST COMPLY WITH MINIMUM MOUNTING REQUIREMENTS (DRAWING AVAILABLE)

ISSUED BY _____ RECEIVED BY _____

1-Copy to: Building Dept, Water Dept, and Utilities Dept

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #:

ISSUED:

JOB LOCATION: _____

SUBDIVISION NAME: _____ LOT #: _____

OWNER: Skip Miller Trucking

ADDRESS: 599 Freedom Dr.

CONTRACTOR: _____

PHONE: _____

TAP SIZE: 1" _____ 1.5" _____ 2" X OTHER _____

AMOUNT PAID: _____ YOKE SIZE: _____


PLUMBING CONTRACTOR: _____ PH: _____

DATE OF TAP: 6-20-01 OLD TAP #: _____ NEW TAP #: 0140

SIZE AND KIND OF MAIN: 8" C-900

LOCATION OF MAIN: 8' North of North curb DEPTH OF MAIN: 5'

DIST FROM HYDRANT\VALVE: 64' W of Hyd 1511 DIST TO CURB STOP FROM CORP: 44'

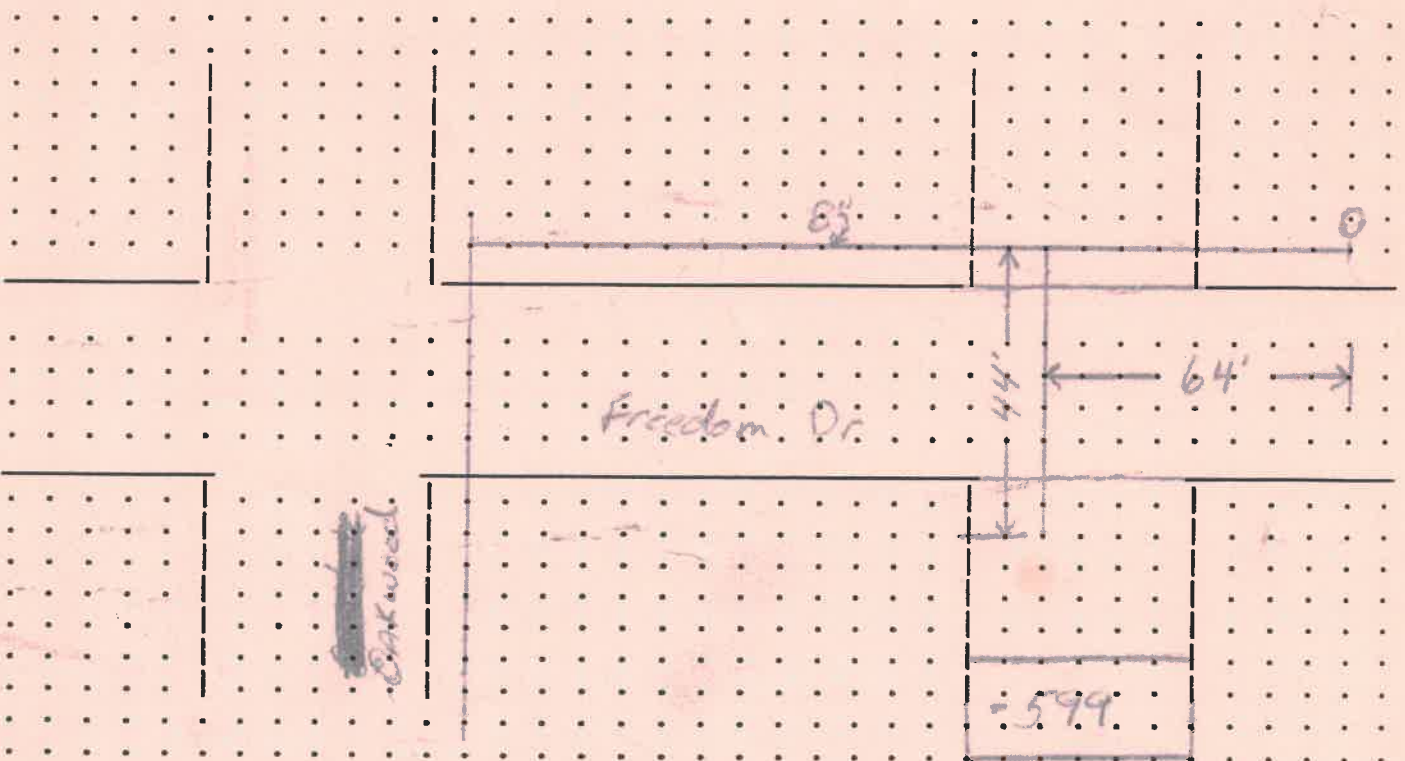

DATE APPROVED: Sept 24, 01

BY: Jeffrey E. Maulugh



City of NAPOLEON, OHIO

255 WEST RIVERVIEW AVENUE, P.O. BOX 151
NAPOLEON, OHIO 43545-0151
(419) 592-4010
FAX (419) 599-8393

August 6, 2001

Mayor
J. Andrew Small

Miller Brothers
599 Freedom Drive
Napoleon, OH 43545

Members of Council
Michael J. DeWit, President
Terri A. Williams
James Hershberger
Travis B. Sheaffer
John A. Helberg
Jean A. Steele
Glenn A. Miller

City Manager
Dr. Jon A. Bisher

Finance Director
Gregory J. Heath

Law Director
David M. Grahn

City Engineer
Joseph R. Kleiner, P.E.

To Whom It May Concern,

In the past month, the City of Napoleon has installed, tested and approved the new water main along Freedom Drive. Service taps have been provided for each business along the new water main route.

The City of Napoleon's Ordinance requires each Residential, Commercial or Industrial owner to connect to the city water main within 90 days of written notice. This letter is your written notice to connect to the City's water main.

Remember to obtain the necessary permits that are required to connect to the City's water supply. Your contractor, after installing the new service, must also disconnect any wells or other water supply sources.

Should you have any questions concerning this matter, please call the Engineering Department at (419) 592-4010, Monday through Friday, 8:00 a.m. to 5:00 p.m.

Respectfully,

Joseph R. Kleiner, P.E.
City Engineer

JRK/ske

cc: Jon Bisher, City Manager
Jeff Marihugh, Operations Supt.