

WATER TAPPING PERMIT

Issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0156 Issued 12-10-76 Received of Beck's Const. (\$ 650 ) .00

(Charge for tapping permit to supply water service to) Lot No. 43 Sub Div. D Tray

Street No. 2402 Ken James Ct Tap Size 1" Cost \$ .00 Plumber Meyer P/H

Date completed Approved by Jeffrey C. Mantel water distribution dept. finance director


Name Beck's Const. Size of tap 1" Date 3-26-97 Street and No. 2402 Ken James Ct.

Old Tap No. New Tap No. 9704 Size and Kind of Main 8" C-900

Location of Main 6' West of West Corp. Depth of Main 6 1/2'

Distance from Hydrant/Valve 157' South of Hyd 464 Distance to Curb Stop from Corp. 35'

(Note: No tracing wire)

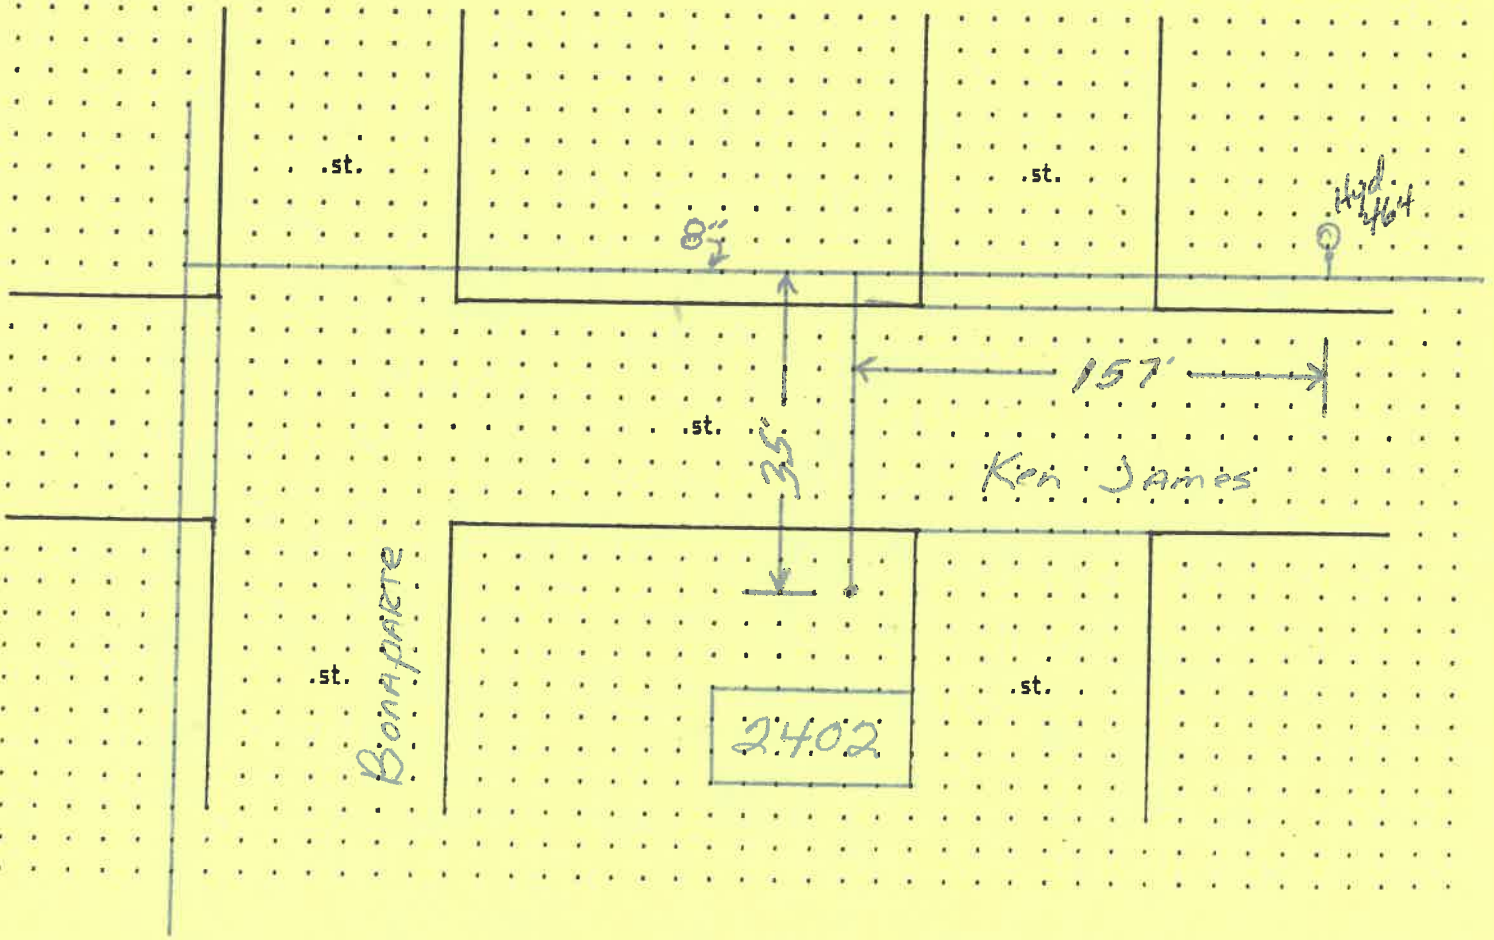

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0156

Issued 12-10-96

Received of Beck's Const.

(\$ 650 ) .00

(Charge for tapping permit to supply water service to) Lot No. 2<sup>nd</sup> 3<sup>rd</sup> Sub Div. Dayton

Street No. 2402 Ken James Ct. Tap Size 1" Cost \$ .00 Plumber Meyer P.H.

Date completed \_\_\_\_\_ Approved by *William C. Maitland*  
water distribution dept.

finance director

Name Beck's Const. Size of tap 1" Date 3-26-97 Street and No. 2402 Ken James Ct.

Old Tap No. \_\_\_\_\_ New Tap No. 9704 Size and Kind of Main 8" C-900

Location of Main 6' West of F West curb Depth of Main 6 1/2'

Distance from Hydrant/Valve 157' South of Hyd 464 Distance to Curb Stop from Corp. 35'

(Note: No tracing wire)

