

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0222 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by J. Perry water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 8-30-96 Street and No. 112 W. MAURICE

Old Tap No. 2030 New Tap No. 9659 Size and Kind of Main 6" CIP

Location of Main 4' North of South curb Depth of Main 4 1/2'

Distance from Hydrant/Valve 126' West of Hyd 101 Distance to Curb Stop from Corp. 28'

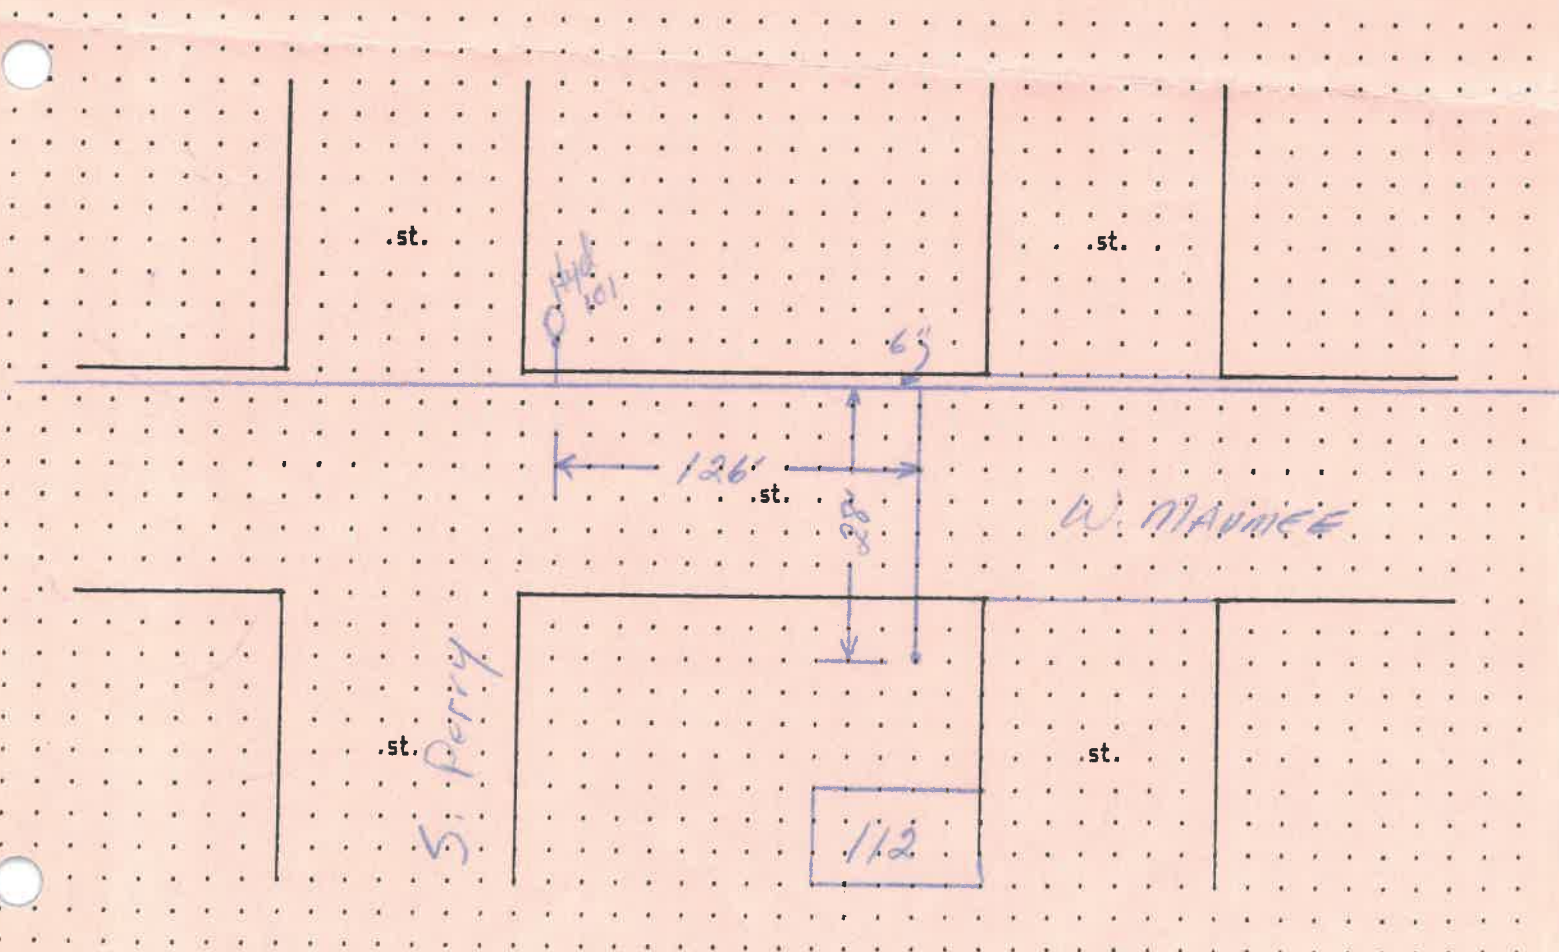

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0222 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by J. Perry water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 8-30-96 Street and No. 112 W NAUMEE

Old Tap No. 2030 New Tap No. 9659 Size and Kind of Main 6" CIP

Location of Main 4' North of South CORB Depth of Main 4 1/2'

Distance from Hydrant/Valve 126' West of Hydrant #101 Distance to Curb Stop from Corp. 28'

