

**CITY OF NAPOLEON  
BUILDING CONSTRUCTION PERMIT  
(1, 2 or 3 Family Dwelling)**

Owner Name Marvin Buchholz  
 Address ANNEX 1015 W. Washington Street  
 Builder Name Harold Bestelman  
 Address 413 Park Street Tel. 592-2383

**Lot Information:**

Street No. 408 W. Naumes Ave, Napoleon, Ohio  
 Lot 1 Subdivision Lower Outlets  
 Lot Dimensions \_\_\_\_\_ Lot Area \_\_\_\_\_ Sq. Ft.  
 Yard Set Back: Front \_\_\_\_\_ Rear \_\_\_\_\_  
 Side \_\_\_\_\_ Side \_\_\_\_\_

Zoning "A" Intended use of Building: New 100 Amp Electric service entrance.

**Building Information:**

Single \_\_\_\_\_ Double \_\_\_\_\_ Multiple X New Construction \_\_\_\_\_ Addition \_\_\_\_\_ Remodel X  
 Size: Length \_\_\_\_\_ Width \_\_\_\_\_ No. of Stories 1 2  
 Floor Area: 1st Floor \_\_\_\_\_ 2nd Floor \_\_\_\_\_ 3rd Floor \_\_\_\_\_ Basement \_\_\_\_\_  
 Unfinished Attic \_\_\_\_\_ Garage \_\_\_\_\_  
 Foundation: Piers \_\_\_\_\_ Full Basement \_\_\_\_\_ Part Basement \_\_\_\_\_  
 Concrete \_\_\_\_\_ Block \_\_\_\_\_  
 Walls: Frame \_\_\_\_\_ Block \_\_\_\_\_ Brick \_\_\_\_\_ Other \_\_\_\_\_  
 Electrical: Wiring New 100 Amp Electric Heating Electrical Appliances \_\_\_\_\_  
 Plumbing: Fixtures or Traps \_\_\_\_\_ Warm Air Heating \_\_\_\_\_ Hot Water Heating \_\_\_\_\_

Additional Information: This permit requires compliance with the attached addendum marked exhibit "A" and made a part here-of.

Date \_\_\_\_\_ Applicant Signature \_\_\_\_\_

*approved 11-9-78 NH*  
 Owner \_\_\_\_\_ Builder - Agent \_\_\_\_\_

3/18/77: SERVICE AND PANEL ONLY INSPECTED AND APPROVED BY HOWES,  
 Inspection Record: 4-7-77 FINAL ELECTRICAL BY NORM HOWES

Work Started \_\_\_\_\_ Foundations \_\_\_\_\_ Plumbing, Heating \_\_\_\_\_  
 Set Back, Side Lines \_\_\_\_\_ Plumbing (Rough In) \_\_\_\_\_ And Air Conditioning \_\_\_\_\_  
 Excavation \_\_\_\_\_ Erecting Frame \_\_\_\_\_ Roof \_\_\_\_\_  
 Footing \_\_\_\_\_ Electrical Work \_\_\_\_\_

Comments: AS OF 12/10/76 NO SIGNS OF ANY WORK BEGUN. AWP

Certificate of Occupancy Issued \_\_\_\_\_

Pink - Engineer

Inspector

Permit No.	<u>100-74</u>		
Issued	<u>August 24, 1976</u>		
By	<u>[Signature]</u> Building Inspector		
Valuation	<u>\$700.00</u>		
	<b>Fees</b>	<b>Base</b>	<b>Plus</b>
Construction			
Plumbing			
Electrical		<u>\$3.00</u>	<u>\$3.00</u>
Heating			
Water Tap			
Sewer Tap			
Temporary Elec.			
<b>TOTAL</b>		<u>\$3.00</u>	<u>\$3.00</u>

Date: 3-8-76

TO: The Building Inspector - Engineering Dept.

FROM: Electric Distribution Superintendent

Confirmed the installation of \_\_\_\_\_ AMP. electrical  
service entrance, located Rear of Building on Porch.

at the following address: 408 West Maunee.

Approved

Not Approved

K. P. King  
Electric Supt.

3-8-76  
Date

Remarks: Needs 3-60 Amp Services. OK.

CITY OF NAPOLEON  
ENGINEERING DEPARTMENT  
APPLICATION FOR ELECTRICAL PERMIT  
(PLEASE PRINT OR TYPE)

The undersigned hereby makes application for the installation, replacement or alteration of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Code for 1, 2 and 3 Family Buildings.

Owner's Name MARVIN-BUCHHOLZ Address 408 WEST-MAUMEE

Contractor's Name HAROLD-BOSTELMAN Address 618 PARK Tel. 592-2383

LOT INFORMATION:

Location of Project 408 WEST-MAUMEE Lot # \_\_\_\_\_

Subdivision \_\_\_\_\_ zoning District "A"

BUILDING INFORMATION:

Single Family \_\_\_\_\_ Double Family \_\_\_\_\_ Multiple Family ✓

New Construction \_\_\_\_\_ Existing \_\_\_\_\_ Addition \_\_\_\_\_

Replacement \_\_\_\_\_ Remodel \_\_\_\_\_ Service Change ✓

Size: Total Square Foot Per Floor \_\_\_\_\_ No. of Stories 2

DESCRIPTION OF WORK

Size of Service 100 AMP. Service Change Only YES (Yes or No)

Total Number of New Circuits \_\_\_\_\_ Total Number of New Circuits Excluding Appliance Circuits \_\_\_\_\_

APPLIANCE CIRCUITS: (indicate quantity)

Electric Range \_\_\_\_\_ Range Hood \_\_\_\_\_ Clothes Dryer \_\_\_\_\_ Dishwasher \_\_\_\_\_

Air Conditioner \_\_\_\_\_ Attic Fan Blower \_\_\_\_\_ Room Exhaust Fan \_\_\_\_\_

Disposal \_\_\_\_\_ Hot Water Heater \_\_\_\_\_ Electric Oven \_\_\_\_\_

Require Temporary Electric NO (Yes or No)

Note: G.F.I.C. required for all temporary electric with approved ground rod at service.


APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELECTRICAL LAY-OUT AND WIRING DIAGRAM.

ESTIMATED COST OF COMPLETED PROJECT: 700.00

DATE AUG-26-76 APPLICANT'S SIGNATURE Harold-Bostelman  
OWNER-CONTRACTOR-AGENT

MARVIN BUCHHOLZ  
408-WEST-MAUMEE

AUG-26-76

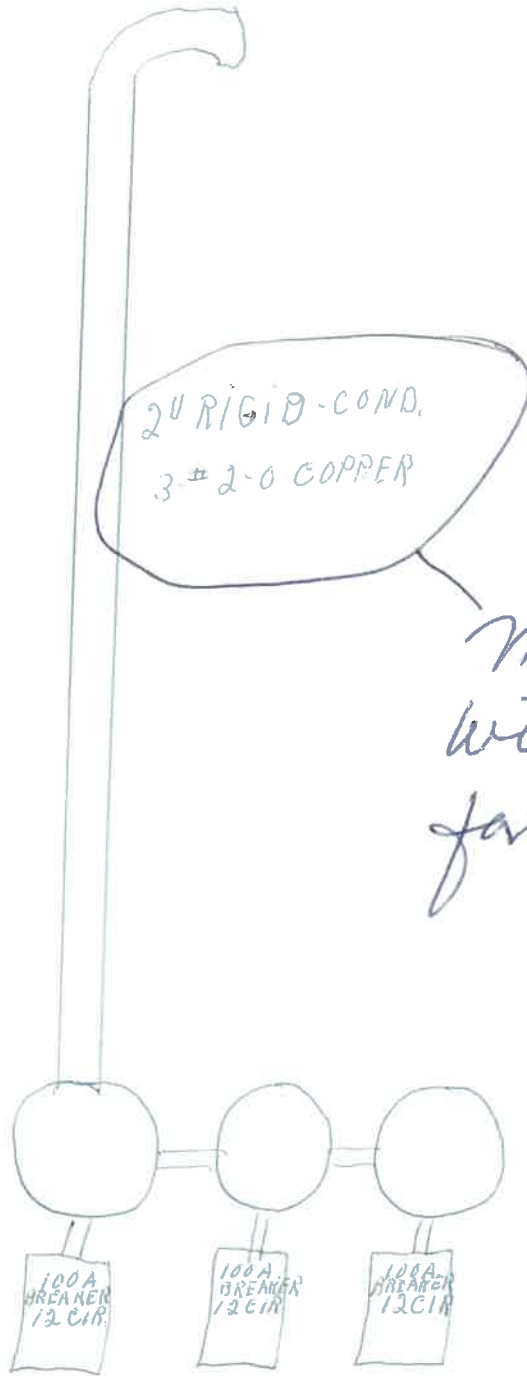

Make sure 2/0  
will carry load  
for 3 apts.

NH

8-28-76

SINGLE-METER-NOW - WILL USE 1 METER CAP-2 METER-SOCKETS  
WHEN-EVER - CUSTOMER-MAKES-CHANGES - USE-METERS-AS-NEEDED.

2nd & 3rd meter socket installed

11-9-78 NH

BUILDING DEPARTMENT  
INTEROFFICE COMMUNICATION

Date AUGUST 26, 1976

To: Norman Howes From: Ron Sonnenberg  
Subject: Service Entrances @ 408 W. Maumee Ave.

Harold Bostelman said he talked to you about this before, they intend to install three meter bases at this time but only use one and cap off the others. Please advise if this is acceptable. This is for a multiple family dwelling.

Ron Sonnenberg

P.S. If you have any questions call me @ this no. before 12:00 PM 592-3265

OK - 8-28-76 N.H.