

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W- 0568 Issued _____ Received of _____ (\$.00)

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$.00 Plumber _____


Date completed _____ Approved by _____
water distribution dept. finance director

Name Hannah Ludeman Size of tap 1" Date 3-22-25 Street and No. 469 W. Monroe

Old Tap No. 1097 New Tap No. 9524 Size and Kind of Main 6" CIP

Location of Main 1' North of South curb Depth of Main 4'

Distance from Hydrant/Valve 67' East of Hyd 343 Distance to Curb Stop from Corp. 8 1/2'

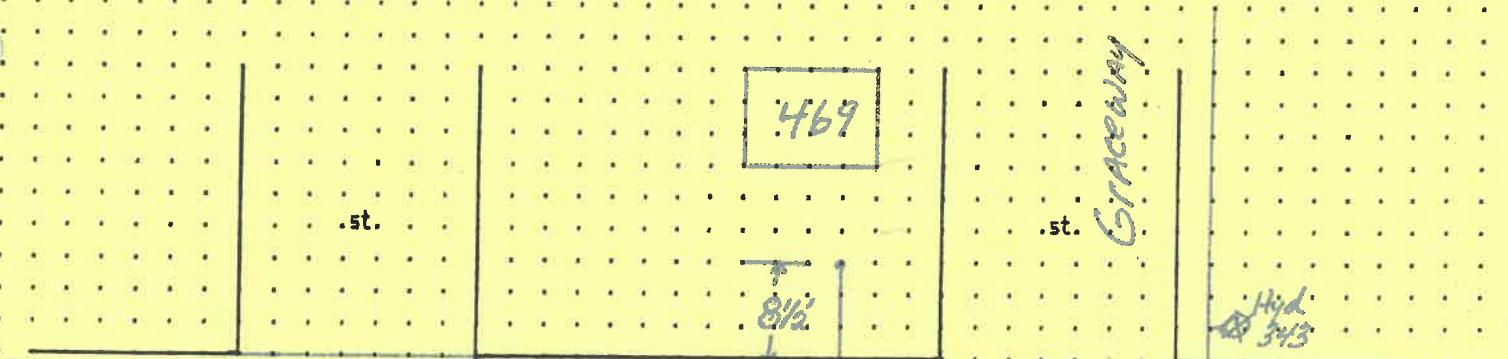

6 1/2
8 1/2 ← → 67'

W. Monroe

