

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0219 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by H. E. Mantagh
 water distribution dept. finance director

Name Oakwood Pk. Restrooms Size of tap 1 1/2" Date 7-9-96 Street and No. 400 Oakwood Ave

Old Tap No. _____ New Tap No. 9648 Size and Kind of Main 6" C-900

Location of Main 60' South of main drive Depth of Main 7'
 (with tracing wire)

Distance from Hydrant/Valve 334' East of Valve Distance to Curb Stop from Corp. 195'

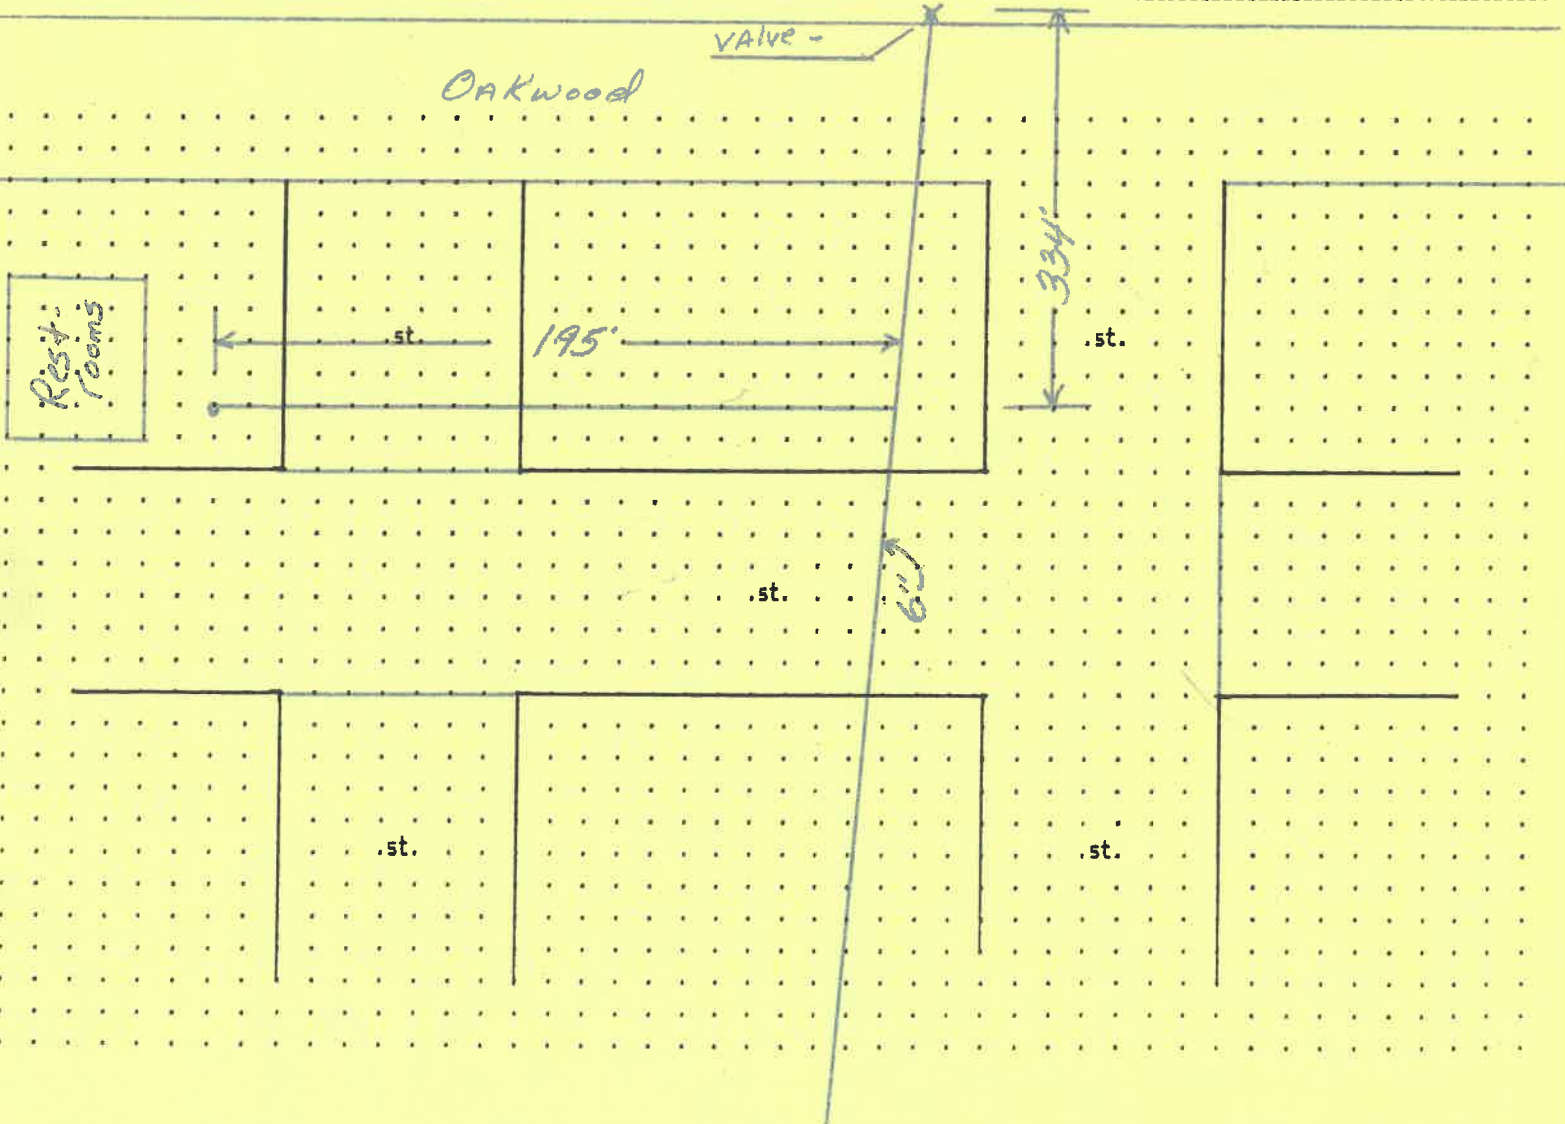

WATER TAPPING PERMIT
issued by

The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

1400 Oakwood

Permit No. W-0219 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Philip C. Montague
water distribution dept. finance director

Name Oakwood PK. Restrooms Size of tap 1 1/2" Date 7-9-96 Street and No. Oakwood Ave

Old Tap No. _____ New Tap No. 9648 Size and Kind of Main 6" C-900

Location of Main 60' South of main drive Depth of Main 7'
(with tracing wire)

Distance from Hydrant/Valve 334' East of Valve Distance to Curb Stop from Corp. 195'

