

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0395 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

COMPLETED


Date completed _____ Approved by _____
water distribution dept. _____ finance director _____

Name _____ Size of tap 1" Date 6-2-94 Street and No. 3 PARK LANE

Old Tap No. 7511 New Tap No. 9443 Size and Kind of Main 8" PVC

Location of Main 12' EAST OF EAST CURB Depth of Main 5'

Distance from Hydrant/Valve 115' North of Hyd #29 Distance to Curb Stop from Corp. 6'

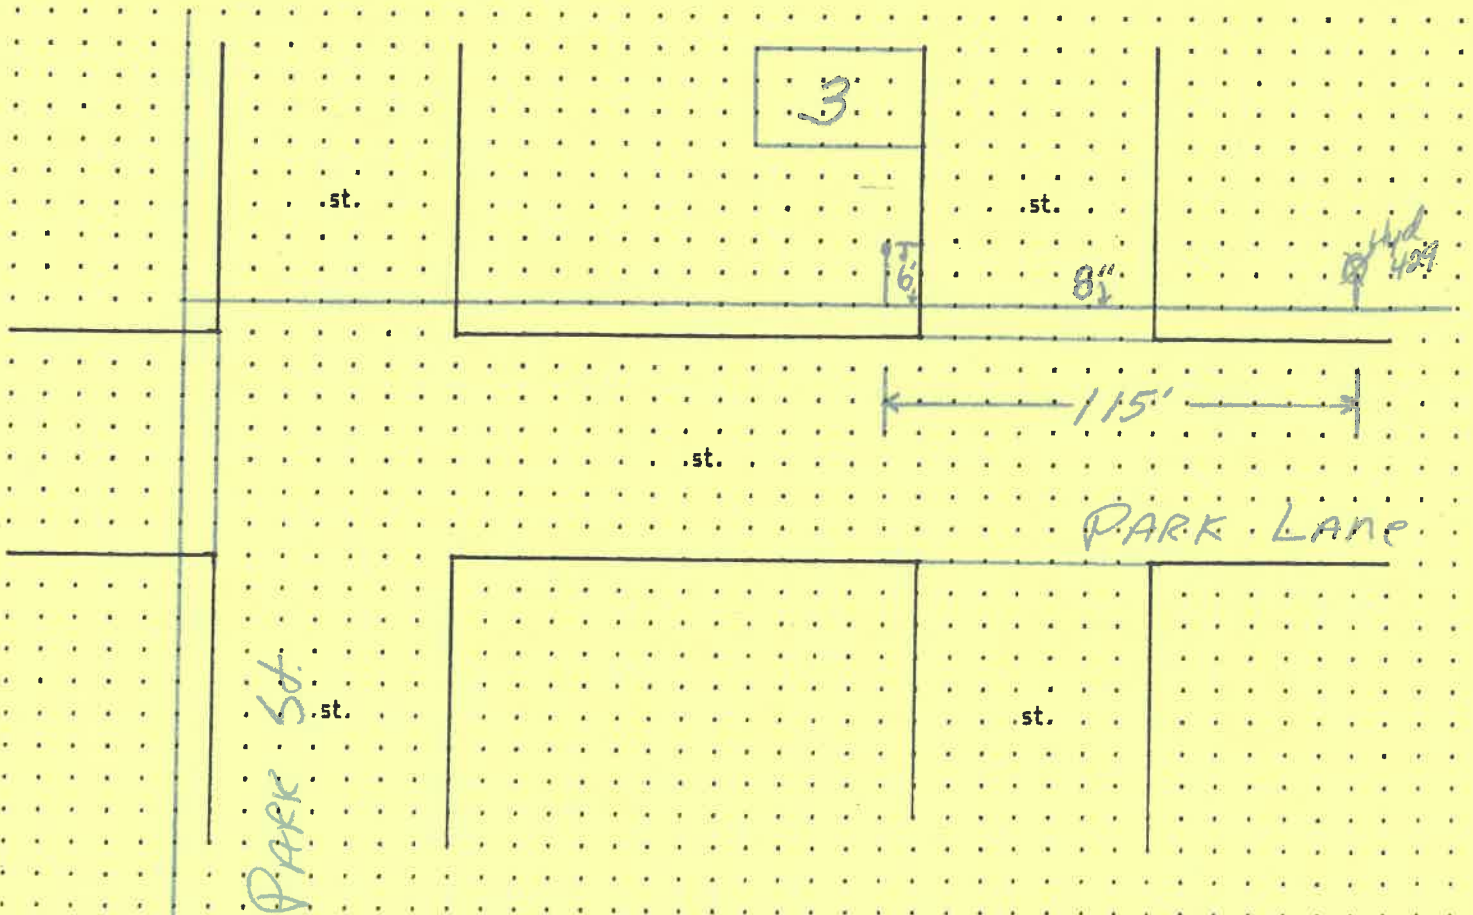

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0390 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

COMPLETED

Date completed _____ Approved by _____
water distribution dept. _____ finance director _____

Name _____ Size of tap 1" Date 6-3-94 Street and No. 3 PARK LANE

Old Tap No. 7510 New Tap No. 9438 Size and Kind of Main 8" PVC

Location of Main 12' East of East CURB Depth of Main 5'

Distance from Hydrant/Valve 205' South of Hyd #16 Distance to Curb Stop from Corp. 4'

