

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010


Permit No. W- 0229 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by [Signature] water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 4-2-97 Street and No. 638 PARK
Old Tap No. 3386 New Tap No. 9705 Size and Kind of Main 8" CIP
Location of Main 4' North of North CURB Depth of Main 4 1/2'
Distance from Hydrant/Valve 240' West of Hydrant 36 Distance to Curb Stop from Corp. 20'

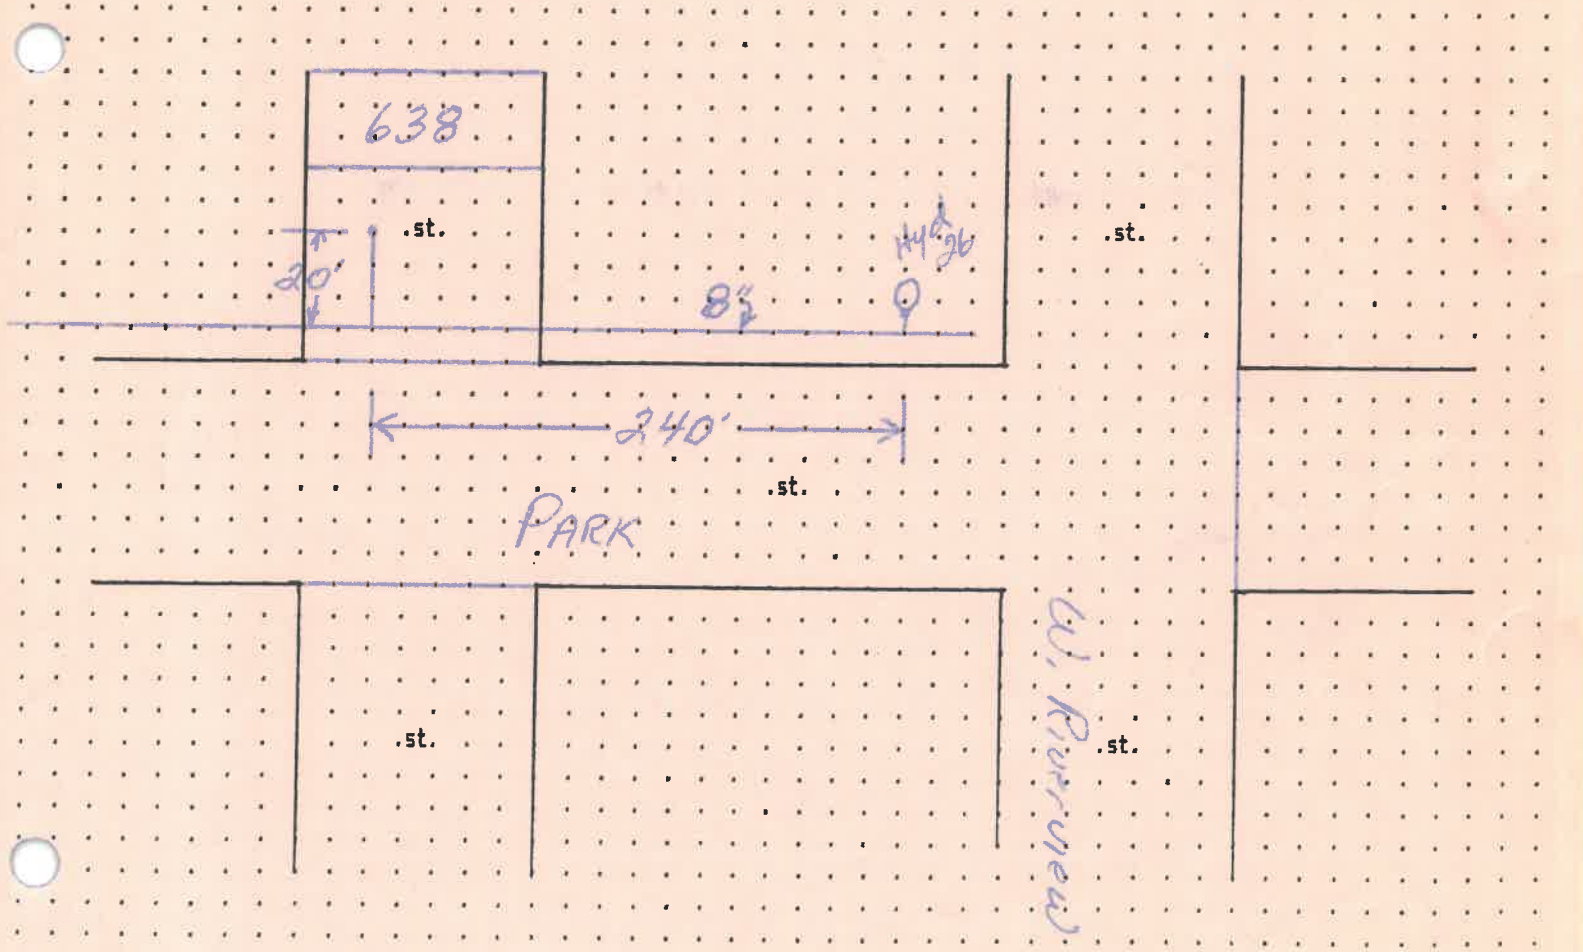

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0229 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by *Jeffrey E. Mantel* water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 4-2-97 Street and No. 638 PARK

Old Tap No. 3386 New Tap No. 9705 Size and Kind of Main 8" CIP

Location of Main 4' North of North CURB Depth of Main 4 1/2'

Distance from Hydrant/Valve 240' West of Hyd 36 Distance to Curb Stop from Corp. 20'

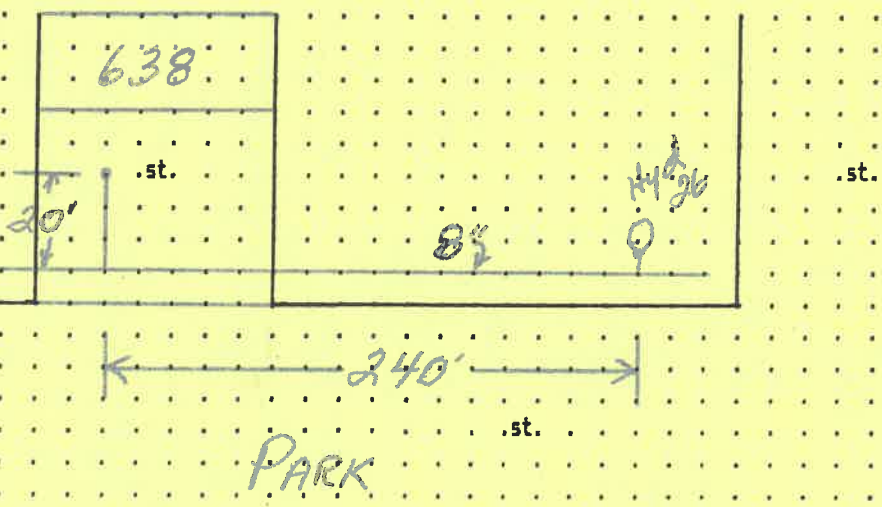

W. Riverview