

CITY OF NAPOLEON
BUILDING CONSTRUCTION PERMIT
 (1, 2 or 3 Family Dwelling)

Owner Name Martha Von Deylen
 Address 726 Park St.

Builder Name Wilbur Sonnenburg
 Address 1020 W. Perry St. Tel. 592-3205

Lot Information:

Street No. 726 Park St.
 Lot 255 Subdivision Sheffield's 3rd
 Lot Dimensions Lot Area Sq. Ft.
 Yard Set Back: Front Rear
 Side Side

Zoning "R1" Intended use of Building: installing to the existing dwelling 100AMP electrical service entrance, main panel located in the basement and wiring for dryer.

Building Information:

Single ✓ Double Multiple New Construction Addition Remodel ✓
 Size: Length Width No. of Stories 2
 Floor Area: 1st Floor 2nd Floor 3rd Floor Basement
 Unfinished Attic Garage
 Foundation: Piers Full Basement Part Basement
 Concrete Block

Walls: Frame ✓ Block Brick Other
 Electrical: Wiring 100AMP Service Electric Heating ✓ Electrical Appliances ✓
 Plumbing: Fixtures or Traps Warm Air Heating ✓ Hot Water Heating ✓

Additional Information: This permit requires compliance with the attached addendum marked exhibit "A" and made a part here-of.

Date 11-19-75 Applicant Signature Wilbur Sonnenburg

Note: 12/1/75 the following must be corrected
 1) Tighten clamp on rod
 2) Paint holding blocks
 3) Vapor barrier
 4) Protect NM cable within 7' of floor in basement.

Inspection Record:

Work Started Foundations Plumbing, Heating
 Set Back, Side Lines Plumbing (Rough In) And Air Conditioning
 Excavation Erecting Frame Roof
 Footing Electrical Work 12/1/75 Service & Panel approved by Howes

Comments:

Certificate of Occupancy Issued

Pink - Engineer

Inspector

Permit No.	<u>126-75</u>			
Issued	<u>11/12/75</u>			
By	<u>Howes</u> Building Inspector			
Valuation	<u>\$150.00</u>			
	Fees	Base	Plus	Total
Construction
Plumbing
Electrical	<u>\$3.00</u>	<u>\$1.55</u>	<u>\$4.55</u>
Heating
Water Tap
Sewer Tap
Temporary Elec.
TOTAL	<u>\$3.00</u>	<u>\$1.55</u>	<u>\$4.55</u>

\$ 1.75 1st 10
• 1.80 bal @ 60¢ each
3.55
1.00 Dryer Circuit
4.55

11/14/75 Ken ok'd
Location

CITY OF NAPOLEON
ENGINEERING DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(PLEASE PRINT OR TYPE)

The undersigned hereby makes application for the installation, replacement or alteration of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Code for 1, 2 and 3 Family Buildings.

Owner's Name MARTHA VON BAYLEN Address 726 PARK ST.

Contractor's Name WILBUR SOMMERBER Address 1020 N. PERRY ST. Tel. 592-3205

LOT INFORMATION:

Location of Project _____ Lot # 255

Subdivision ShoFField 3rd Zoning District B

BUILDING INFORMATION:

Single Family Double Family _____ Multiple Family _____

New Construction _____ Existing _____ Addition _____

Replacement _____ Remodel Service Changes

Size: Total Square Foot Per Floor _____ No. of Stories 2

DESCRIPTION OF WORK

Size of Service 100 AMP. Service Change Only Yes (Yes or No)

7 existing circuits

Total Number of New Circuits 20 Total Number of New Circuits Excluding Appliance Circuits 13

APPLIANCE CIRCUITS: (indicate quantity)

Electric Range _____ Range Hood _____ Clothes Dryer Dishwasher _____

Air Conditioner _____ Attic Fan Blower _____ Room Exhaust Fan _____

Disposal _____ Hot Water Heater _____ Electric Oven _____

Require Temporary Electric _____ (Yes or No)

Note: G.F.I.C. required for all temporary electric with approved ground rod at service.

APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELECTRICAL LAY-OUT AND WIRING DIAGRAM.

ESTIMATED COST OF COMPLETED PROJECT: \$ 1500.00

DATE 11-14-75

APPLICANT'S SIGNATURE Wilbur Sommerberg
OWNER-CONTRACTOR-AGENT

NEW THREE
WIRE SERVICE

NEW
SERVICE

1 1/2" RIGID
STEEL

3-#2 COPPER
WIRE

RED
SERVICE

WINDOW

1 1/2" RIGID
STEEL

2'-

100 AMP MAIN
CIRCUIT BREAKER
90 CIRCUIT
PANEL

#6 COPPER
GROUND
CIRCUIT

3/8" x 3/8" COPPER
GROUND
ROD


220V
3P 4W
DRIVE
REPTED
1st DISCONNECT

6'

FIRST
FLOOR


BASINMENT

NEW POWER

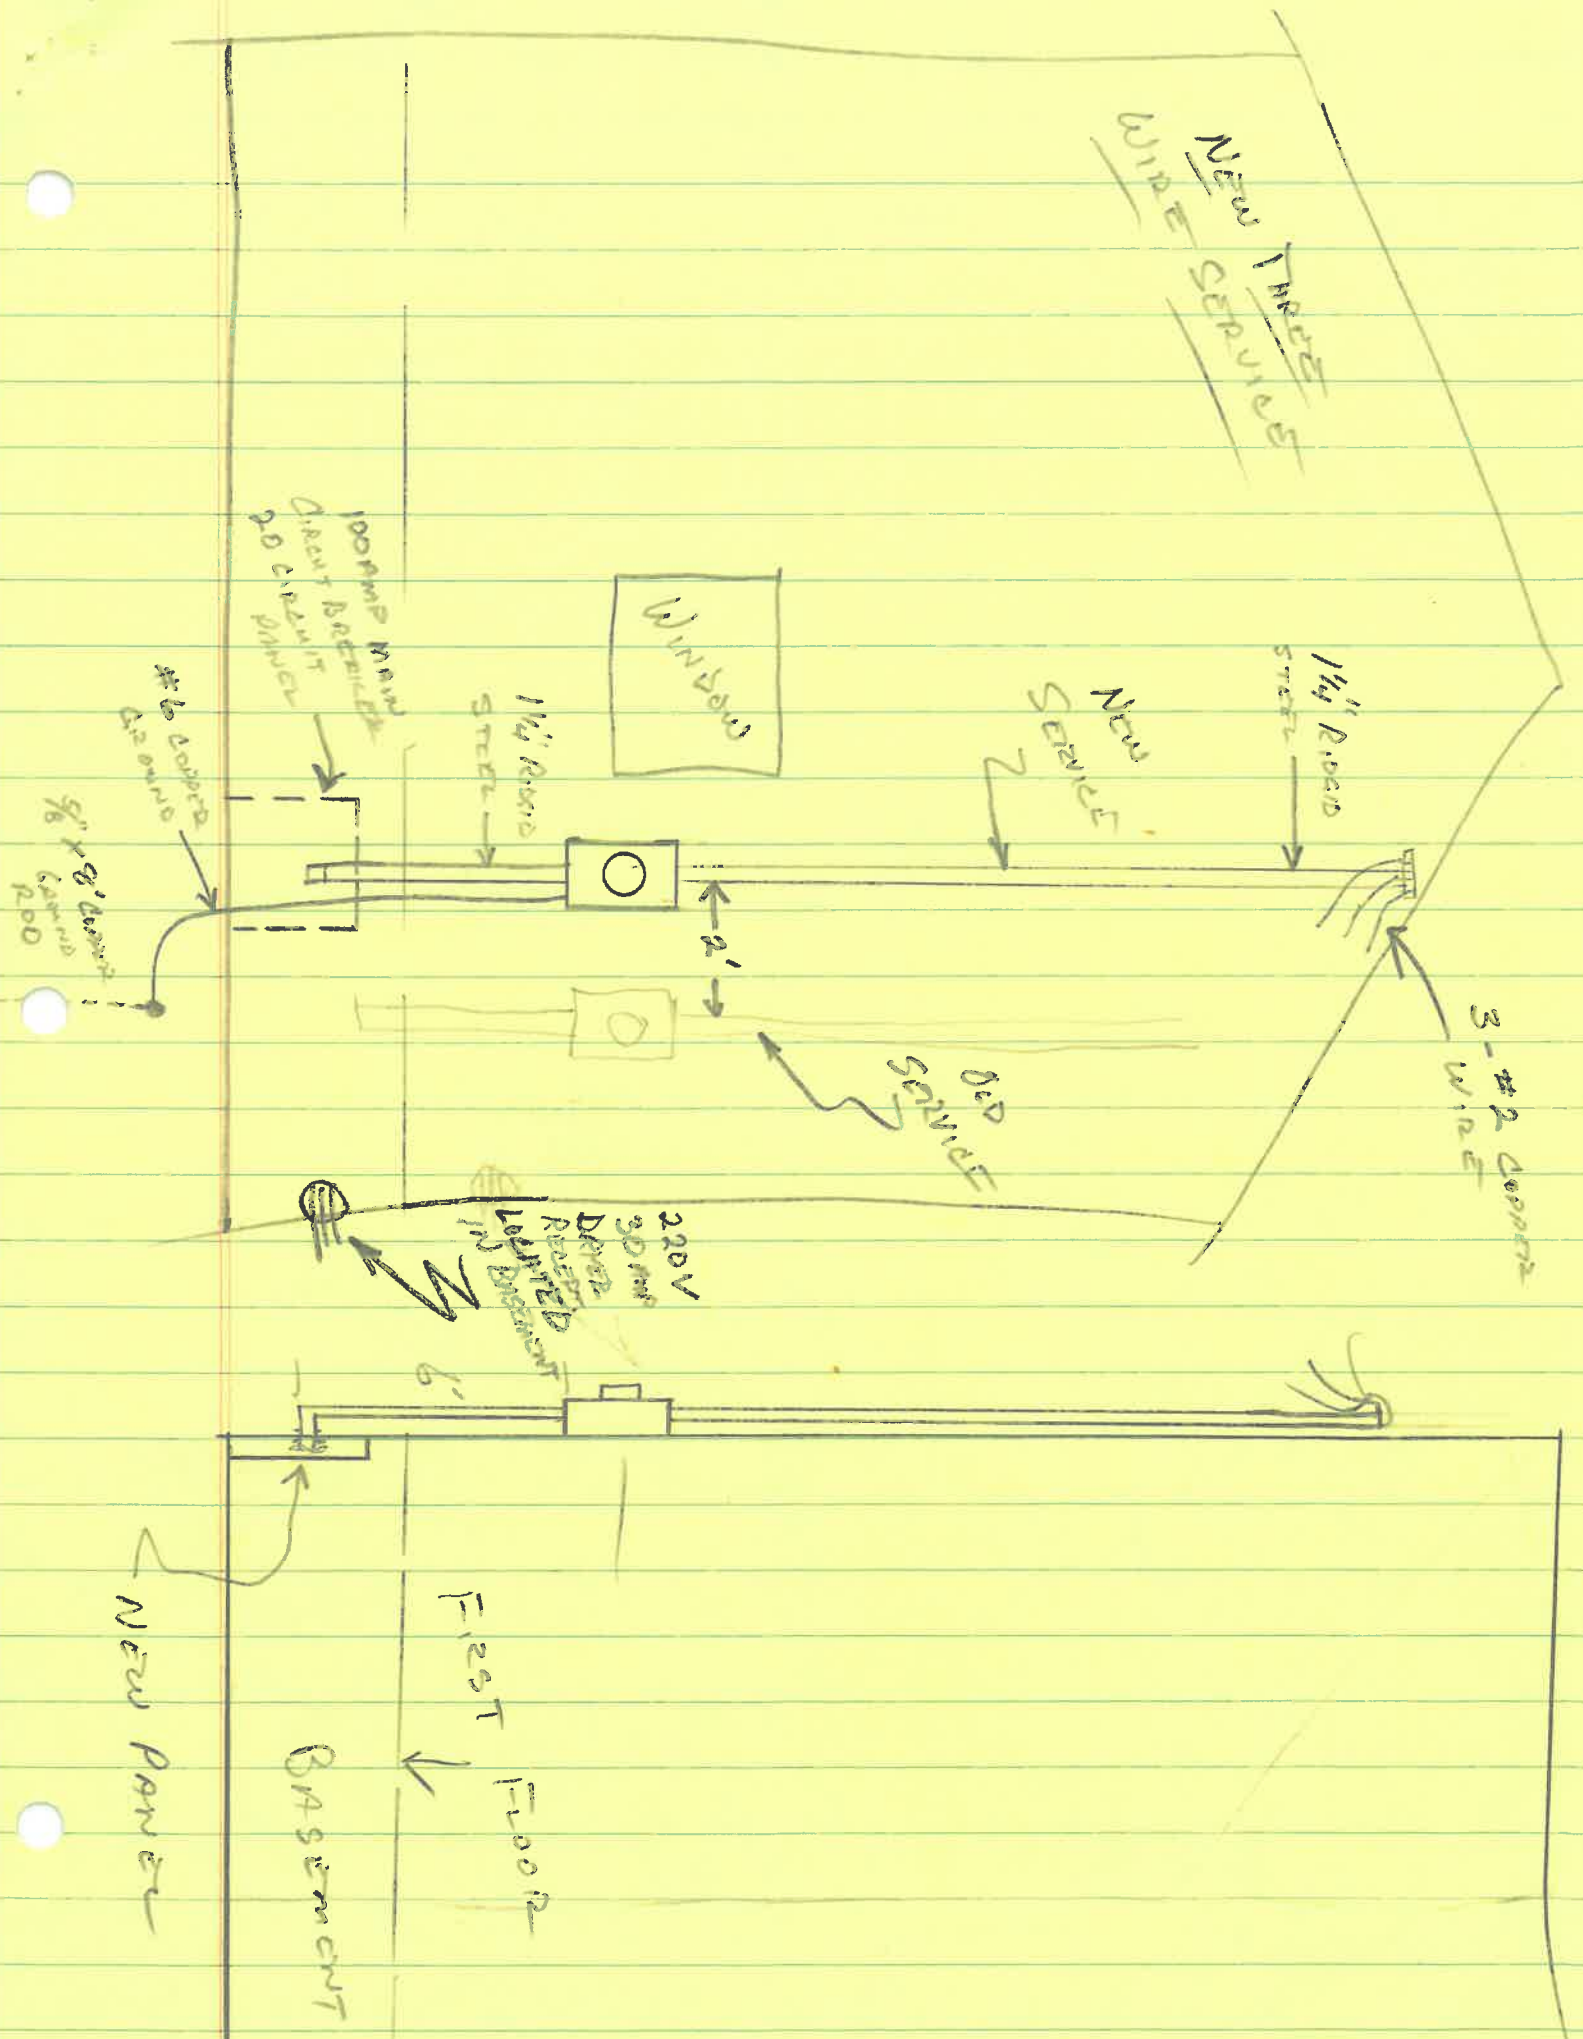


EXISTING TWO WIRE SERVICE

FIRST FLOOR
BASEMENT
EXISTING PANEL

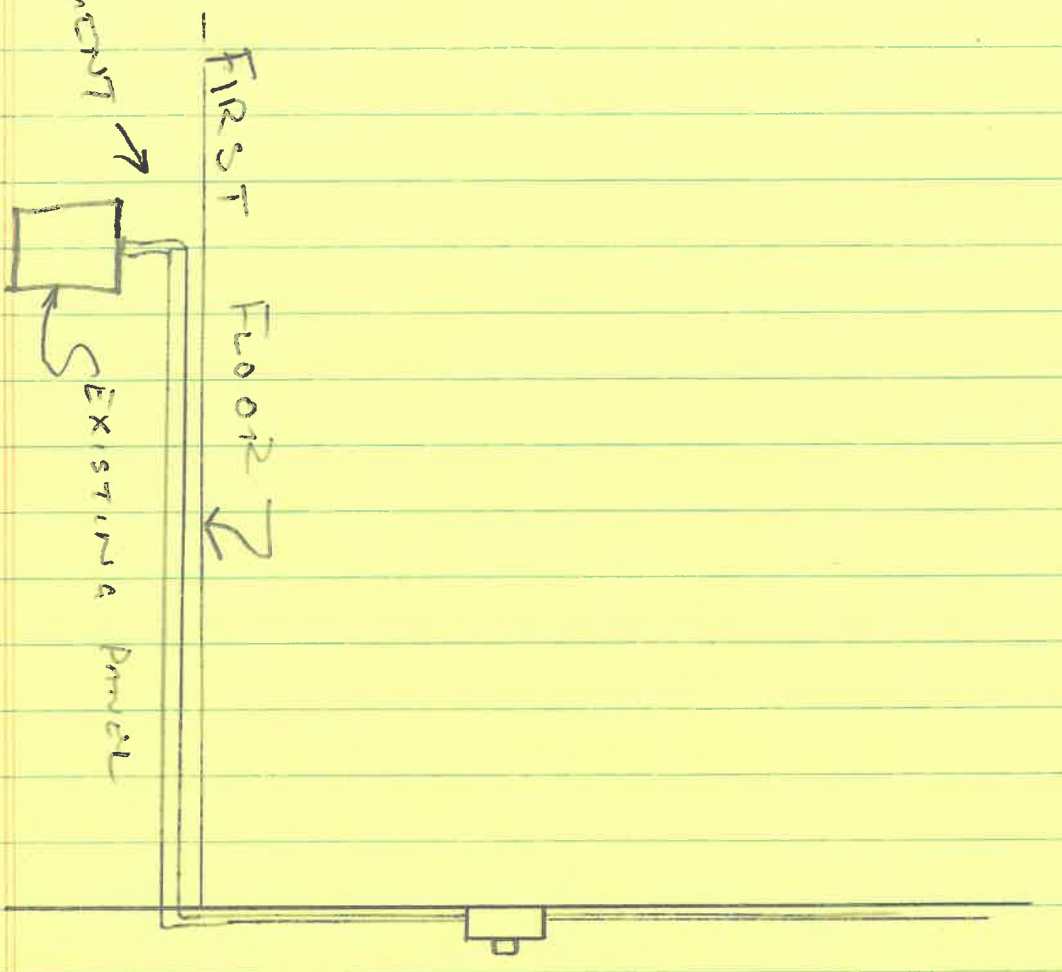

WINDOW

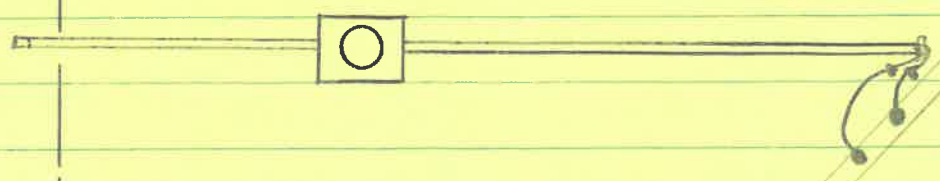

CHANGE EXISTING TWO WIRE SERVICE
TO THREE WIRE 100 AMP SERVICE, ALL
EXISTING HOUSE WIRING TO REMAIN AS IS.
INSTALL ONE NEW CIRCUIT FOR ELECTRIC
CLOTHES DRYER.

SERVICE ENTRANCE WIRE - #2 CU.

RIGID STEEL CONDUIT - 1 1/4"

GROUND WIRE - #6 CU.

GROUND ROD - 5/8" X 8' CU.

MRS MARTHA VON DOLLEN

726 PARK ST.

NAPOLEON, OHIO

43545