

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

017

Permit No. _____ Date Feb. 20, 1980

Job Location 1011 N. Perry St. Valuation \$ 300.00

Owner Bobby H. Ramey ^{Address} 1011 N. Perry St.

Contractor Bobby H. Ramey ^{Name} 1011 N. Perry St. Telephone No. 592-3003

Address _____

Electric Contractor _____

Plumbing Contractor _____

Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential ^{No. dwelling units} Commercial _____ Industrial _____

New Construction _____ Addition _____ Remodel

Brief Description of Work ~~XXXXXX~~ Change service to 220 volts to install dryer outlet. Rework basement wiring.

ISSUED BY R.E. Johnson ^{Building Official} Res.

DEPT. OF BUILDING & ZONING

PAID

FEB 21 1980

CITY OF NAPOLEON

It is the owners or contractors responsibility to call the Building Department for the following (X) inspections:

- _____ Footing excavation prior to placing concrete.
- _____ Footing drains and foundation prior to backfill.
- _____ Prepared sub-grade prior to placing concrete floor slab.
- _____ Sanitary sewer
- Rough-in electrical, plumbing and service framing prior to installing wall board.
- Final electrical, plumbing and heating.
- _____ Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit	\$ _____
Electrical Permit	\$ <u>8.00</u>
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demolition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other _____	\$ _____
TOTAL FEES	\$ <u>8.00</u>
LESS FEES PAID	\$ <u>0-</u>
BALANCE DUE	\$ <u>8.00</u>

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

SMITHSONIAN INSTITUTION
UNITED STATES DEPARTMENT OF THE INTERIOR

110

Faint, mostly illegible text at the top of the page, possibly a title or header section.

Second section of faint, illegible text, possibly a list or table of contents.

Handwritten note: 1/31

Third section of faint, illegible text, possibly a detailed list or table.

Bottom section of faint, illegible text, possibly a footer or concluding remarks.

017 8.00

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(please print or type)

The undersigned hereby makes application for installation or replacement of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Codes.

Owner's Name Bobby H. Ramey Address 1011 N. Perry, St.

Electrical Contractor SELF Telephone No. 592-3003

Address SAME AS ABOVE

General Contractor _____ Telephone No. _____

Address _____

Location of Project 1011 N. Perry, St. Cost of Project \$300.00

Work Information:

Residential SINGLE Commercial _____ Industrial _____
No. Units

New _____ Service Change X Rewiring _____ Additional Wiring X

Brief Description of Work: CHANGE service TO 220VOLTS TO
INSTALL DRYER OUTLET. REWORK BASEMENT WIRING.

Size of proposed Service Entrance 100AMP Number of new Circuits 3

Type of proposed Service Entrance _____ Underground _____ Overhead X

Require Temporary Electric NO (Yes or No)

Total Floor Area - Commercial and Industrial only _____ sq. ft.


Additional Information: EXISTING service IS 110VOLTS ONLY.
Need 220VOLTS TO RUN DRYER.

*GROUND-FAULT CIRCUIT INTERRUPTER PROTECTION IS REQUIRED ON ALL 120-VOLT SINGLE PHASE, 15 AND 20 AMP. CIRCUITS WHICH ARE PART OF A TEMPORARY ELECTRIC SERVICE; AND ALSO ON BATHROOM, OUTDOOR, AND GARAGE RECEPTACLES IN ALL DWELLING UNITS. Art. 210-8 N.E.C.

*APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELECTRICAL LAYOUT AND RISER DIAGRAM. (FOR COMMERCIAL AND INDUSTRIAL WORK ONLY).

Date Feb. 19, 1980 Applicant's Signature Bobby H. Ramey

- EXISTING SERVICE IS LOCATED ON BACK PORCH.
 - NEW SERVICE TO BE MOUNTED ON SIDE OF HOUSE WITH PANEL BELOW IN BASEMENT.
- WHERE CAN SERVICE BE MOUNTED?

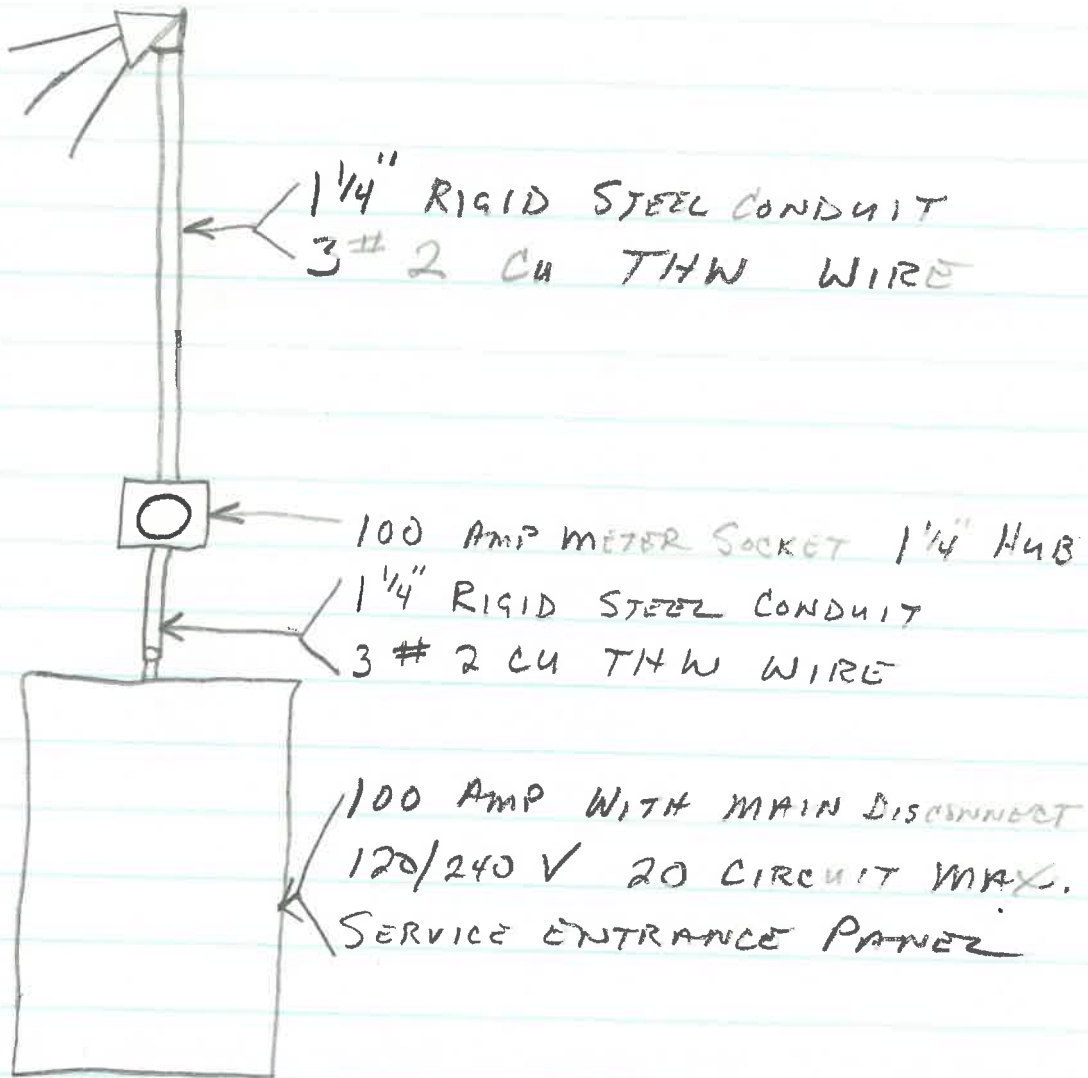

- 5/8" X 8' CU GROUND ROD
- #6 BARE CU. GROUND WIRE TO ROD
- #6 BARE CU. GROUND WIRE TO WATER SYSTEM

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

017

Job Location 1011 N. Perry St. Date Feb. 20, 1980
Owner Bobby H. Rainey Address 1011 N. Perry St. Valuation \$ 300.00
Contractor Bobby H. Rainey Name Bobby H. Rainey Address 1011 N. Perry St.
Telephone No. 592-3003
Address _____
Electric Contractor _____
Plumbing Contractor _____
Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential X No. dwelling units Commercial _____ Industrial _____
New Construction _____ Addition _____ Remodel X
Brief Description of Work Change service to 220 volts to install dryer outlet. Rework basement wiring.

ISSUED BY R.E. Johnson Building Official DEPT. OF BUILDING & ZONING

It is the owners or contractors responsibility to call the Building Department for the following (X) inspections:

- _____ Footing excavation prior to placing concrete.
- _____ Footing drains and foundation prior to backfill.
- _____ Prepared sub-grade prior to placing concrete floor slab.
- X _____ Sanitary sewer
- _____ Rough-in electrical, plumbing and service framing prior to installing wall board.
- X _____ Final electrical, plumbing and heating.
- _____ Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit	\$ _____
Electrical Permit	\$ <u>8.00</u>
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demolition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other	\$ _____
TOTAL FEES	\$ <u>8.00</u>
LESS FEES PAID	\$ <u>-0-</u>
BALANCE DUE	\$ <u>8.00</u>

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

INSPECTION RECORD

UNDERGROUND		ROUGH-IN & FINA'				
Type	Date	By	Type	Date	By	
PLUMBING	Sewer Connection		Drainage, W. & Vent			
	Building Sewer		Water Piping			
	Water Piping		Condensate Lines			
			Indirect Waste			
				FINAL APPROVAL		
ELECTRICAL	Floor Ducts Raceways		Rough Wiring	3/4/80	NH	
	Conduits & or Cable		Conduits/ Cable			
	Grounding & or Bonding		Service Panel Switchboard	3/4/80	NH	
			Subpanels			
			<input type="checkbox"/> Range <input type="checkbox"/> Dryer	FINAL APPROVAL	3/4/80	NH
MECHANICAL	Refrigerant Piping		Refrigerant Piping			
	Ducts/ Plenums		Ducts/ Plenums			
			Ventilation <input type="checkbox"/> Supply			
			<input type="checkbox"/> Exhst.	FINAL APPROVAL		
			Wall Construction	Fireplace Chimney		
BUILDING	Excavation		Crawl Space <input type="checkbox"/> Vent <input type="checkbox"/> Access			
	Footings & Reinforcing		Floor System(s)			
	Sub-soil Drain		Roof System			
	Foundation Walls		Fire Wall(s)			
	Floor Slab		Roof Cover Roof Drain			
	FINAL APPROVAL BLDG. DEPT.		FINAL APPROVAL BLDG. DEPT.	Special Insp Reports Rec'd		
			Certificate of Occupancy Issued	Attic <input type="checkbox"/> Vent <input type="checkbox"/> Access		#

CITY OF NAPOLEON
Engineering Department
 255 Riverview Avenue
 NAPOLEON, OHIO 43545

TO _____

DATE 3-9-80		JOB NO. 017	
PROJECT			
LOCATION 1011 N. PERRY			
CONTRACTOR RAMEY		OWNER RAMEY	
WEATHER		TEMP. ° at AM ° at PM	
PRESENT AT SITE SERVICE			

THE FOLLOWING WAS NOTED:

> **NORM: THIS HAS BEEN HOOKED-UP + SHOULD BE CHECKED
 HE ALSO DID SOME RE-WIRING IN THE BASEMENT.**

Final-Basement OK 3-9-80 HH
Service OK " "

COPIES TO _____

FIELD REPORT

SIGNED **Howes**

CITY OF NAPOLEON
Engineering Department
255 Riverview Avenue
NAPOLEON, OHIO 43545

DATE	3-9-80	JOB NO.	017
PROJECT			
LOCATION	1011 N. PERRY		
CONTRACTOR	RAMEY	OWNER	RAMEY
WEATHER		TEMP.	° at = AM ° at = PM
SUBJECT TO DATE	SERVICE		

TO

THE FOLLOWING WAS NOTED:

> Norm: THIS HAS BEEN HOOKED-UP & SHOULD BE CHECKED
HE ALSO DID SOME RE-WIRING IN THE BASEMENT.

Final-Basement OK 3-9-80 AHH
Service OK " "

COPIES TO

FIELD REPORT

SIGNED

Hovels

