

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0347 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey L. Mastaglio water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 8-10-98 Street and No. 1078 N. Perry

Old Tap No. 726 New Tap No. 9833 Size and Kind of Main 4" CIP

Location of Main under West curb Depth of Main 3 1/2'

Distance from Hydrant/Valve 23' South of Hyd 336 Distance to Curb Stop from Corp. 33'
(outside pit)

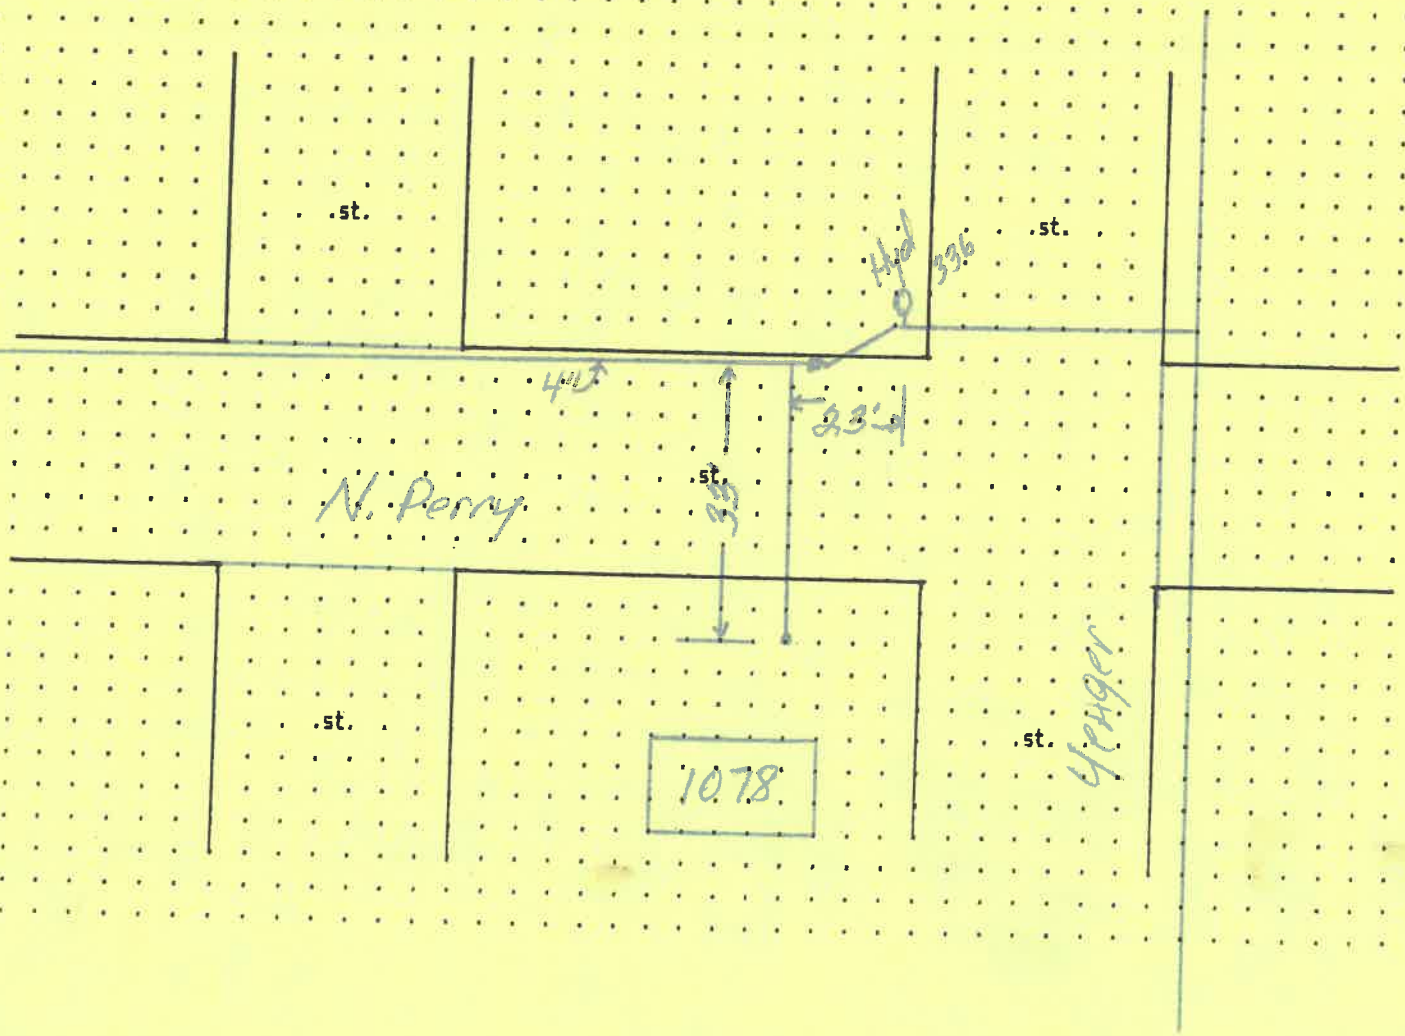

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0347 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Philip R. Marshall water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 8-10-98 Street and No. 1078 N. Perry

Old Tap No. 726 New Tap No. 9833 Size and Kind of Main 4" CIP

Location of Main under West curb Depth of Main 3 1/2'

Distance from Hydrant/Valve 23' South of Hyd 336 Distance to Curb Stop from Corp. 33'
(outside pit)

