

**PERMIT**  
**CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING**  
**255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010**

Permit No. 161-79 Date Nov. 13, 1979  
 Job Location 712 W. Perry St. Valuation \$ 21,400.00  
 Owner Jack Collins Address 712 W. Perry St.  
 Contractor Bergstedt Builders Telephone No. 592-3451  
 Address 1050 Dodd St., Napoleon, Ohio  
 Electric Contractor \_\_\_\_\_  
 Plumbing Contractor \_\_\_\_\_  
 Mechanical Contractor \_\_\_\_\_

**This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.**

**Work Information:**

Residential \_\_\_\_\_ Commercial X Industrial \_\_\_\_\_  
No. dwelling units  
 New Construction \_\_\_\_\_ Addition \_\_\_\_\_ Remodel X  
 Brief Description of Work Remodel building for offices

ISSUED BY \_\_\_\_\_ DEPT. OF BUILDING & ZONING  
Building Official

**It is the owners or contractors responsibility to call the Building Department for the following (X) inspections:**

- \_\_\_\_\_ Footing excavation prior to placing concrete.
- \_\_\_\_\_ Footing drains and foundation prior to backfill.
- \_\_\_\_\_ Prepared sub-grade prior to placing concrete floor slab.
- \_\_\_\_\_ Sanitary sewer
- X \_\_\_\_\_ Rough-in electrical, plumbing and service framing prior to installing wall board.
- X \_\_\_\_\_ Final electrical, plumbing and heating.
- X \_\_\_\_\_ Final building inspection, prior to occupancy.

**PERMIT & FEES**

|                       |                 |
|-----------------------|-----------------|
| Building Permit       | \$ <u>54.25</u> |
| Electrical Permit     | \$ <u>24.05</u> |
| Plumbing Permit       | \$ _____        |
| Mechanical Permit     | \$ <u>0-</u>    |
| Demolition Permit     | \$ _____        |
| Zoning Permit         | \$ <u>0-</u>    |
| Sign Permit           | \$ _____        |
| Water Tap             | \$ _____        |
| Sewer Tap             | \$ _____        |
| Temp. Elec.           | \$ _____        |
| Other _____           | \$ _____        |
| <b>TOTAL FEES</b>     | \$ <u>78.30</u> |
| <b>LESS FEES PAID</b> | \$ <u>0</u>     |
| <b>BALANCE DUE</b>    | \$ <u>78.30</u> |

**Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.**

CITY OF NAPOLEON

Engineering Department

ELECTRICAL INSPECTION FIELD REPORT

255 Riverview Avenue Napoleon, Ohio 43545  
(Please Print or Type)

Date 10-22-79

Permit No. 161-79

Type of Inspection DEPR FINAL

Type of Occupancy OFFICE

Project Name COLLINS OFFICE

Address 712 N. PERRY ST

City NAP State OH.

Approved

Violation

Electrical Contractor BELSTEDT

Remarks:

Code Reference

BACK DOOR SHOULD BE OPEN.

1) - Fasten 100A-DISCONNECT SWITCH SECURELY TO BACK BOARD (AT SERVICE EQUIPMENT, ART-110-14)


2) Neutral conductor from 100A Disc. Switch Required to be insulated. (Art. 250-410)

3) GROUNDING.

4) Rent cover recess

lighting fixtures with insulation.

5) Copper ONLY

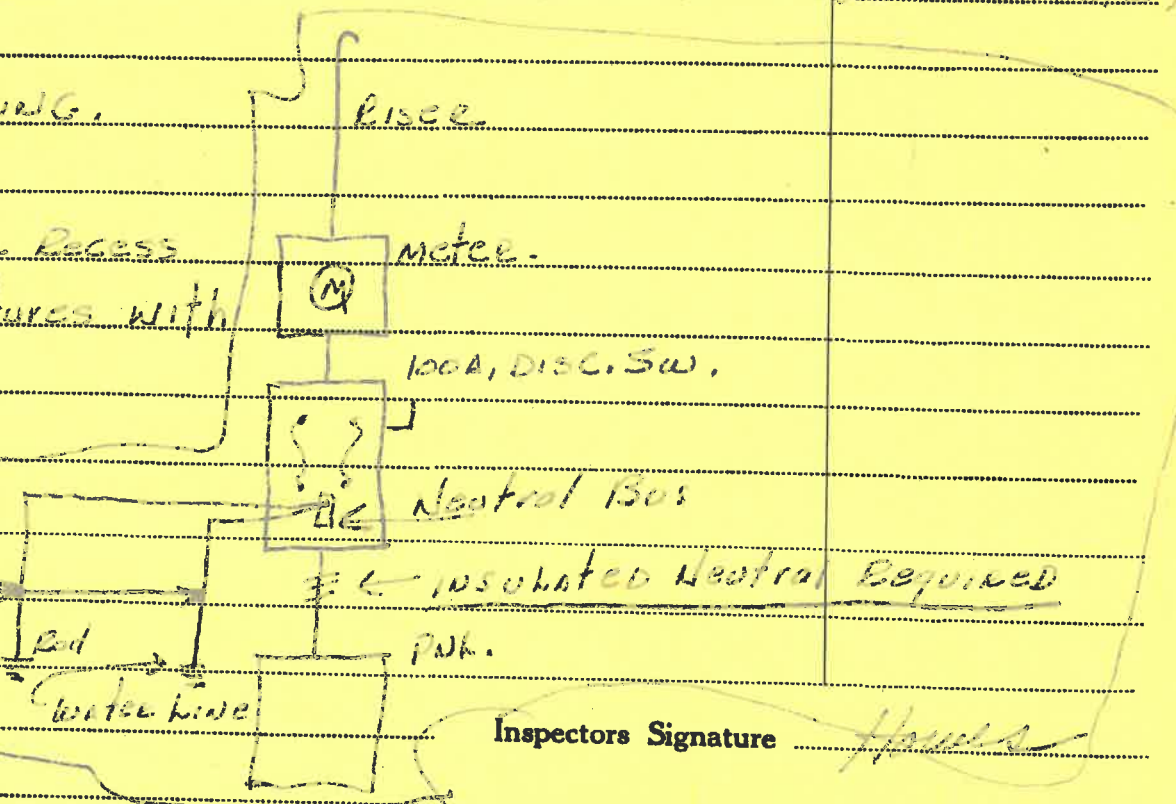

Compliance Time

Inspectors Signature [Signature]

Copies To:

**PERMIT**

**CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING**  
**255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010**

Permit No. 161-79 Date Nov. 13, 1979  
Job Location 712 N. Perry St. Valuation \$ 21,400.00  
Owner Jack Collins Address 712 N. Perry St.  
Contractor Bergstedt Builders Name 712 N. Perry St.  
Address 1050 Dodd St., Napoleon, Ohio Telephone No. 592-3451  
Electric Contractor \_\_\_\_\_  
Plumbing Contractor \_\_\_\_\_  
Mechanical Contractor \_\_\_\_\_

**This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.**

**Work Information:**

Residential \_\_\_\_\_ No. dwelling units Commercial X Industrial \_\_\_\_\_  
New Construction \_\_\_\_\_ Addition \_\_\_\_\_ Remodel X  
Brief Description of Work Remodel building for offices

ISSUED BY R. E. Johnson (BWD) Building Official DEPT. OF BUILDING & ZONING

**It is the owners or contractors responsibility to call the Building Department for the following (X) inspections:**

- \_\_\_\_\_ Footing excavation prior to placing concrete.
- \_\_\_\_\_ Footing drains and foundation prior to backfill.
- \_\_\_\_\_ Prepared sub-grade prior to placing concrete floor slab.
- \_\_\_\_\_ Sanitary sewer
- X \_\_\_\_\_ Rough-in electrical, plumbing and service framing prior to installing wall board.
- X \_\_\_\_\_ Final electrical, plumbing and heating.
- X \_\_\_\_\_ Final building inspection, prior to occupancy.

**PERMIT & FEES**

|                       |                 |
|-----------------------|-----------------|
| Building Permit       | \$ 54.25        |
| Electrical Permit     | \$ 24.05        |
| Plumbing Permit       | \$ _____        |
| Mechanical Permit     | \$ -0-          |
| Demolition Permit     | \$ _____        |
| Zoning Permit         | \$ -0-          |
| Sign Permit           | \$ _____        |
| Water Tap             | \$ _____        |
| Sewer Tap             | \$ _____        |
| Temp. Elec.           | \$ _____        |
| Other                 | \$ _____        |
| <b>TOTAL FEES</b>     | <b>\$ 78.30</b> |
| <b>LESS FEES PAID</b> | <b>\$ -0-</b>   |
| <b>BALANCE DUE</b>    | <b>\$ 78.30</b> |

**Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.**

CITY OF NAPOLEON  
 BUILDING INSPECTION DEPARTMENT  
 APPLICATION FOR BUILDING PERMIT  
 (please print or type)

The undersigned hereby makes application for construction, installation, or alteration work as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Building Codes.

Location of project 712 N Perry Cost of Project ~~19,000.<sup>00</sup>~~ 21,400.<sup>00</sup>

Owner's Name Jack Collins Address \_\_\_\_\_

Contractor Bergstedt Builders Telephone No. 592-3451

Address 1050 Dodd Napoleon Ohio 43545

Lot Information: (not required for siding job)

Lot No. \_\_\_\_\_ Subdivision \_\_\_\_\_

Zoning District \_\_\_\_\_ Lot Size \_\_\_\_\_ ft X \_\_\_\_\_ ft. Area \_\_\_\_\_ sq. ft.

Setbacks: Front \_\_\_\_\_ Right Side \_\_\_\_\_ Left Side \_\_\_\_\_ Rear \_\_\_\_\_

Use Information:

Residential \_\_\_\_\_ Commercial  Industrial \_\_\_\_\_

Work Construction \_\_\_\_\_ Addition \_\_\_\_\_ Remodel

Work Siding \_\_\_\_\_

Work: put in wall for office

REMODEL BUILDING FOR OFFICES

Size 46'0" Width 22'0" No. of Stories 2

Area 1012 sq. ft. Basement 1012 sq. ft.

Area 1012 sq. ft. Accessory Building \_\_\_\_\_ sq. ft.

Area \_\_\_\_\_ sq. ft. Other \_\_\_\_\_ sq. ft.

Additional Information:


APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELEVATIONS, FLOOR PLANS, CROSS SECTIONS AND PLOT PLAN. IF LOCATION OR FOUNDATION, SHOW ALL EXISTING STRUCTURES AND THEIR SIZE AND LOCATION. ALL PLANS SHALL BE DRAWN TO SCALE.

Date Oct 11-79 Applicant's Signature Don Bergstedt

*fees charged for first floor only.*

PERMIT NO. 161-79 PERMIT FEE \$ 54.25

holding for  
ward trial

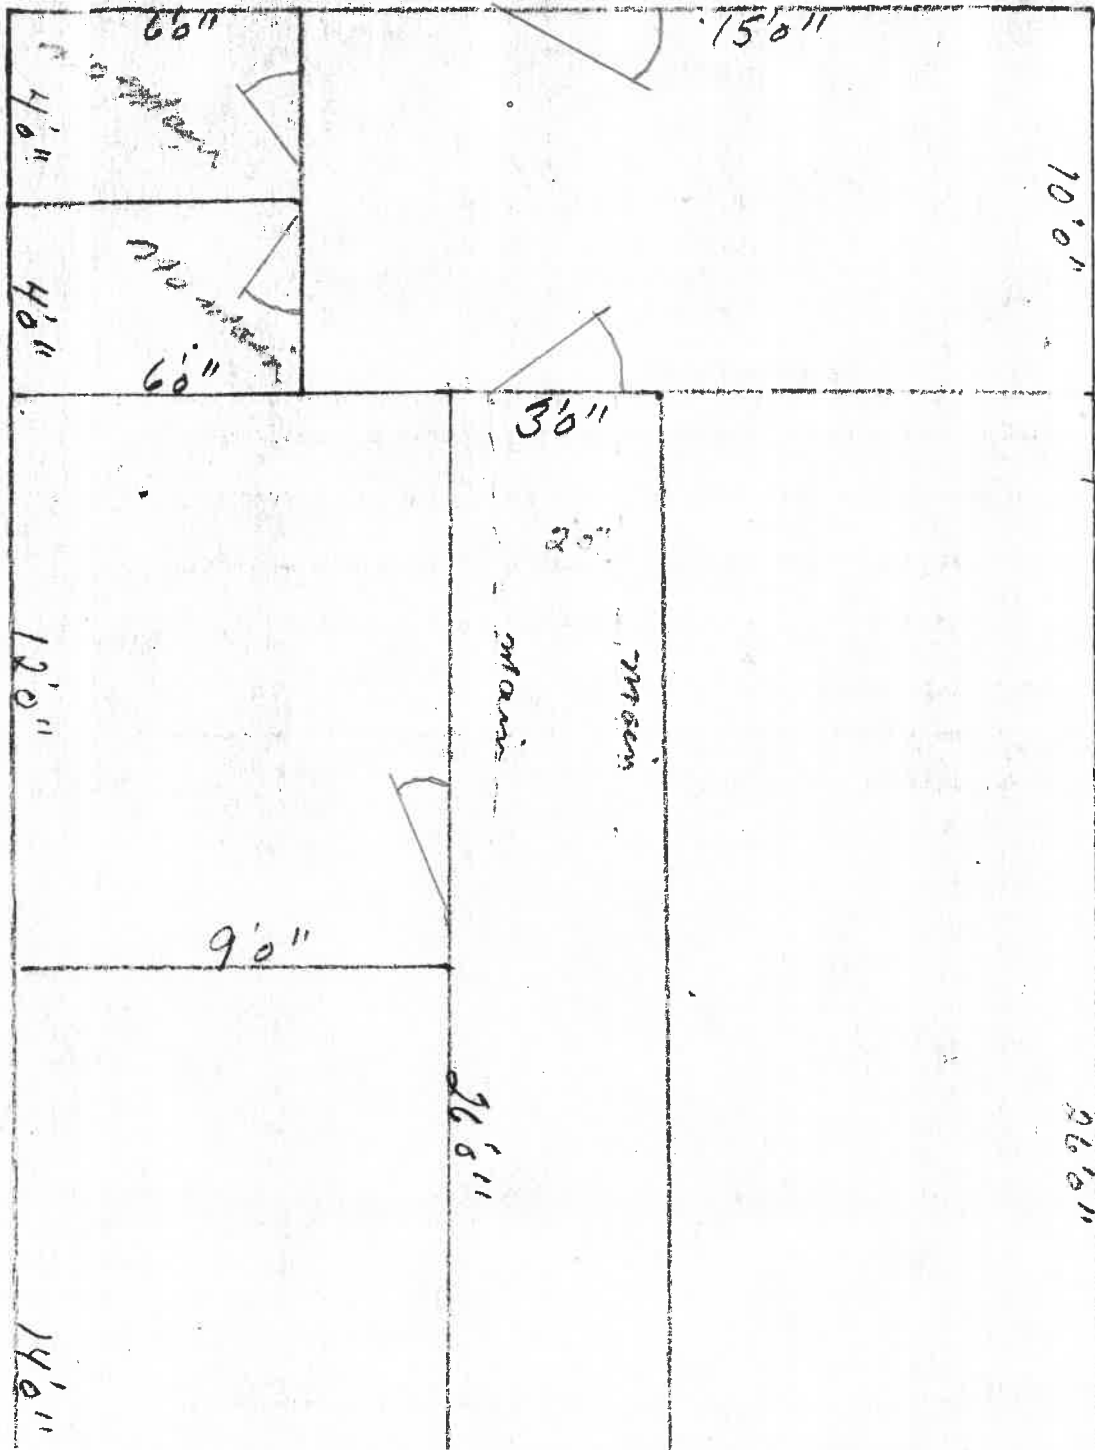

*220*

CITY OF NAPOLEON  
BUILDING INSPECTION DEPARTMENT  
APPLICATION FOR ELECTRICAL PERMIT  
(please print or type)

\$ 24.05

The undersigned hereby makes application for installation or replacement of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Codes.

Owner's Name Jack Collins Address \_\_\_\_\_

Electrical Contractor Burgstett Builders Telephone No. 592-3451

Address 1050 Dodd Napoleon Ohio

General Contractor Same Telephone No. 592-3451

Address \_\_\_\_\_

Location of Project 712 N Perry Cost of Project \$1200.00  
~~19,000.00~~

Work Information:

Residential \_\_\_\_\_ Commercial X Industrial \_\_\_\_\_

No. Units

New \_\_\_\_\_ Service Change \_\_\_\_\_ Rewiring X Additional Wiring X

Brief Description of Work: Kill old wiring and put in new receptacle ~~receptacle~~ + Light

Size of proposed Service Entrance \_\_\_\_\_ Number of new Circuits 5

Type of proposed Service Entrance \_\_\_\_\_ Underground \_\_\_\_\_ Overhead \_\_\_\_\_

Require Temporary Electric \_\_\_\_\_ (Yes or No)

Total Floor Area - Commercial and Industrial only 1,012 sq. ft.

Additional Information: \_\_\_\_\_


\*GROUND-FAULT CIRCUIT INTERRUPTER PROTECTION IS REQUIRED ON ALL 120-VOLT SINGLE PHASE, 15 AND 20 AMP. CIRCUITS WHICH ARE PART OF A TEMPORARY ELECTRIC SERVICE; AND ALSO ON BATHROOM, OUTDOOR, AND GARAGE RECEPTACLES IN ALL DWELLING UNITS. Art. 210-8 N.E.C.

\*APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELECTRICAL LAYOUT AND RISER DIAGRAM. (FOR COMMERCIAL AND INDUSTRIAL WORK ONLY).

Date Oct 11-79 Applicant's Signature Don Burgstett

White Fire Guard Grid  
Fire Guard Site  
2x4 Site

Don Bergstedt

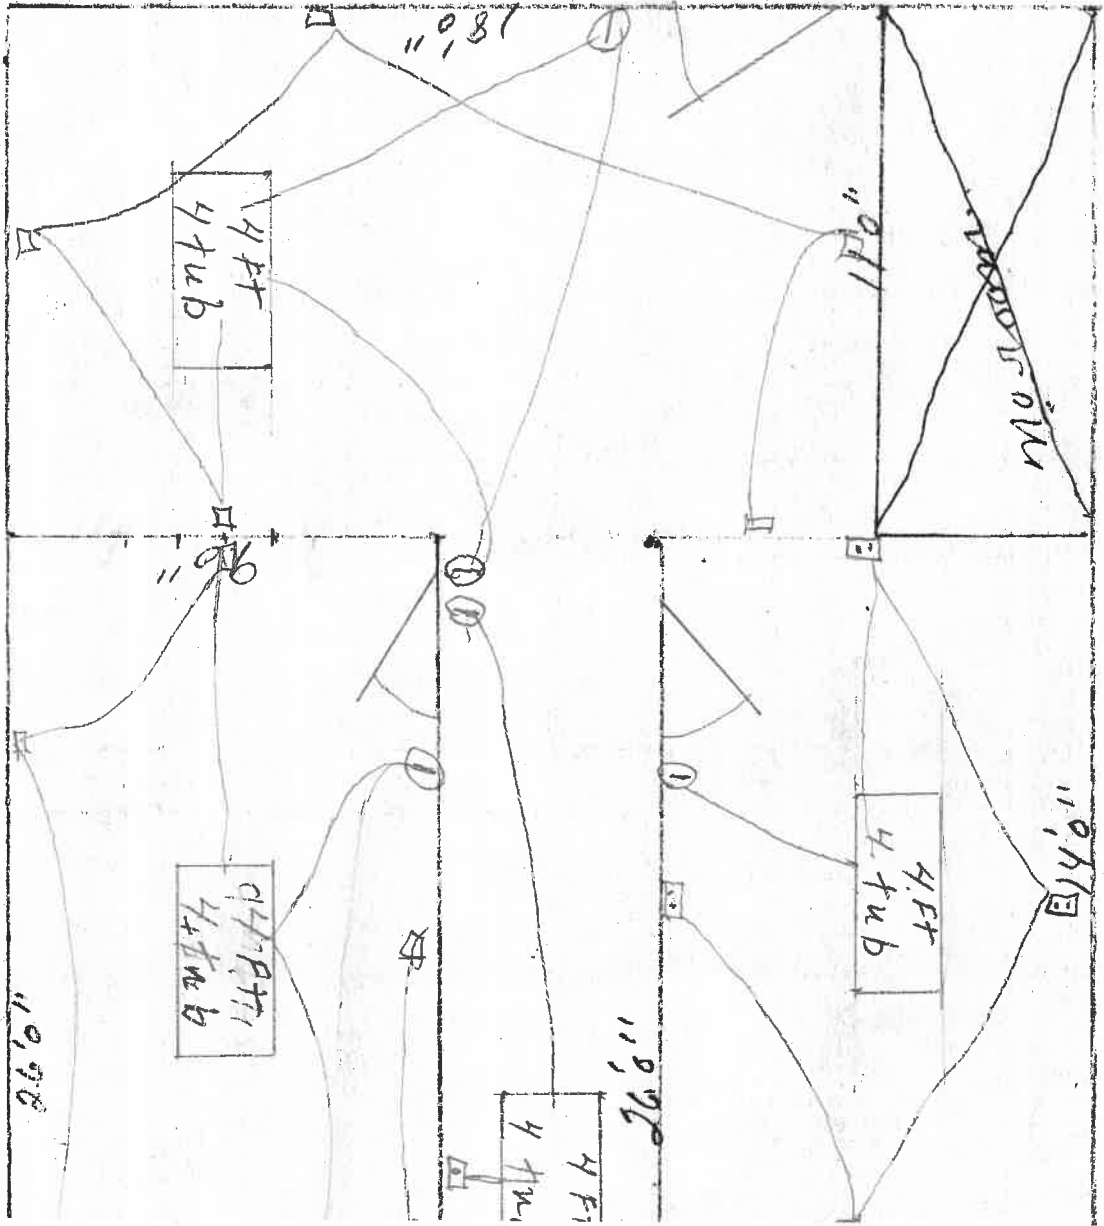



100 Nov 7-28-76

CITY OF NAPOLEON  
BUILDING INSPECTION DEPARTMENT  
APPLICATION FOR HEATING PERMIT  
(PLEASE PRINT OR TYPE)

NO. FEE

The undersigned hereby makes application for the installation, replacement or alteration of a heating system or device as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Mechanical Code for 1, 2 and 3 Family Buildings.

Owner's Name Jack Collins Address \_\_\_\_\_

Contractor's Name Bergquist Builders Address 1050 Dodd Tel. 592 3451

BUILDING INFORMATION:

Single Family \_\_\_\_\_ Double Family \_\_\_\_\_ Multiple \_\_\_\_\_ New Construction \_\_\_\_\_  
Addition \_\_\_\_\_ Remodel X Replacement \_\_\_\_\_ No. of Stories 3

DESCRIPTION OF WORK

Heating System - Warm Air X Hot Water \_\_\_\_\_ Steam \_\_\_\_\_ Electric \_\_\_\_\_

Unit Heaters \_\_\_\_\_ Unit Gas Heaters \_\_\_\_\_ Other \_\_\_\_\_

Type - Gravity \_\_\_\_\_ Forced X Radiant \_\_\_\_\_

No. of Thermostatical Heating Zone 1

Hot Water - One Pipe \_\_\_\_\_ Two Pipe \_\_\_\_\_ Series Loop \_\_\_\_\_

Electric Heat - No. of Circuits \_\_\_\_\_ Other \_\_\_\_\_

Total Heat Loss of Area to be Heated \_\_\_\_\_ 81,000 Btu.

Rated Capacity of Furnace/Boiler \_\_\_\_\_ 81,000 Btu.

No. of Furnaces 1 No. of Hot Air Runs 7

No. of Hot Water Radiators \_\_\_\_\_ Type of Fuel natural gas

Heating Units Located: Crawl Space \_\_\_\_\_ Floor Level \_\_\_\_\_ Suspended \_\_\_\_\_

Roof or Exposed to Outside Air \_\_\_\_\_ Attic \_\_\_\_\_ Other basement


APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: LOCATION OF FURNACE OR UNIT HEATERS AND SIZE AND LOCATION OF FEEDER DUCTS AND RETURN AIR DUCTS. ALL PLANS SHALL BE DRAWN TO SCALE.

ESTIMATED COST OF COMPLETED PROJECT: \$ 1200.00

DATE Oct 11-79 APPLICANT'S SIGNATURE Don Bergquist  
OWNER-CONTRACTOR-AGENT

White Fire Guard Crest  
Fire Guard Site  
2x4 Site

Don Bergstedt

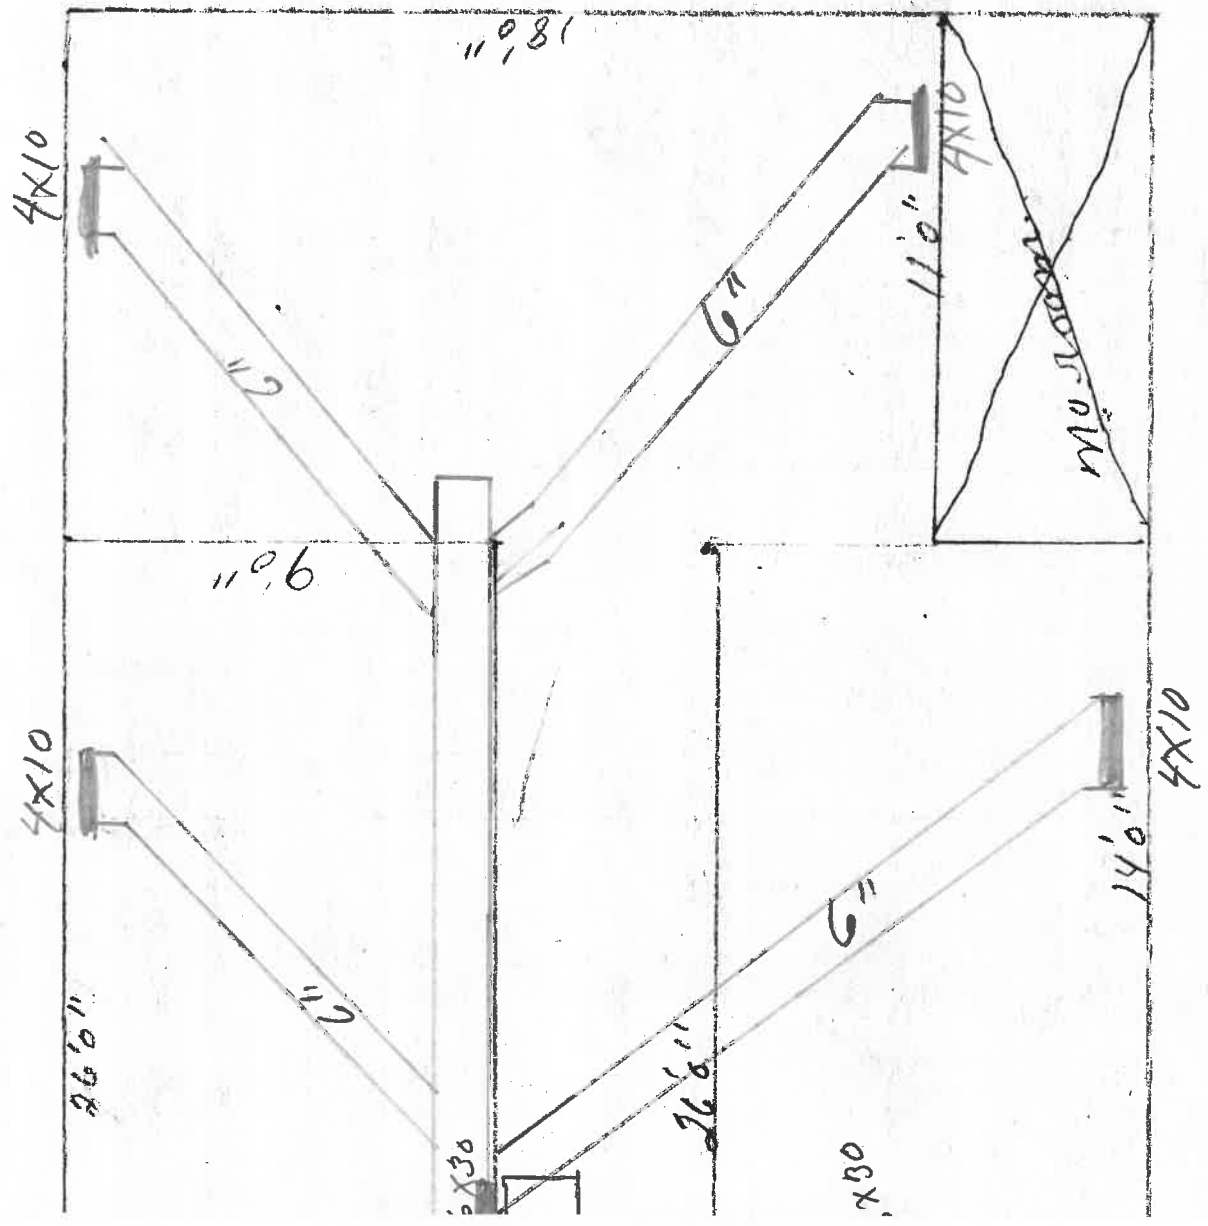

CITY OF NAPOLEON

Engineering Department

ELECTRICAL INSPECTION FIELD REPORT

255 Riverview Avenue Napoleon, Ohio 43545  
(Please Print or Type)

Date 12-1-79

Permit No. 161-79

Type of Inspection ROUGH-IN

Type of Occupancy OFFICE

Project Name

Address 712 N. PERRY

City State

Approved

Violation

Electrical Contractor BERGSTEDT

Remarks:

Code Reference

NORM: THIS IS IN THE FIRE LIMITS - BOB SAYS  
IT SHOULD BE IN CONDUIT.  
THIS IS BETWEEN MURPHY'S #  
CALL BERGSTEDT @ 592-3451 BEFORE  
YOU GO AND HE WILL OPEN IT FOR YOU

1:30 Pm Roughin OK

- 1) Check main Disc. See use Rain title enclosure
- 2) grounding required.
- 3) Same size conductors from load side of meter to Dist. Panel. See use on all other connections.

Compliance Time

Inspectors Signature Hobbes

Copies To: