




REVISIONS	BY

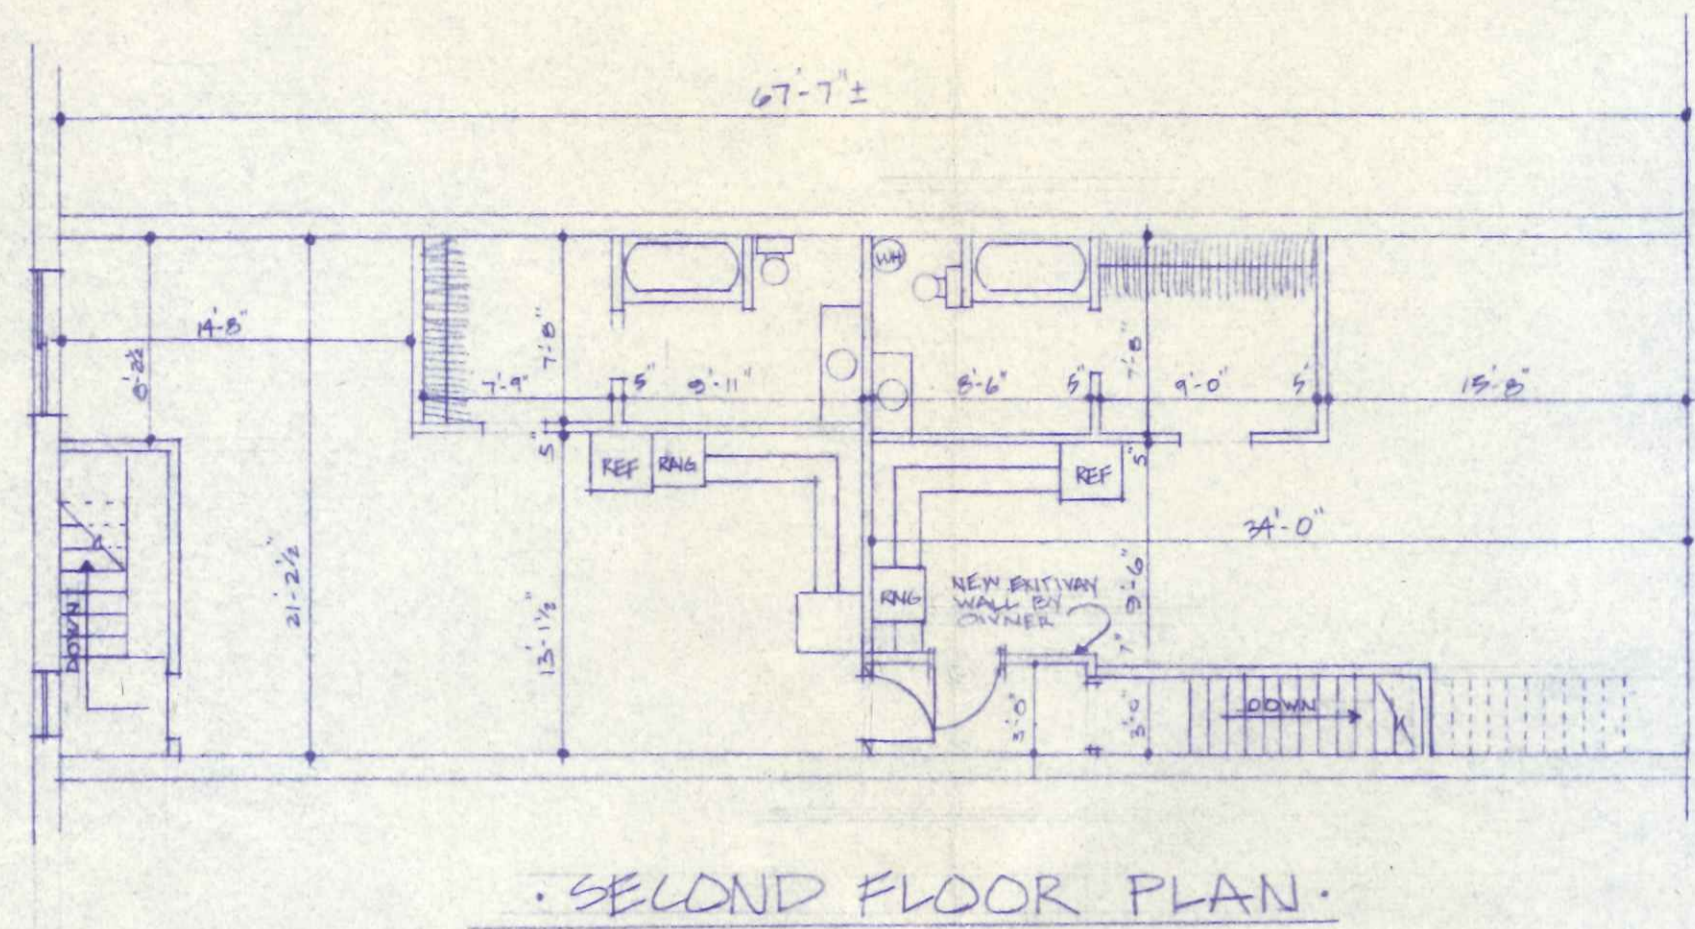


• SECOND FLOOR PLAN.

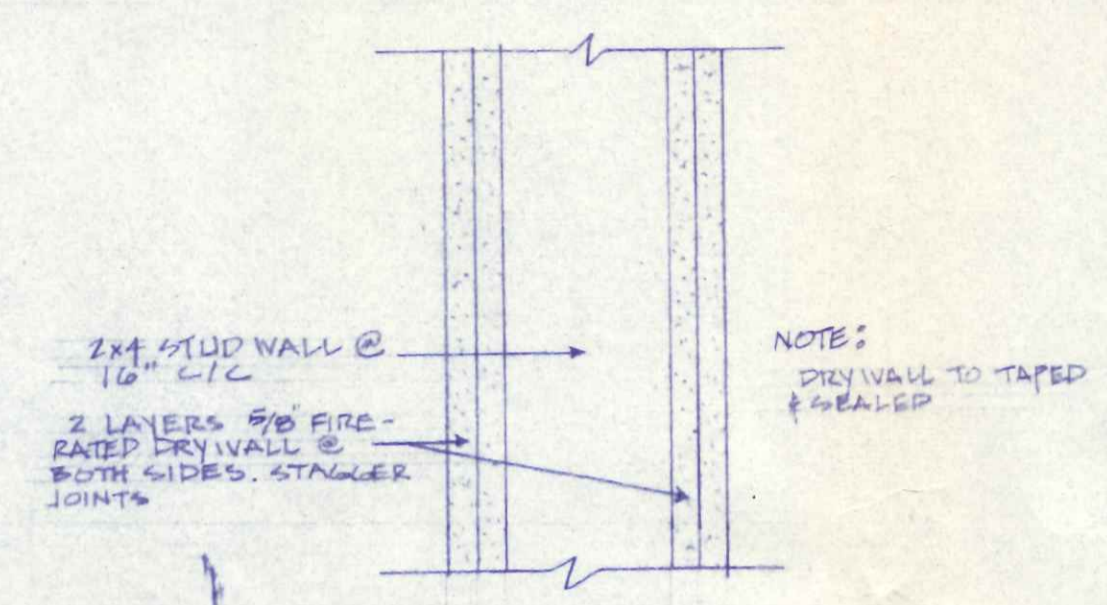


NEW 2 HR FIRE WALL
UL-LISTED

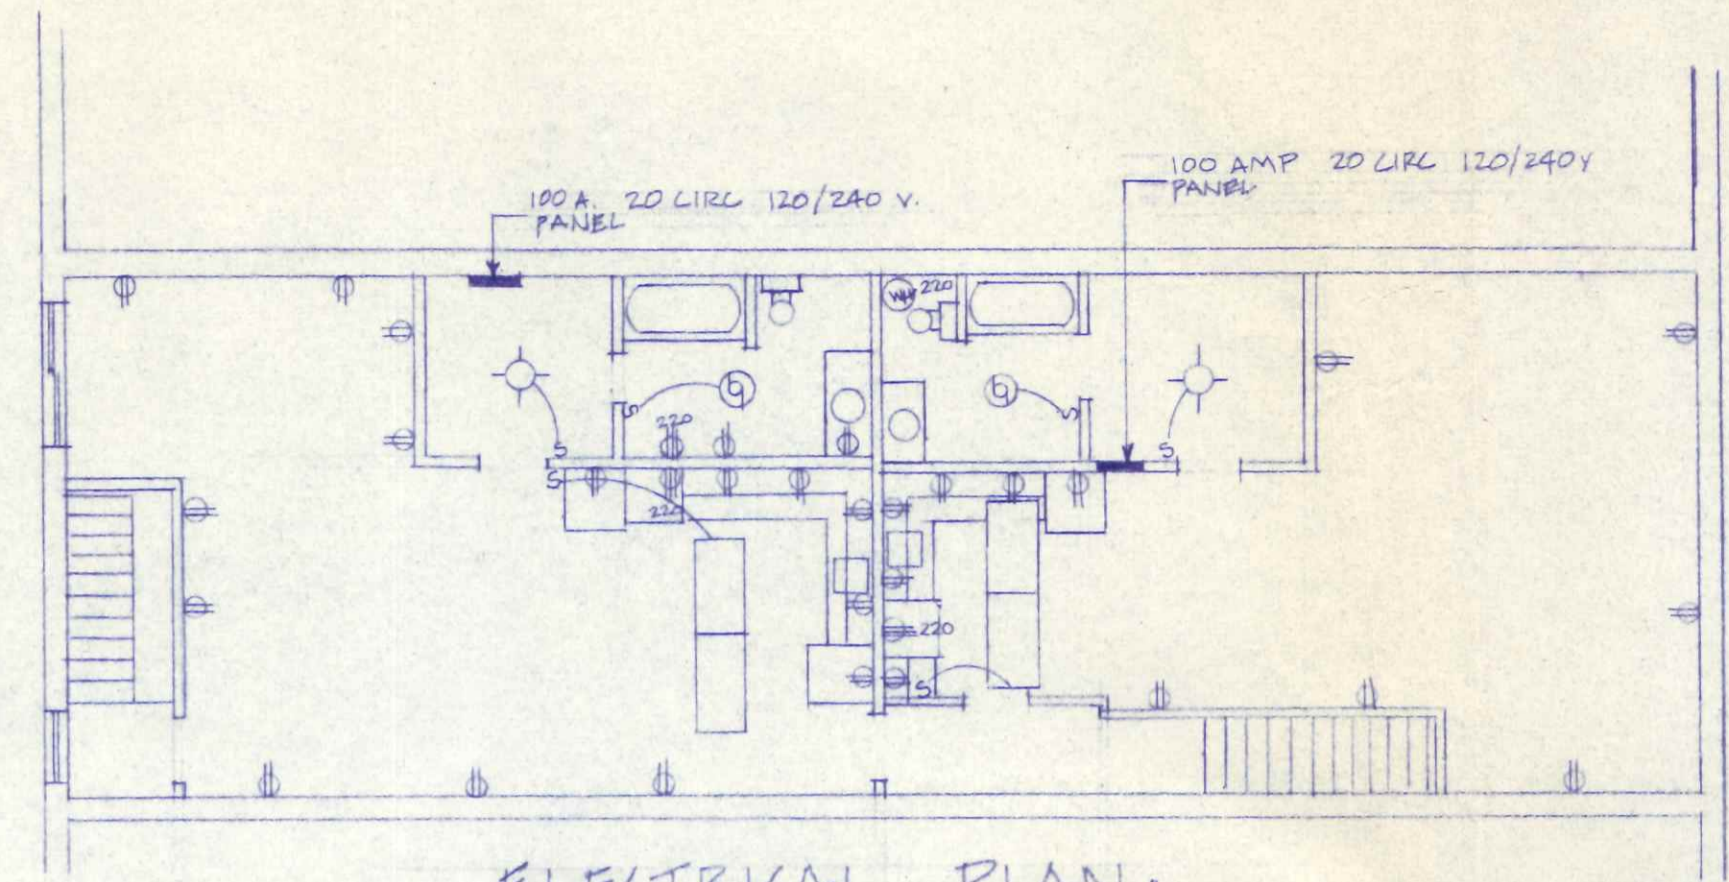

• ELECTRICAL PLAN.

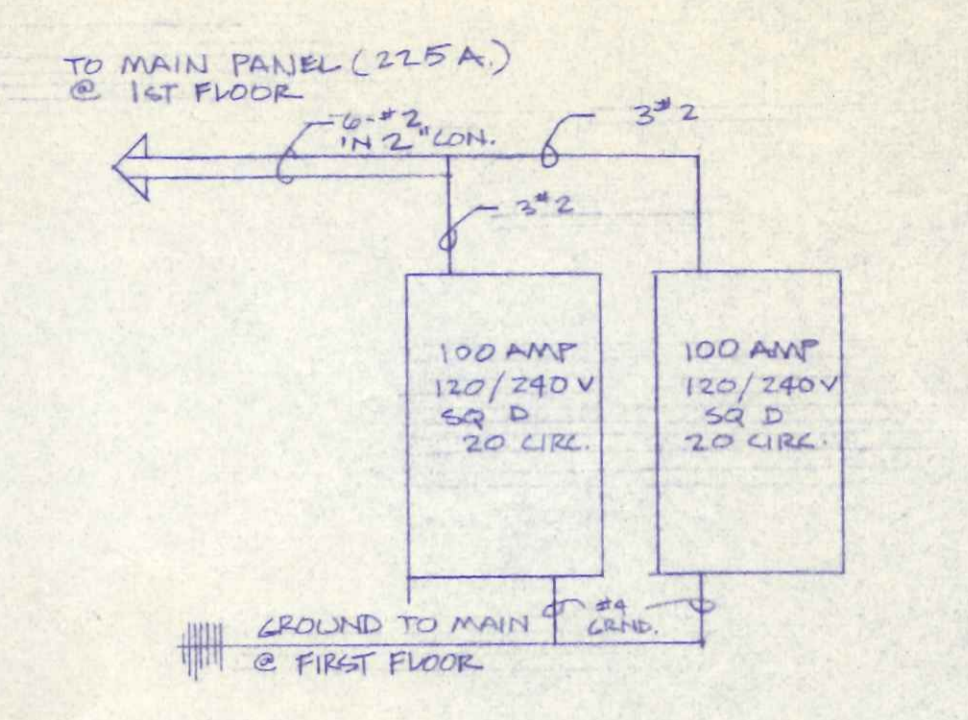


• RISER DIAGRAM -
NTS

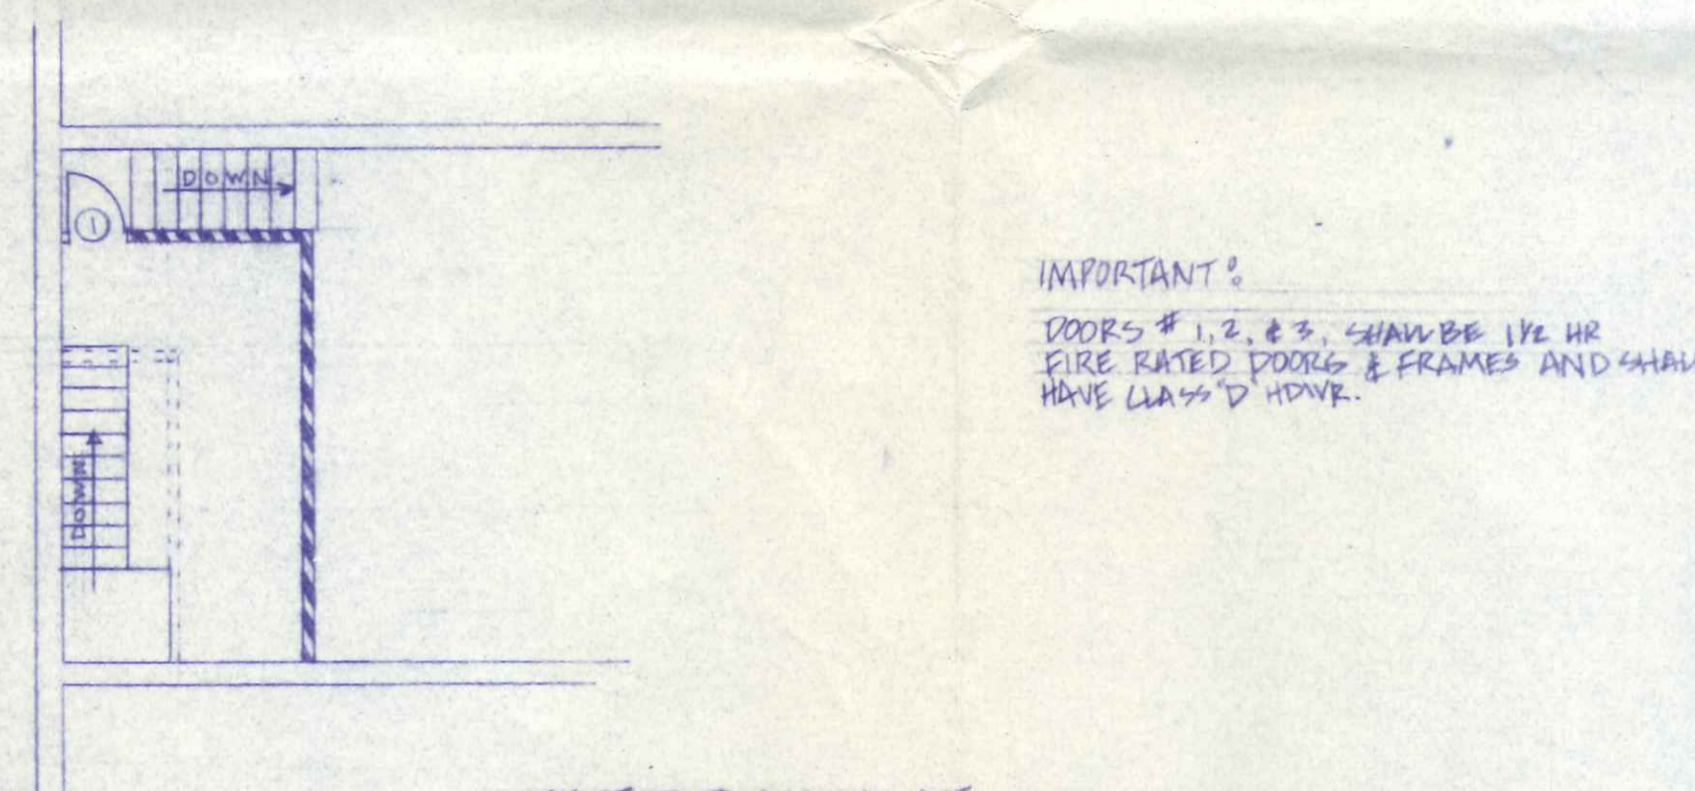


• MEZZANINE.

IMPORTANT:
DOORS # 1, 2, & 3. SHALL BE 1 1/2 HR
FIRE RATED DOORS & FRAMES AND SHALL
HAVE CLASS 'D' HWK.

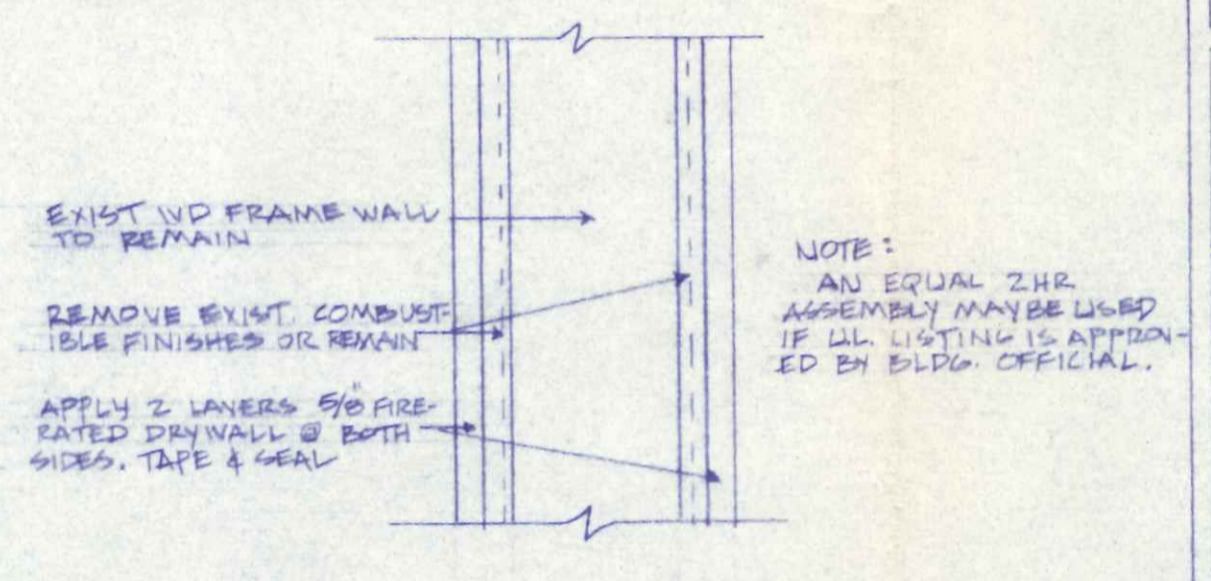


RENOVATION OF EXIST 0 HR WALL
TO 2 HR WALL

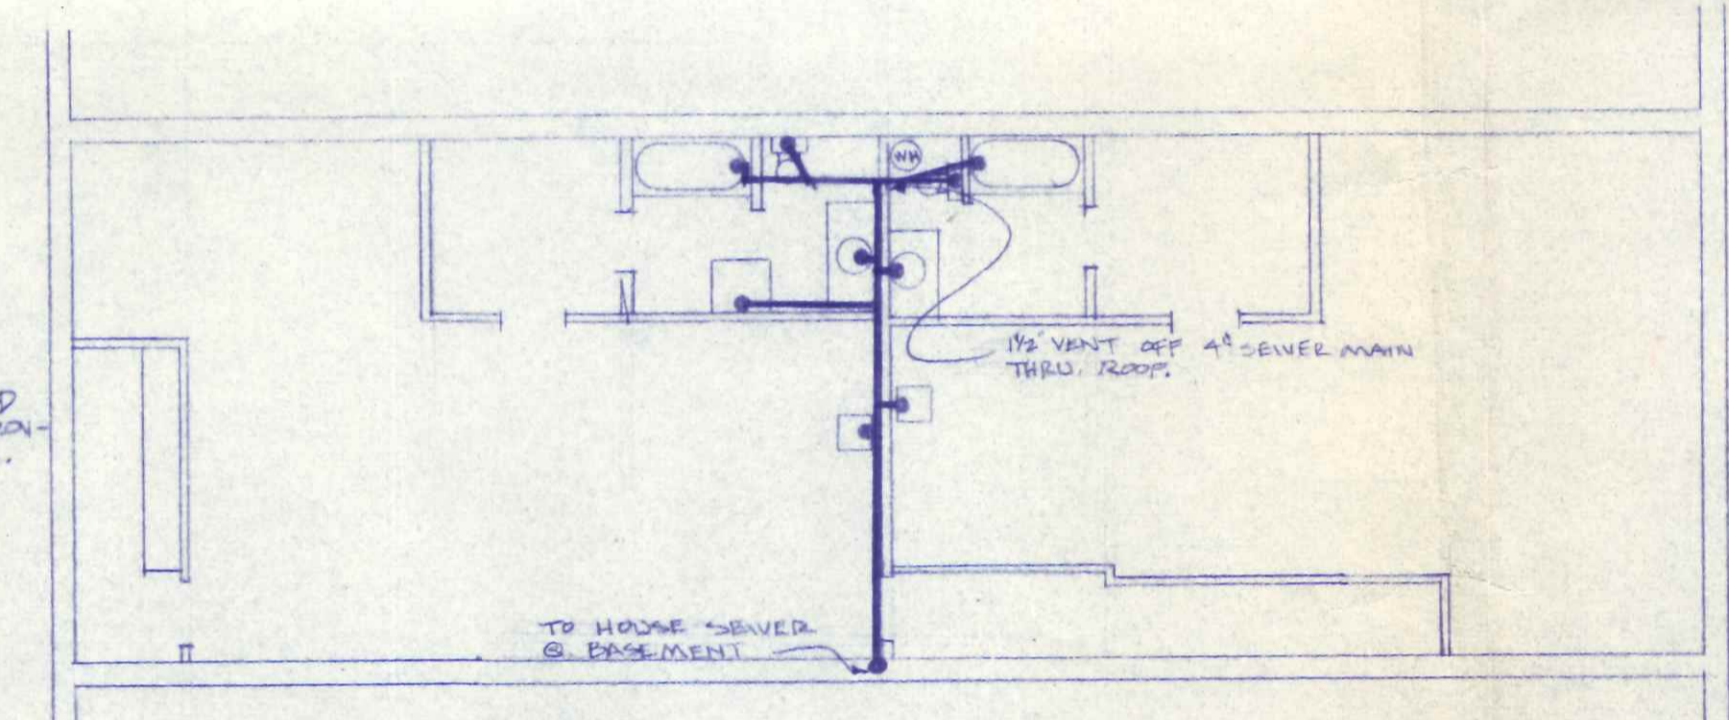

• PLUMBING PLAN.

PLUMBING NOTE:
ALL PLUMBING FEEDS
TO 4" PVC LINE WHICH
DRAINS DIRECTLY TO THE
HOUSE SEWER IN BASEMENT
OR TERRACE. ALL HOUSE SEWERS
ARE COHERENT TO OBBL CRITERIA (6-5-80)
PER CITY OF NAPOLEON INSPECTION
DEPT. (ADDENDUM INCLUDING) ADDENDUM # 1 - 4" PVC @ HOUSE
SEWER CONNECTION SHALL BE EQUIPPED WITH
4" CLEAN OUT AT BASEMENT FLOOR LINE.

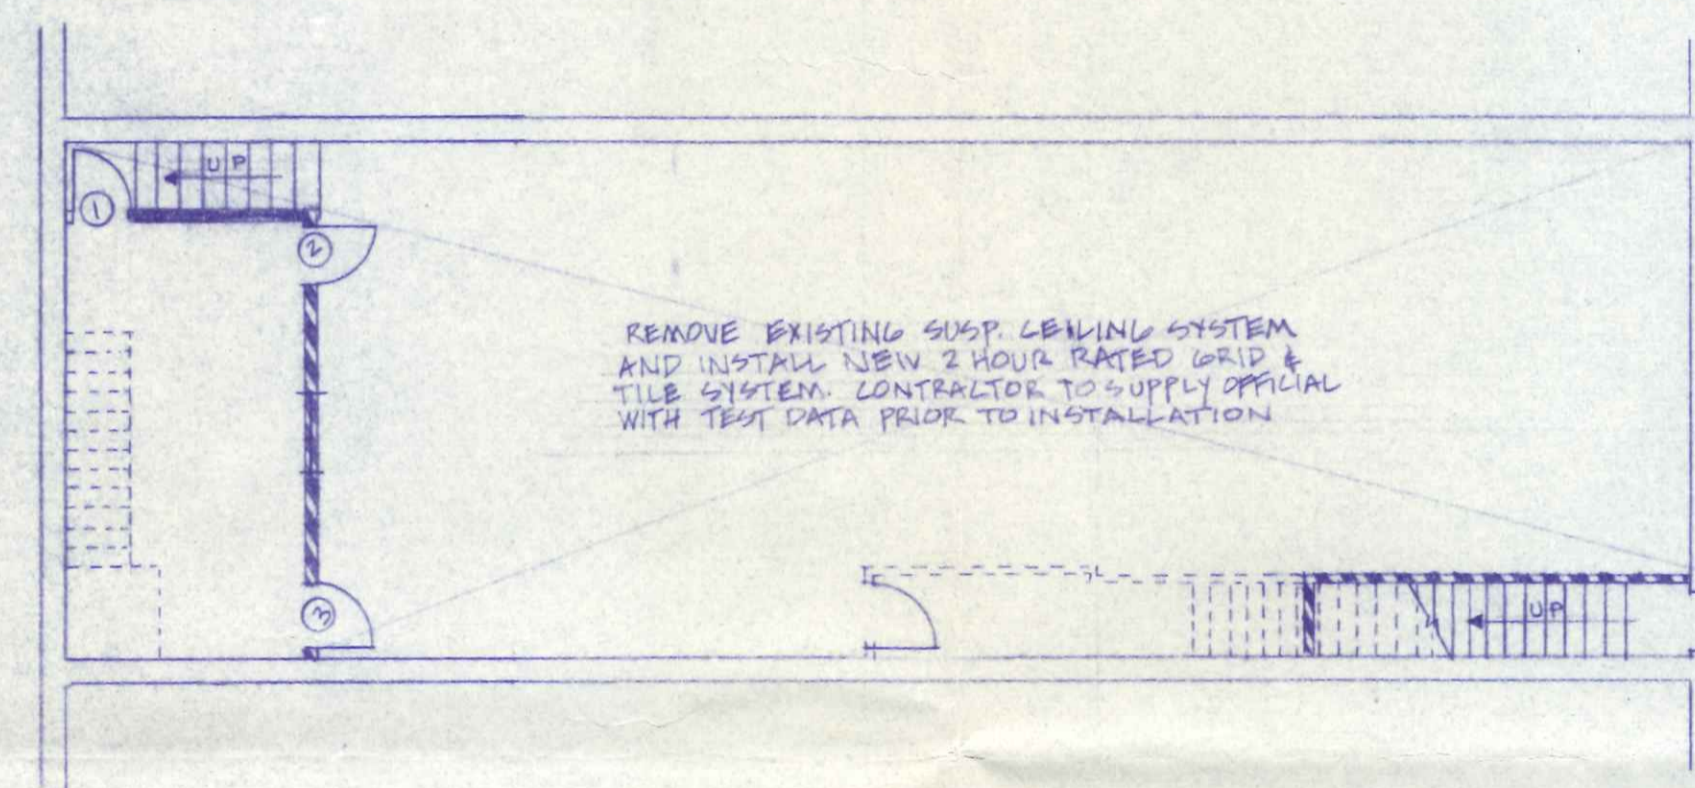

• FIRST FLOOR PLAN (EXITS ONLY).

SCALE 1/8" = 1'-0"

• WALL LEGEND •

	EXISTING WALLS TO REMAIN AS ARE AND UNCHANGED
	NEW 2 HR. FIRE WALLS
	EXISTING WALLS TO BE REVAMPED AS 2 HR FIRE WALLS.

Plan Approval
R. J. H.
7-2-80

RENOVATIONS & ALTERATIONS FOR
NOODLES LOUNGE
720 N PERRY ST. NAPOLEON, OHIO

DATE	6-7-80
SCALE	1/8" = 1'-0"
DRAWN	J.A. ROSENBERG
JOB	NL-80
SHEET	1
OF	1 SHEETS