

CITY OF NAPOLEON
PERMIT TO INSTALL STORAGE TANK
FOR FLAMMABLE LIQUIDS

Pd \$ 25.00
6-23-82

OWNER WALTER K Thielman PERMIT NO. 128

ADDRESS 402 S. Perry DATE 6-23-82


Issued by: P.W. Schweinhagen
Clerk

INSTALLER Ottawa Oil ADDRESS 105 E. 4th
Ottawa, Ok

LOCATION WHERE TANK IS TO BE INSTALLED: STREET 402 S. Perry
LOT NO. _____

← N

House

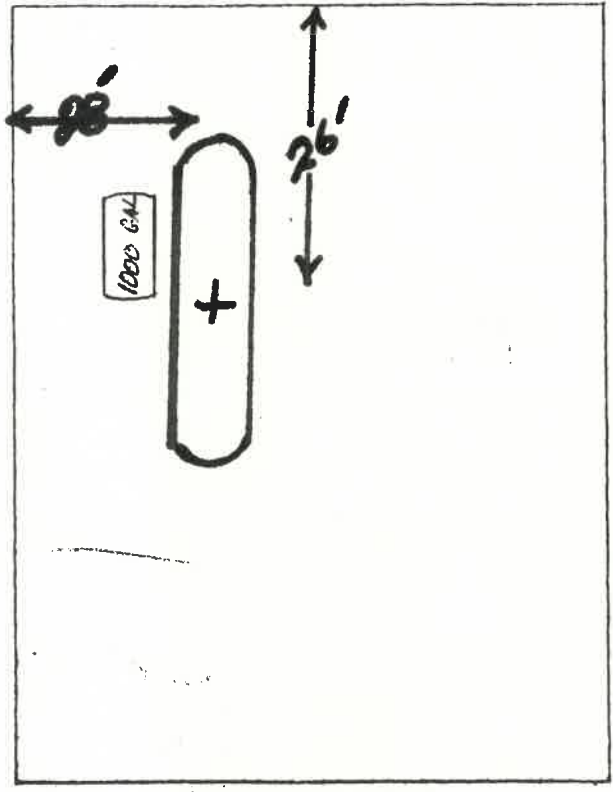

PROPERTY LINE
South. Perry St.

INSPECTION

LOCATION OF TANK 6-29-82
TANK FOUNDATION 6-29-82
BEFORE TANK IS COVERED 7-2-82

By: John E. Luchey
Fire Inspector

Tank No 10981
SIZE 8' X 26'
Gallons 8000

East Maume Ave.

Draw in dotted lines the location of tank or tanks and give the distance from two property lines. Show NORTH on drawing.