

CITY OF NAPOLEON
255 W. RIVERVIEW AVE
NAPOLEON, OHIO 43545

P E R M I T

DIVISION OF BUILDING & ZONING
PH (419) 592-4010
FAX (419) 599-8393

PERMIT NO: 1343

DATE ISSUED: 09-23-02

ISSUED BY: BND

JOB LOCATION: 619 S PERRY ST

EST. COST:

LOT #:

SUBDIVISION NAME:

OWNER: BOSTELMAN, MARGE
ADDRESS: 619 S. PERRY ST
CSZ: NAPOLEON, OH 43545
PHONE:

AGENT: SELF
ADDRESS:
CSZ:
PHONE:
OTHER:

USE TYPE - RESIDENTIAL:

ZONING INFORMATION

DIST: LOT DIM: AREA: # LOADING SP: FYRD: SYRD: RYRD:
MAX HT: # PKG SPACES: HEIGHT: BLDG VOL DEMO PERMIT: LIVING AREA SF:
BOARD OF ZONING APPEALS:

WORK TYPE - NEW: REPLMNT: ADD'N: ALTER: REMODEL:

WORK INFORMATION

SIZE - LGTH: WIDTH: STORIES: BLDG VOL DEMO PERMIT: LIVING AREA SF:

GARAGE AREA SF: HEIGHT:

WORK DESCRIPTION
WATER & SEWER TAPS
GARAGE BLDG


FEE DESCRIPTION

WATER TAP PERMIT
SEWER PERMIT

PAID DATE

FEE AMOUNT DUE

650.00
60.00

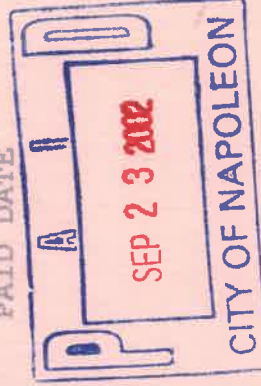

TOTAL FEES DUE 710.00

9.23.02

DATE

P. Margery Bostelman
APPLICANT SIGNATURE

CITY OF NAPOLEON

WATER METER YOKE RELEASE FORM

THIS DOCUMENT ENTITLES THE HOLDER TO "ONE" WATER METER YOKE ASSEMBLY
(Please pickup at City Operations Department 1775 Industrial Drive).

PERMIT #: 1343

ISSUED: 09-23-2002

JOB LOCATION: 619 S PERRY ST

OWNER: BOSTELMAN, MARGE

PHONE:

ADDRESS: 619 S PERRY ST NAPOLEON, OH 43545

CONTRACTOR: SELF

ADDRESS:

PHONE:

WATER TAP SIZE 1" 1.5" _____ 2" _____ OTHER _____
WATER METER YOKE SIZE 5/8" 3/4" _____ 1" _____ OTHER _____

NEW STRUCTURE _____ EXISTING STRUCTURE LAWN METER _____

WATER SERVICE LINE TO BE TYPE "K" COPPER OR "CTS" POLYETHYLENE TUBING
OF 1" MINIMUM SIZE.

BACKFLOW DEVICE REQUIRED YES NO _____
TYPE OF BACKFLOW DEVICE REQUIRED Double check valves assembly,

WATER METER YOKE INSTALLATION IS SUBJECT TO THE FOLLOWING CONDITIONS

- 1.) MUST BE LOCATED IN AN ACCESSIBLE AREA.
- 2.) MUST BE IN AN AREA WHICH IS NOT SUBJECT TO FREEZING TEMPERATURES.
- 3.) MUST BE AT LEAST 18" ABOVE FLOOR LEVEL (NO CRAWL SPACE INSTALLATIONS).
- 4.) MUST COMPLY WITH MINIMUM MOUNTING REQUIREMENTS (DRAWING AVAILABLE)

ISSUED BY _____ RECEIVED BY _____

1-Copy to: Building Dept, Water Dept, and Utilities Dept

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #: 1343

ISSUED: 09-23-2002

JOB LOCATION: 619 S PERRY ST

SUBDIVISION NAME: _____ LOT #: _____

OWNER: BOSTELMAN, MARGE

ADDRESS: 619 S PERRY ST NAPOLEON, OH 43545

CONTRACTOR: SELF PHONE: _____

TAP SIZE: 1" 1.5" 2" OTHER _____

AMOUNT PAID: 650.00 YOKE SIZE: 5/8"


PLUMBING CONTRACTOR: Bob Cordes PH: _____

DATE OF TAP: 11-14-02 OLD TAP #: _____ NEW TAP #: 0230

SIZE AND KIND OF MAIN: 8" CIP

LOCATION OF MAIN: 10' East of West pavement edge DEPTH OF MAIN: 5 1/2'

DIST FROM HYDRANT ~~WAVE~~: 224' S of Hyd 114 DIST TO CURB STOP FROM CORP: 30'

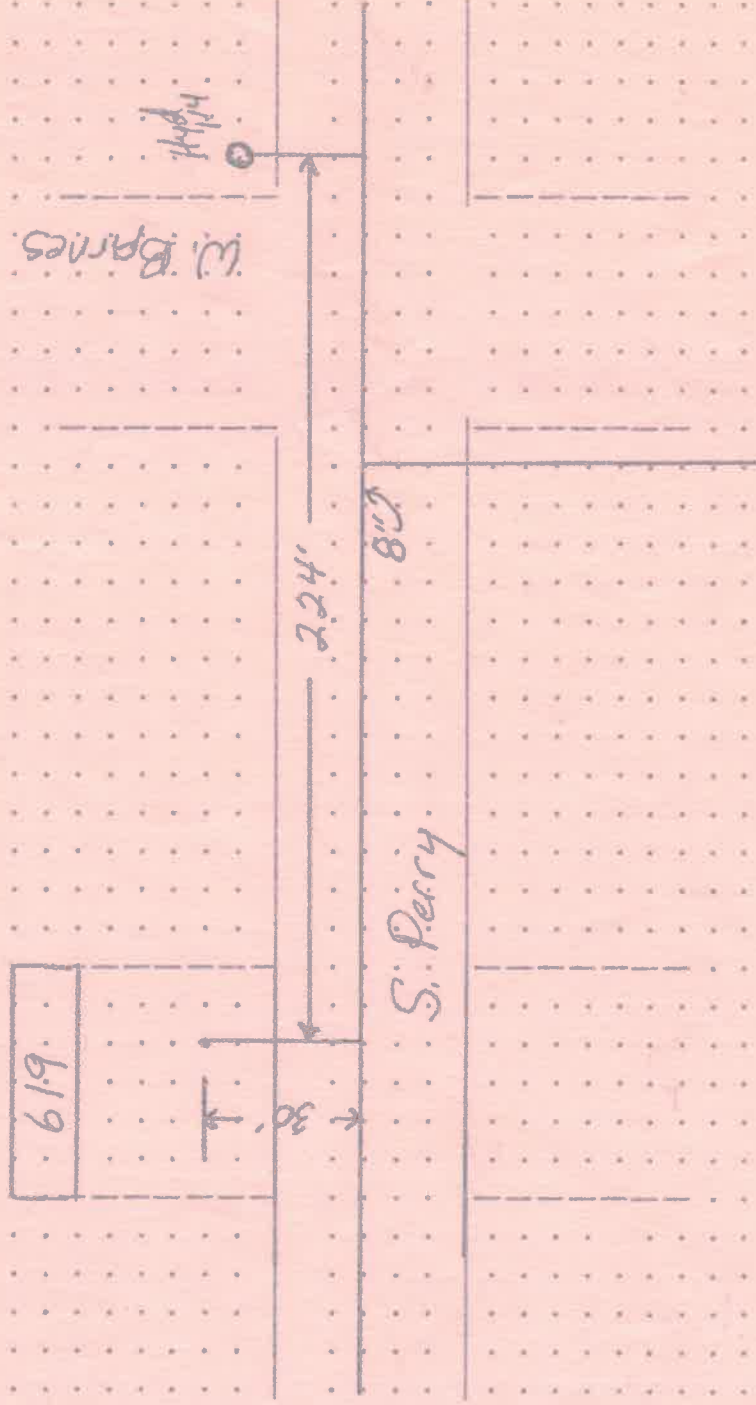


DATE APPROVED: Jan 13, 03

BY: Jeffrey C. Mantugh

9th West

Bob Cordes
9-24-02

Barnes St

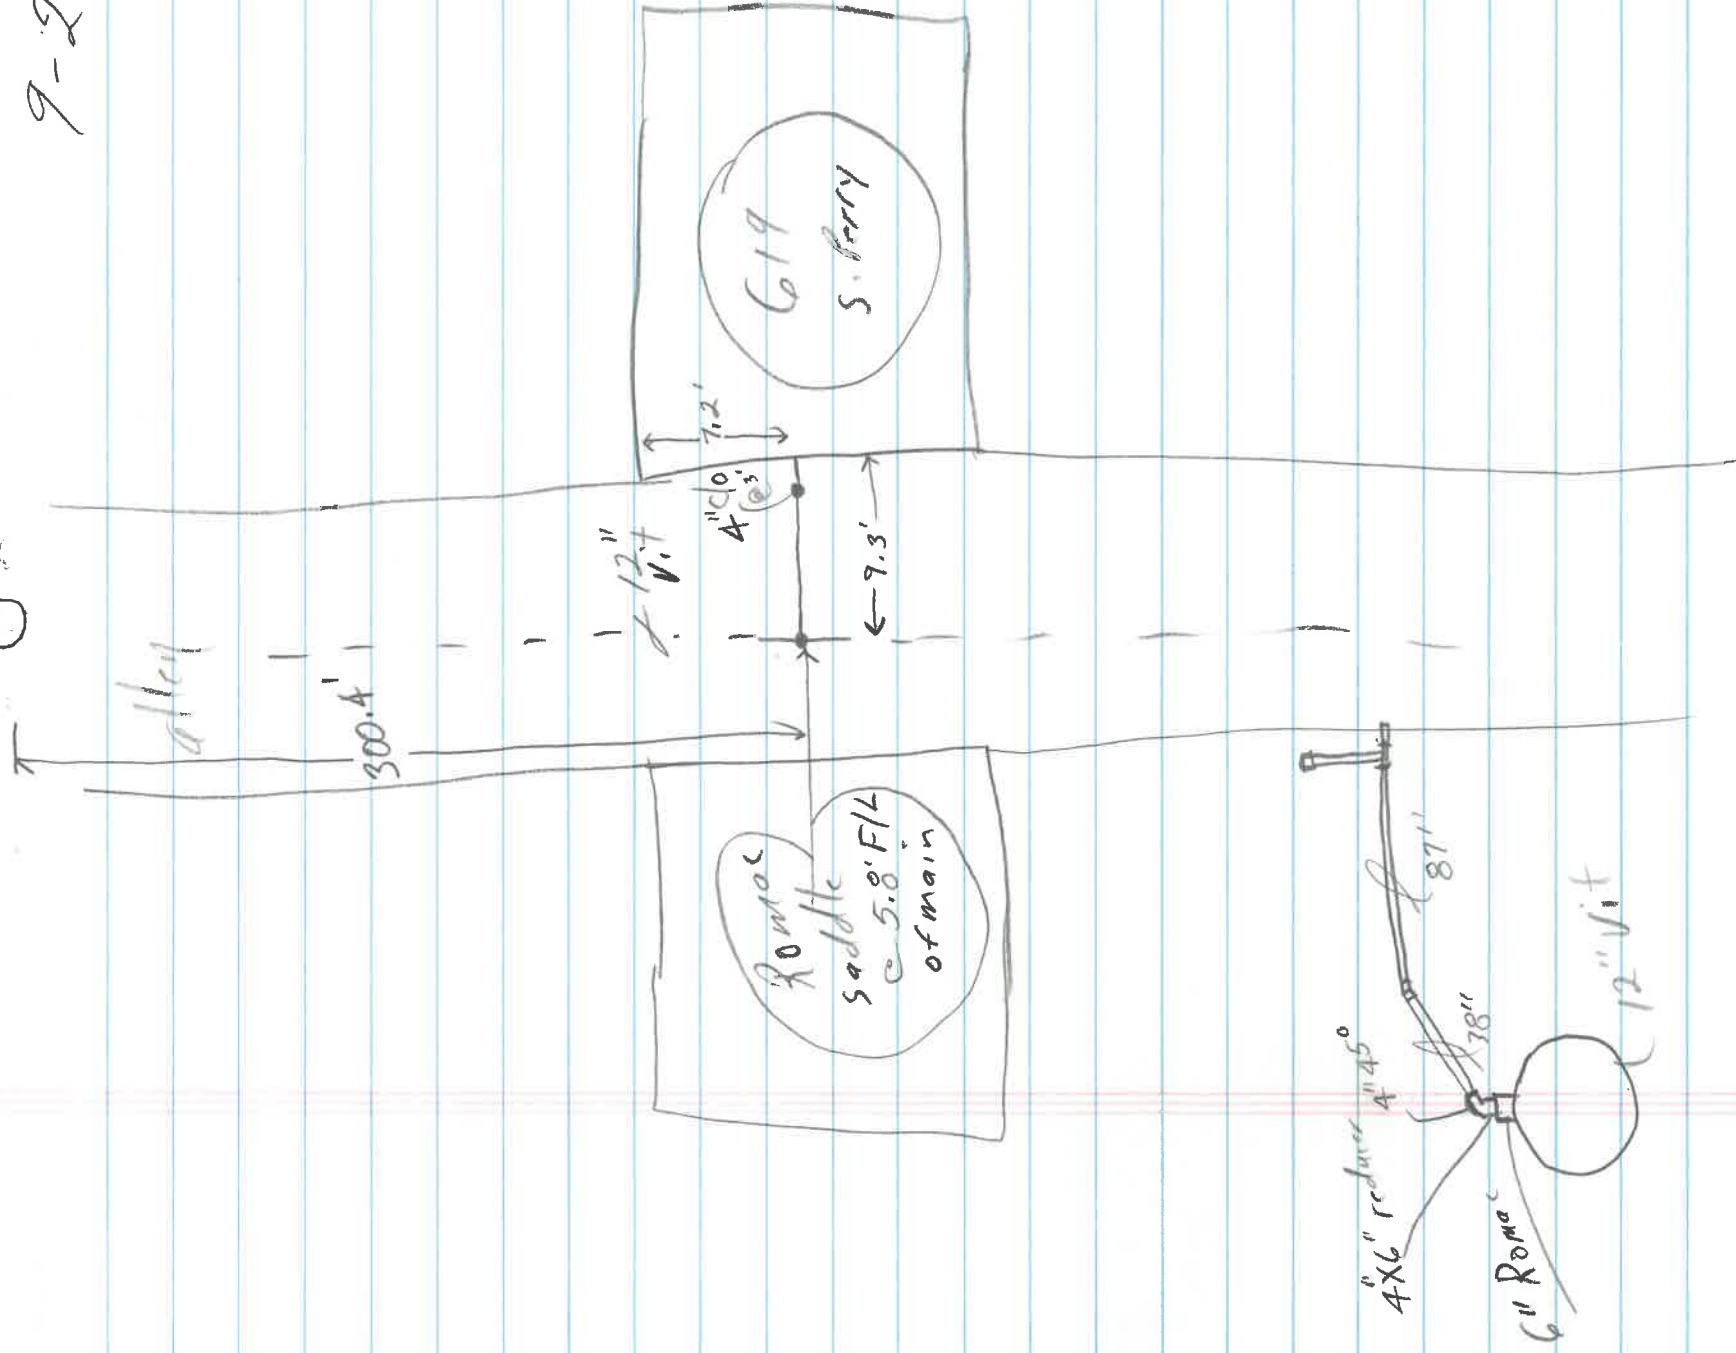

Perry St

CITY OF NAPOLEON INSPECTION FORM

PERMIT #: 1343

DATE ISSUED: 09-23-2002

JOB LOCATION: 619 S PERRY ST

OWNER: BOSTELMAN, MARGE

OWNER PHONE: _____

CONTRACTOR: SELF

CONTRACTOR PHONE: _____

WORK DESCRIPTION: WATER & SEWER TAPS

PLUMBING: UNDGR _____ RGHIN _____ FINAL _____

SEWER INSP _____

MECHANICAL: UNDGR _____ RGHIN _____ FINAL _____

FURNACE REPLC _____ AIR COND _____

ELECTRICAL: UNDGR _____ RGHIN _____ FINAL _____

SERV UPGR _____

BUILDING: SITE _____ FTG _____ FNDT _____

STRUC _____ ROOF _____ EXT _____

VENT _____ ACCES _____ EGRS _____

SMKDT _____ FINAL _____

ISSUE TEMP OCCUP _____ ISSUE OCCUP _____

STRG SHED: SITE _____ FINAL _____

SIGN: FTG _____ FINAL _____

FENCE: SITE _____ FINAL _____

MISC INSP: _____

NOTES: _____

INSPECTOR INITIALS: _____