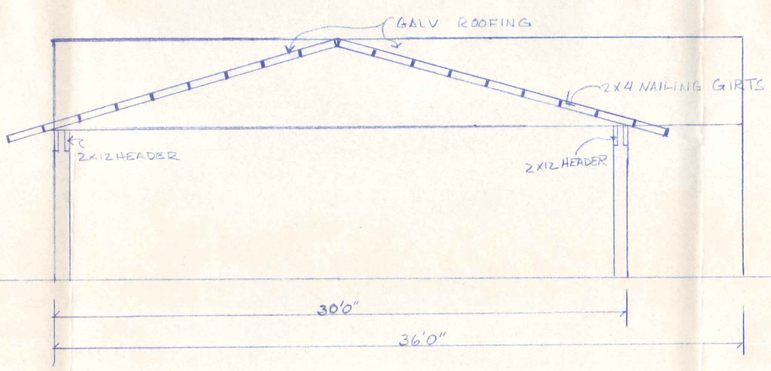

Approved
RHaywood
7/21/80

97 S Pine St
Lab

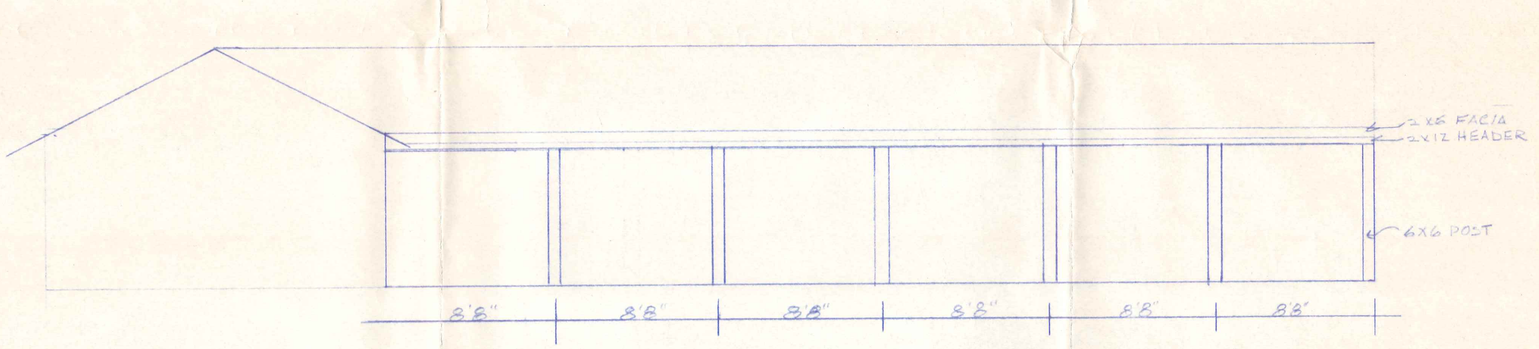

● 100 WATT INCADESCENT LAMP

⊖ DUPLEX RECEPTACLE W/ U-TYPE GROUND
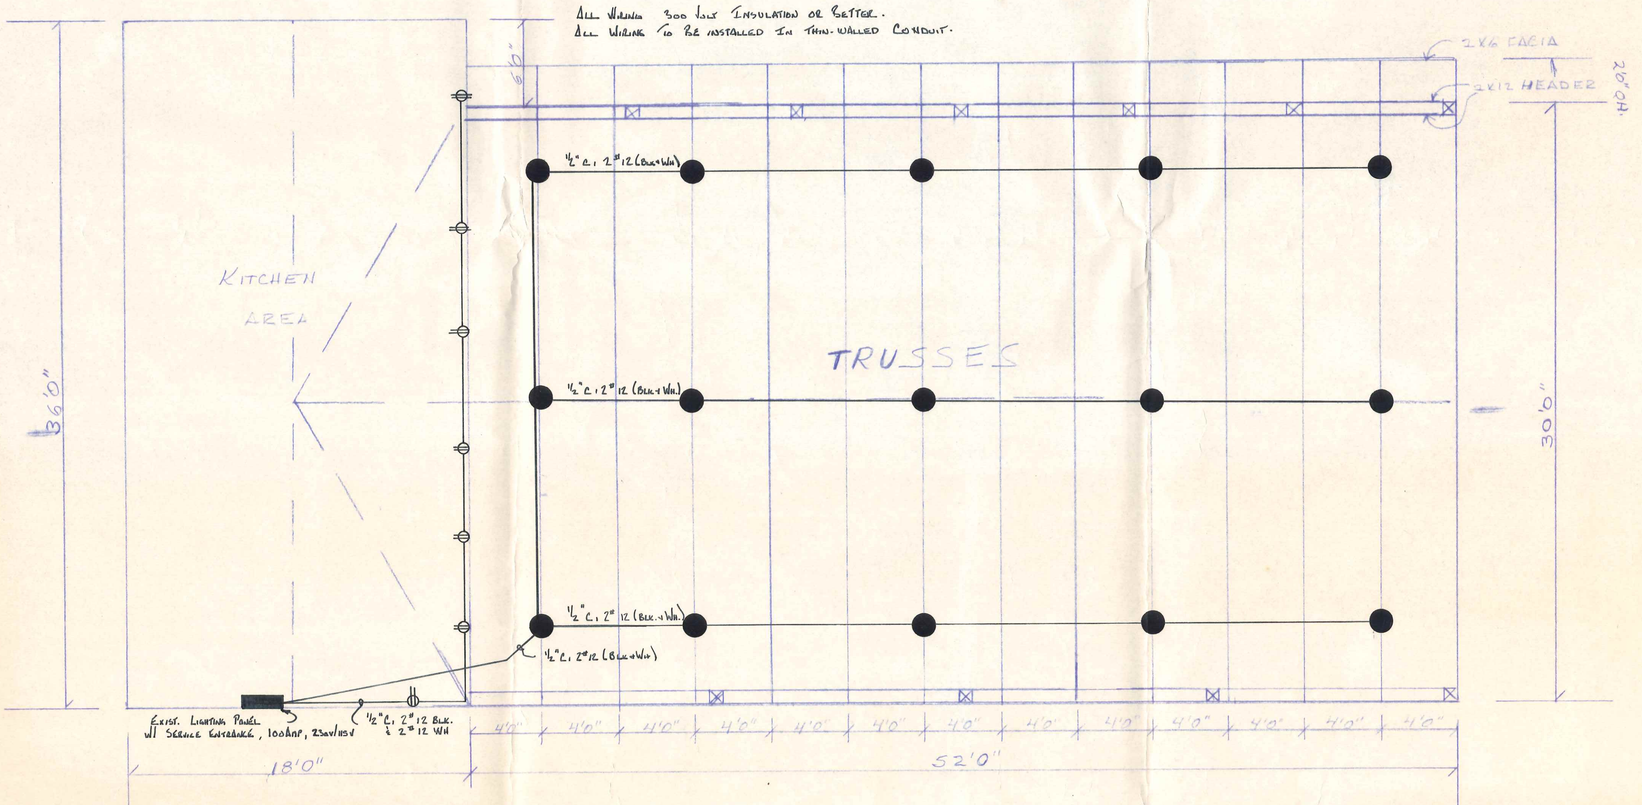
ALL WIRING 300 VOLT INSULATION OR BETTER.
ALL WIRING TO BE INSTALLED IN THIN-WALLED CONDUIT.