

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

Permit No. 665 Date July 15, 1983
Job Location Henry County Fairgrounds Valuation \$ _____
Owner Henry County 4-H Advisory Committee Address _____
Contractor Mike Britenriker Name Address _____ Telephone No. 267-3895
Address RFD 1, Stryker, Ohio
Electric Contractor _____
Plumbing Contractor _____
Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential Commercial Industrial
No. dwelling units
New Construction Addition Remodel
Brief Description of Work

ISSUED BY *Richard S. Haymon* Building Official **PEB** DEPT. OF BUILDING & ZONING

It is the owners or contractors responsibility to call the Building Department for the following (x) inspections:

- Footing excavation prior to placing concrete.
- Footing drains and foundation prior to backfill.
- Prepared sub-grade prior to placing concrete floor slab.
- Sanitary sewer
- Rough-in electrical, plumbing and service framing prior to installing wall board.
- Final electrical, plumbing and heating.
- Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit	\$ <u>No fee</u>
Electrical Permit	\$ _____
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demolition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other _____	\$ _____

TOTAL FEES \$ _____
LESS FEES PAID \$ _____
BALANCE DUE \$ PAID

JUL 19 1983
CITY OF NAPOLEON

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

Permit No. 065 Date July 15, 1983
Job Location Henry County Fairgrounds Valuation \$ _____
Owner Henry County 4-H Advisory Committee Address _____
Contractor Mike Briteniker Name _____ Address _____ Telephone No. 267-3895
Address RFD 1, Stryker, Ohio

Electric Contractor _____
Plumbing Contractor _____
Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential _____ No. dwelling units _____ Commercial _____ Industrial _____
New Construction _____ Addition _____ Remodel _____
Brief Description of Work _____

ISSUED BY Richard J. Hayman Building Official DEPT. OF BUILDING & ZONING

It is the owners or contractors responsibility to call the Building Department for the following (X) inspections:

- Footing excavation prior to placing concrete.
- Footing drains and foundation prior to backfill.
- Prepared sub-grade prior to placing concrete floor slab.
- Sanitary sewer
- Rough-in electrical, plumbing and service framing prior to installing wall board.
- Final electrical, plumbing and heating.
- Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit \$ No Fee
Electrical Permit \$ _____
Plumbing Permit \$ _____
Mechanical Permit \$ _____
Demolition Permit \$ _____
Zoning Permit \$ _____
Sign Permit \$ _____
Water Tap \$ _____
Sewer Tap \$ _____
Temp. Elec. \$ _____
Other _____ \$ _____

TOTAL FEES \$ PAID
LESS FEES PAID \$ _____
BALANCE DUE \$ JUL 19 1983

CITY OF NAPOLEON

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

INSPECTION RECORD

UNDERGROUND		ROUGH-IN & FINA'				
Type	Date	By	Type	Date	By	
PLUMBING	Sewer Connection		Drainage, W. & Vent		Drainage, W. & Vent	
	Building Sewer		Water Piping		Water Heater	
	Water Piping		Condensate Lines		Backflow Prevention	
			Indirect Waste			
					FINAL APPROVAL	
ELECTRICAL	Floor Ducts Raceways		Rough Wiring		Electric Mtr. Clearance	
	Conduits & or Cable		Conduits/ Cable		Signs	
	Grounding & or Bonding		Service Panel			
			Switchboard			
			Subpanels			
MECHANICAL	Refrigerant Piping		Refrigerant Piping		Duct Insulation	
	Ducts/ Plenums		Ducts/ Plenums		Chimney(s)	
			Ventilation Supply		Furnace(s)	
			<input type="checkbox"/> Exhst.		FINAL APPROVAL	
			<input type="checkbox"/> Range <input type="checkbox"/> Dryer		FINAL APPROVAL	
BUILDING	Location, Set-backs, Esmt(s)		Wall Construction		Fireplace Chimney	
	Excavation		Crawl Space <input type="checkbox"/> Vent <input type="checkbox"/> Access		Attic <input type="checkbox"/> Vent <input type="checkbox"/> Access	
	Footings & Reinforcing		Floor System(s)		Special Insp Reports Rec'd	
	Sub-soil Drain		Roof System		Smoke Detector	
	Foundation Walls		Fire Wall(s)		Demolition (sewer cap)	
	Floor Slab		Roof Cover Roof Drain		Building or Structure	
	FINAL APPROVAL BLDG. DEPT		—	Certificate of Occupancy Issued	#	

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(Please print or type)

The undersigned hereby makes application for installation or replacement of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Codes.

Owner's Name Henry Co. 4-H Advisory Committee Address _____

Electrical Contractor Bostelman Electric Telephone No. 599-3416

Address 232 Roberts Nap

General Contractor Mike Briteniker Telephone No. 267-3895

Address RFD 1 Stryker

Location of Project Henry Co Fair Grounds Cost of Project _____

Work Information:

Residential _____ Commercial _____ Industrial _____

No. Units

New _____ Service Change _____ Rewiring _____ Additional Wiring X

Brief Description of Work: _____

Size of proposed service entrance _____ Number of new circuits 6

Type of proposed service entrance _____ Underground _____ Overhead _____

Require Temporary Electric No (Yes or No)

Total Floor Area - Commercial and Industrial only 3072 sq. ft

Additional Information: _____


*Ground fault circuit interrupter protection is required on all 120-volt single phase, 15 and 20 amp. Circuits which are part of a temporary electric service: and also on bathroom, outdoor, and garage receptacles in all dwelling units. Art. 220-8 N.E.C.

*Application for permit shall be accompanied by two complete sets of plans including: Electrical layout and riser diagram. (For commercial and industrial work only).

Date July 14, 1983

Applicant's Signature Norman P. Bostelman

PERMIT NO. 105
PERMIT FEE \$ NO FEE

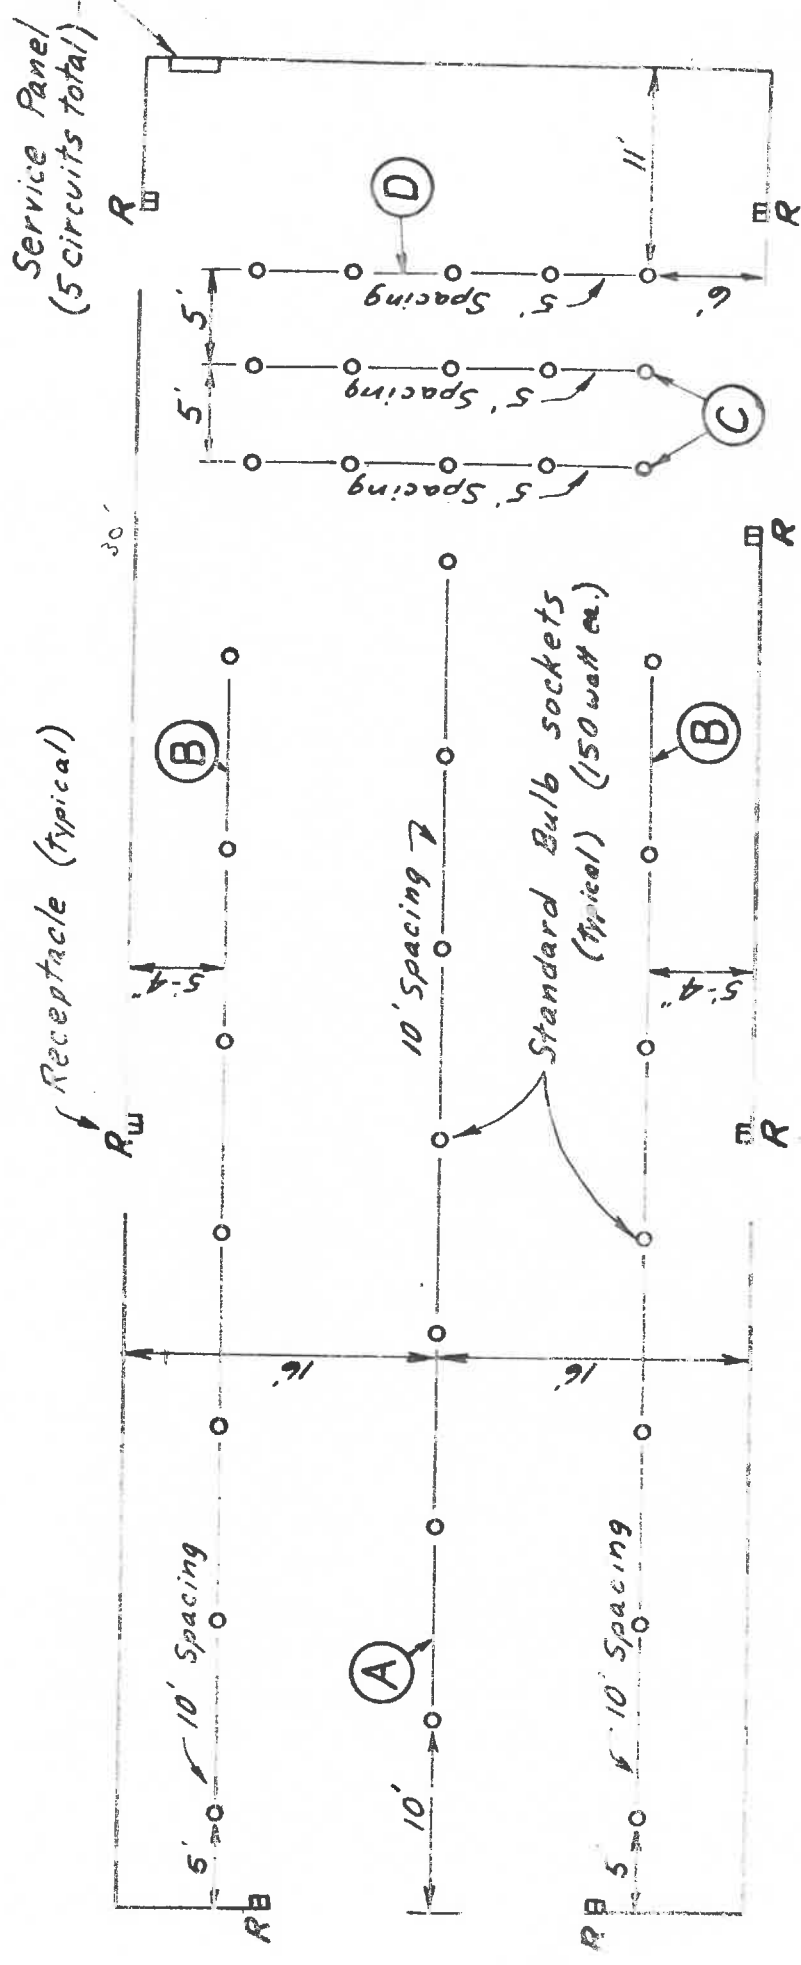

ELECTRICAL LAYOUT

Note: A separate circuit to control lines A, B, C, & D as shown. A fifth circuit will be used for the receptacles. All light sockets will use 150 watt bulbs.

