

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

Permit No. 876 Date Aug 3, 1984
Job Location 907 S. Perry Valuation \$ 600.00
Owner Agricultural Society Address County Court House
Contractor _____ Telephone No. _____
Address _____
Electric Contractor Bartels Electric
Plumbing Contractor _____
Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential Commercial X Industrial
No. dwelling units

New Construction Addition Remodel

Brief Description of Work Electrical in Draft Horse Barn

ISSUED BY Richard G. Haymer DEPT. OF BUILDING & ZONING
Building Official

It is the owners or contractors responsibility to call the Building Department for the following (x) inspections:

- Footing excavation prior to placing concrete.
- Footing drains and foundation prior to backfill.
- Prepared sub-grade prior to placing concrete floor slab.
- Sanitary sewer
- Rough-in electrical, plumbing and service framing prior to installing wall board.
- Final electrical, plumbing and heating.
- Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit	\$ _____
Electrical Permit	\$ <u>9.00</u>
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demolition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other	\$ _____
TOTAL FEES	\$ <u>9.00</u>
LESS FEES PAID	\$ <u>-0-</u>
BALANCE DUE	\$ <u>9.00</u>

PAID
AUG 3 1984
CITY OF NAPOLEON

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

THE UNIVERSITY OF CHICAGO
DEPARTMENT OF CHEMISTRY

372

REPORT OF THE COMMITTEE ON THE
PROGRESS OF CHEMISTRY IN
1954

PAID
MAY 1955
MR. B. ROBERTS

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

Permit No. 076 Date Aug 3 1984
Job Location 707 S. Perry Address _____ Valuation \$ 600.00
Owner _____ Name _____ Address _____
Contractor _____ Telephone No. _____
Address _____
Electric Contractor Barstoll's Electric
Plumbing Contractor _____
Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential _____ Commercial _____ Industrial _____
No. dwelling units
New Construction _____ Addition _____ Remodel _____
Brief Description of Work _____

ISSUED BY Richard A. Boyer Building Official DEPT. OF BUILDING & ZONING

It is the owners or contractors responsibility to call the Building Department for the following (x) inspections:

- Footing excavation prior to placing concrete.
- Footing drains and foundation prior to backfill.
- Prepared sub-grade prior to placing concrete floor slab.
- Sanitary sewer
- Rough-in electrical, plumbing and service framing prior to installing wall board.
- Final electrical, plumbing and heating.
- Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit	\$ _____
Electrical Permit	\$ <u>700</u>
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demolition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other _____	\$ _____

TOTAL FEES \$ _____
LESS FEES PAID \$ _____
BALANCE DUE \$ _____

PAID
AUG 3 1984
CITY OF NAPOLEON

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

INSPECTION RECORD

UNDERGROUND		ROUGH-IN & FINAL			
Type	Date	By	Type	Date	By
PLUMBING					
Sewer Connection			Drainage, W. & Vent		
Building Sewer			Water Piping		
Water Piping			Condensate Lines		
			Indirect Waste		
					FINAL APPROVAL
Floor Ducts Raceways			Rough Wiring		Electric Mtr. Clearance
Conduits & or Cable			Conduits/ Cable		Signs
Grounding & or Bonding			Service Panel Switchboard		
			Subpanels		
			<input type="checkbox"/> Range <input type="checkbox"/> Dryer		FINAL APPROVAL
ELECTRICAL					
MECHANICAL					
Refrigerant Piping			Refrigerant Piping		Duct Insulation
Ducts/ Plenums			Ducts/ Plenums		Chimney(s)
			Ventilation <input type="checkbox"/> Supply		Furnace(s)
			<input type="checkbox"/> Exhst.		FINAL APPROVAL
BUILDING					
Location, Set-backs, Esmt(s)			Wall Construction		Fireplace Chimney
Excavation			Crawl Space <input type="checkbox"/> Vent <input type="checkbox"/> Access		Attic <input type="checkbox"/> Vent <input type="checkbox"/> Access
Footings & Reinforcing			Floor System(s)		Special Insp Reports Rec'd
Sub-soil Drain			Roof System		Smoke Detector
Foundation Walls			Fire Wall(s)		Demolition (sewer cap)
Floor Slab			Roof Cover		Building or Structure
			Roof Drain		
FINAL APPROVAL BLDG. DEPT.			Certificate of Occupancy Issued		#

PAID
MAY 3 1984
CITY OF WASHINGTON

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(Please print or type)

The undersigned hereby makes application for installation or replacement of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Codes.

Owner's Name Henry Co Fair Ground Address _____

Electrical Contractor Bartels Telephone No. 533-3421

Address Liberty Center

General Contractor _____ Telephone No. _____

Address _____

Location of Project Fair Grounds Cost of Project \$600

Work Information:

Residential _____ Commercial X Industrial _____

No. Units _____

New _____ Service Change _____ Rewiring _____ Additional Wiring _____

Brief Description of Work: 8 interior lights, 1 security light and 2 GFCI Receptacles.

Size of proposed service entrance _____ Number of new circuits 4

Type of proposed service entrance _____ Underground _____ Overhead _____

Require Temporary Electric _____ (Yes or No)

Total Floor Area - Commercial and Industrial only _____ sq. ft.

Additional Information: _____


*Ground fault circuit interrupter protection is required on all 120-volt single phase, 15 and 20 amp. Circuits which are part of a temporary electric service; and also on bathroom, outdoor, and garage receptacles in all dwelling units. Art. 220-8 N.E.C.

*Application for permit shall be accompanied by two complete sets of plans including: Electrical layout and riser diagram. (For commercial and industrial work only).

Date 8/3/84

Applicant's Signature Bartels Electric
John Swarrigan

PERMIT NO. 8176
PERMIT FEE \$ 9.00

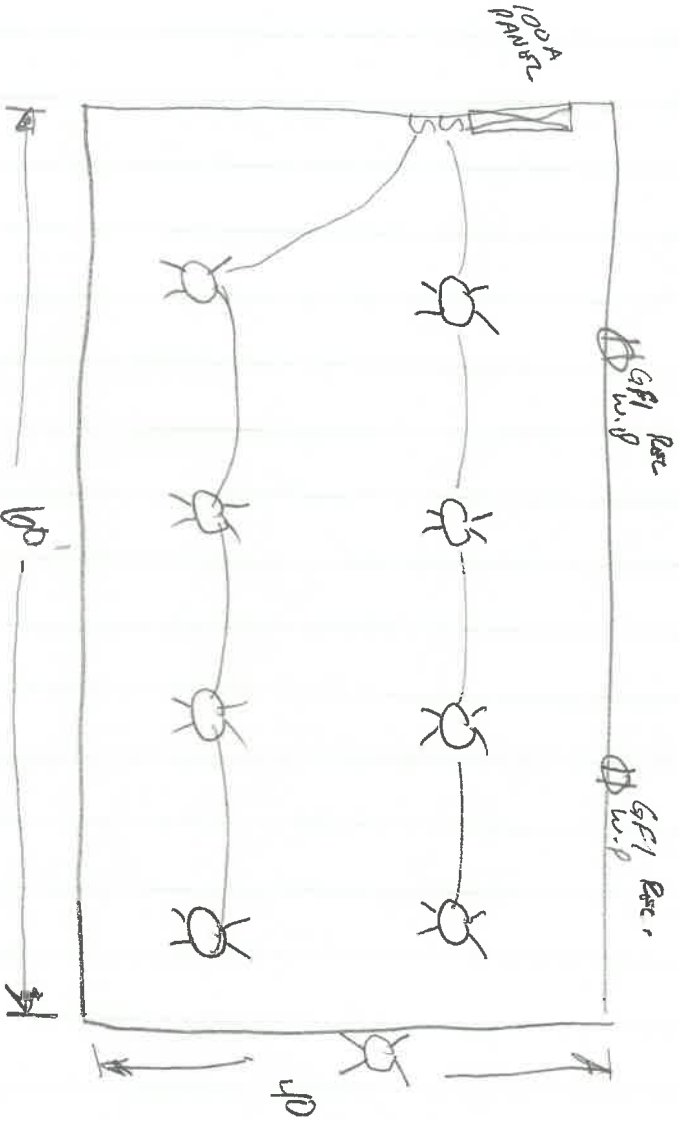

Henry Co. Fairgrounds
 Draft Address Barn

BARTELS Electric
 JOHN SUMNER INGERS

