

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0173 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey C. MacLaughlin water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 8-5-97 Street and No. 1019 Reynolds

Old Tap No. 3734 New Tap No. 9739 Size and Kind of Main 8" C-900

Location of Main 10' EAST OF EAST CURB Depth of Main 5'

Distance from Hydrant/Valve 231' South of Hyd 141 Distance to Curb Stop from Corp. 55'

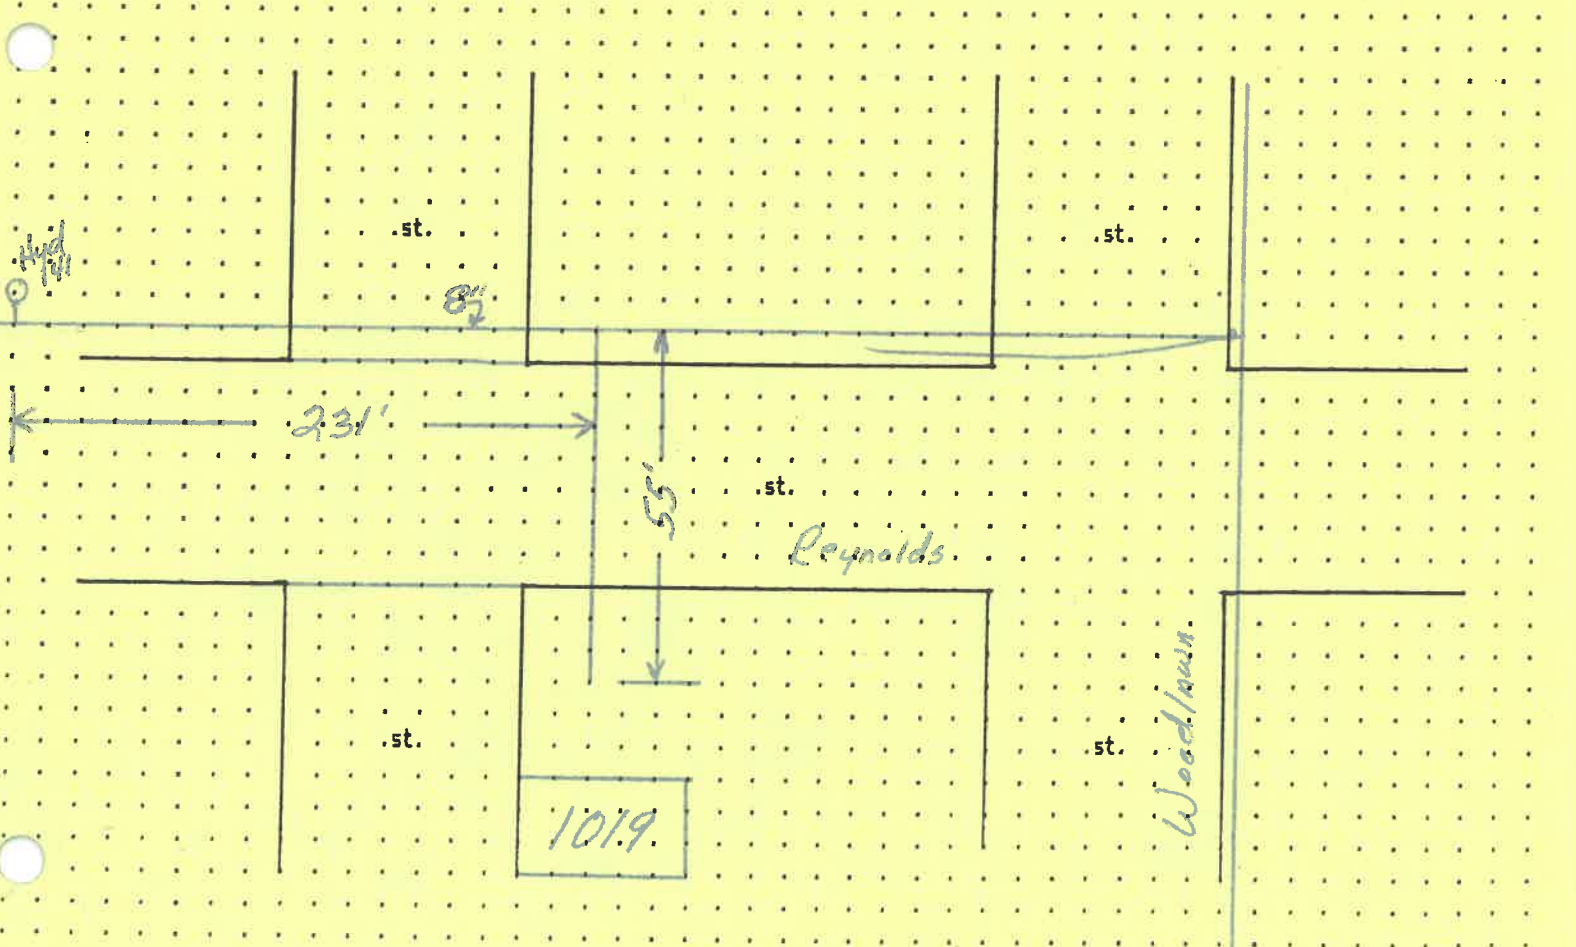

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0173 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by *Jeffrey S. ...* water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 8-5-97 Street and No. 1019 Reynolds

Old Tap No. 3734 New Tap No. 9739 Size and Kind of Main 8" C-900

Location of Main 10' East of East Curb Depth of Main 5'

Distance from Hydrant/Valve 231' South of Hyd 141 Distance to Curb Stop from Corp. 55'

