

**WATER TAPPING PERMIT**  
 issued by  
**The Napoleon Water Distribution Department**  
 255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010


Permit No. W-0218 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_) .00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ " Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Jeffrey R. Mantel  
 water distribution dept. \_\_\_\_\_ finance director

Name \_\_\_\_\_ Size of tap 1" Date 3-14-96 Street and No. 1069 Reynolds  
 Old Tap No. 553 New Tap No. 9617 Size and Kind of Main 4" CIP  
 Location of Main 6' West of West pavement edge Depth of Main 4 1/2'  
 Distance from Hydrant/Valve 86' South of Valve #140 Distance to Curb Stop from Corp. 12'

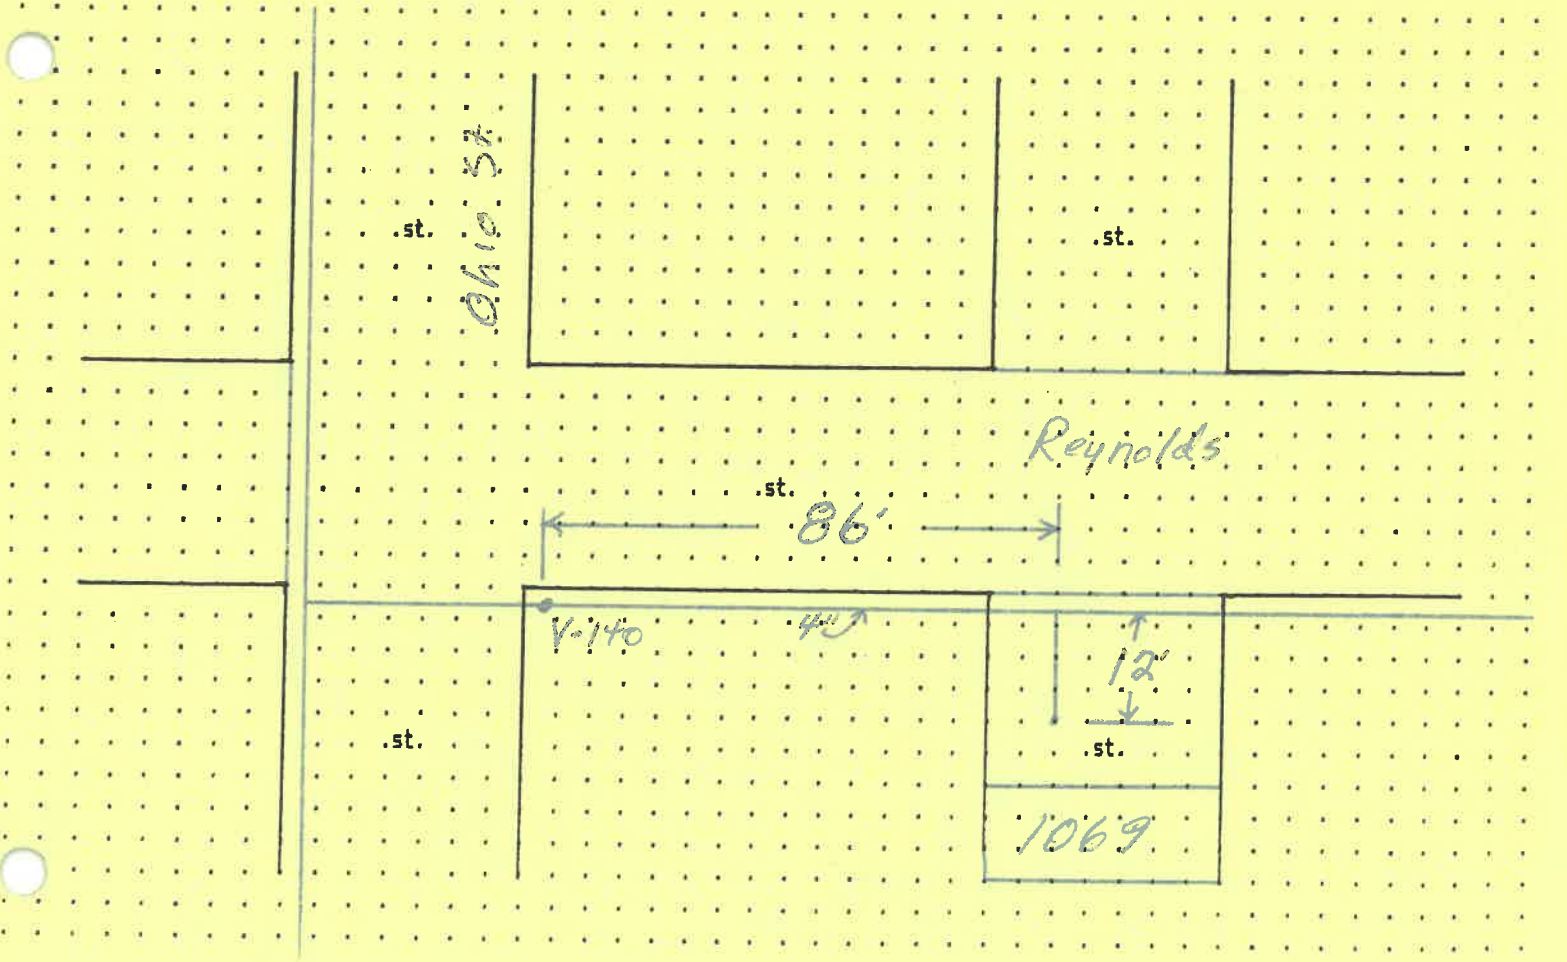

**WATER TAPPING PERMIT**  
 issued by  
**The Napoleon Water Distribution Department**  
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

COMPLETED

Permit No. W- 0218 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_


Date completed \_\_\_\_\_ Approved by Jeffrey E. Mankel water distribution dept. \_\_\_\_\_ finance director

Name \_\_\_\_\_ Size of tap 1" Date 3-14-96 Street and No. 1069 Reynolds

Old Tap No. 553 New Tap No. 9617 Size and Kind of Main 4" CIP

Location of Main 6' West of West pavement edge Depth of Main 4 1/2'

Distance from Hydrant/Valve 86' South of Valve #140 Distance to Curb Stop from Corp. 12'

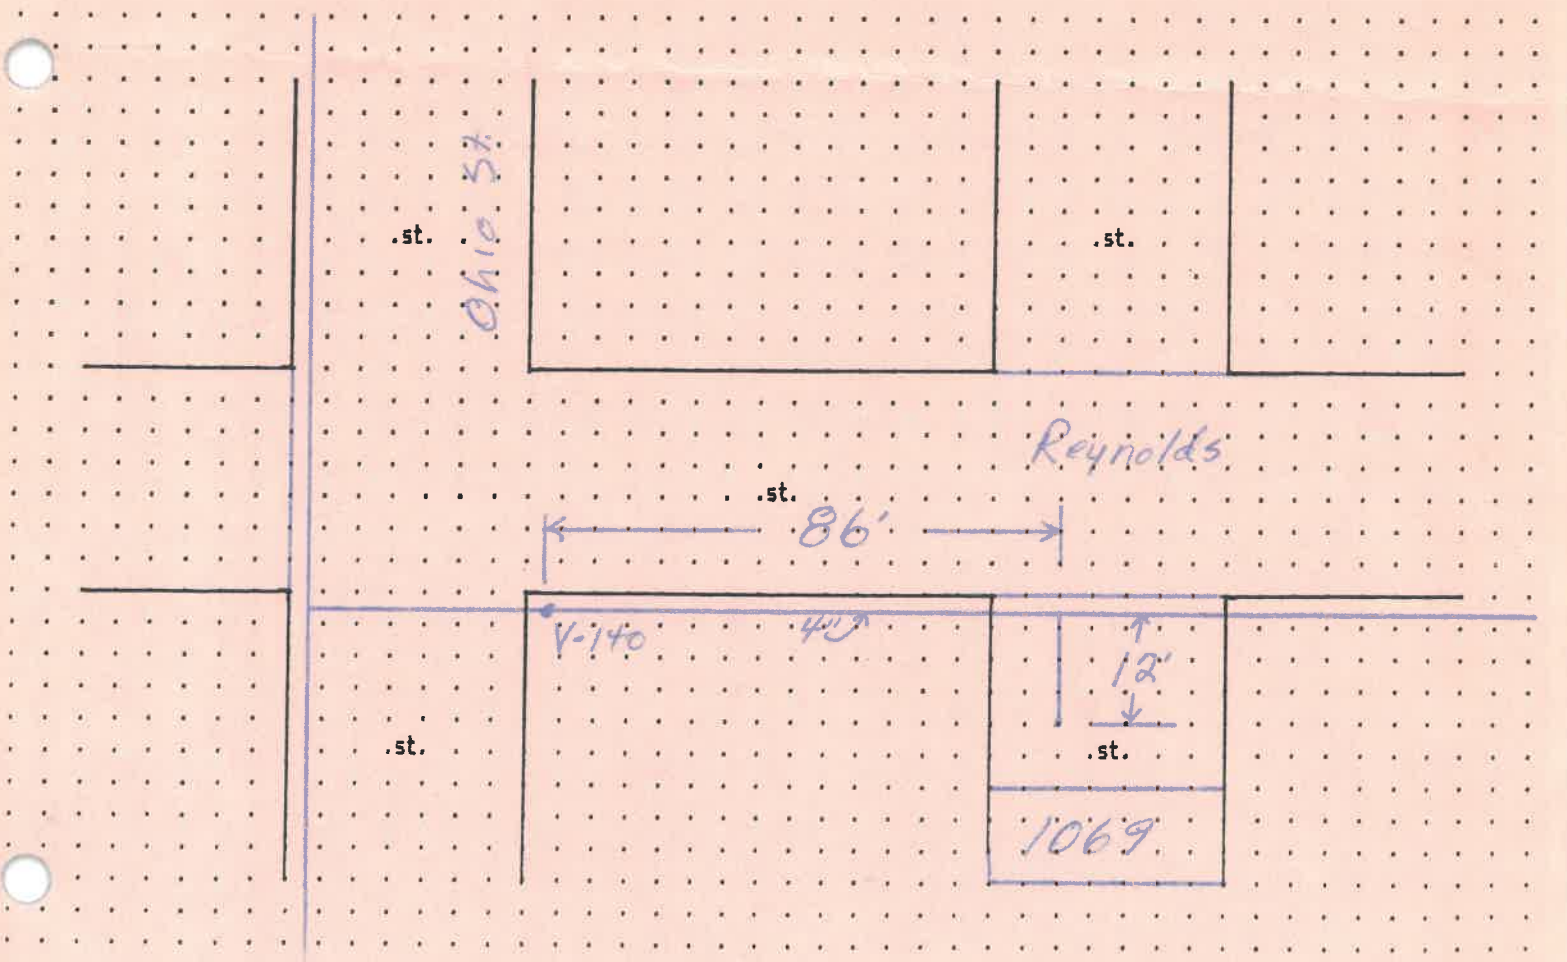

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0165 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ \* Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_


Date completed \_\_\_\_\_ Approved by Jeffrey E. Mantel water distribution dept. \_\_\_\_\_ finance director

Name \_\_\_\_\_ Size of tap 1" Date 8-6-97 Street and No. 1069 Reynolds

Old Tap No. 9617 New Tap No. 9743 Size and Kind of Main 8" C-900

Location of Main 3' West of East CORP Depth of Main 5 1/2'

Distance from Hydrant/Valve 282' North of Hyd 141 Distance to Curb Stop from Corp. 52'

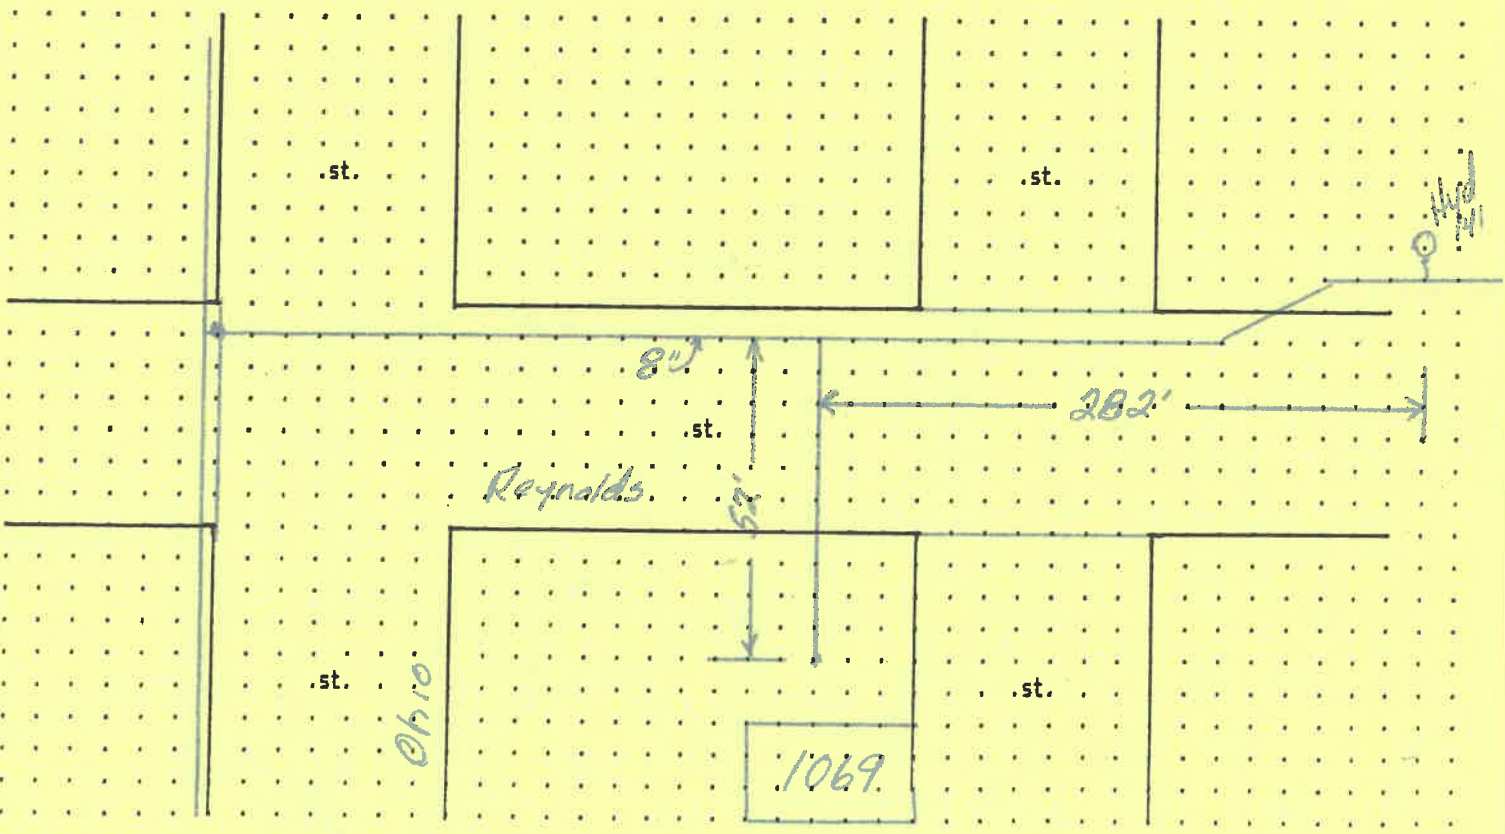

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0165 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_) .00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ " Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Jeffrey P. Mouton water distribution dept. \_\_\_\_\_ finance director

Name \_\_\_\_\_ Size of tap 1" Date 8-6-97 Street and No. 1069 Reynolds

Old Tap No. 9617 New Tap No. 9743 Size and Kind of Main 8" C-900

Location of Main 3' West of East CURB Depth of Main 5 1/2'

Distance from Hydrant/Valve 282' North of Hyd 141 Distance to Curb Stop from Corp. 52'

