

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

Permit No. 0971 Date Feb. 7, 1985
Job Location 375 EAST RIVERVIEW Valuation \$ 1700.00
Address
Owner United Telephone Service Address 375 E. Riverview
Name
Contractor _____ Telephone No. _____
Address _____
Electric Contractor OK Electric 214 Vine, WASSEON, Ohio
Plumbing Contractor _____
Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential _____ Commercial _____ Industrial XXXXXX
No. dwelling units
New Construction _____ Addition _____ Remodel XXXXX
Brief Description of Work Install twelve receptacles with GFCI, along Top Of
fence on side and front lot lines. Total load 1500 Watts per receptacle

ISSUED BY Richard G. Hayman DEPT. OF BUILDING & ZONING
Building Official

It is the owners or contractors responsibility to call the Building Department for the following (X) inspections:

- _____ Footing excavation prior to placing concrete.
- _____ Footing drains and foundation prior to backfill.
- _____ Prepared sub-grade prior to placing concrete floor slab.
- _____ Sanitary sewer
- XXXXX Rough-in electrical, plumbing and service framing prior to installing wall board.
- XXXXX Final electrical, plumbing and heating.
- XXXX Final building inspection, prior to occupancy.

Building Permit	\$ _____
Electrical Permit	\$ <u>35.00</u>
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demolition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other _____	\$ _____
TOTAL FEES	\$ <u>35.00</u>
LESS FEES PAID	\$ <u>-0-</u>
BALANCE DUE	\$ <u>35.00</u>

PERMIT & FEES
CITY OF NAPOLEON

PAID
FEB -7 1985

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

Permit No. 0271 Date Feb. 7, 1983
Job Location 375 EAST RIVERVIEW Valuation \$ 1700.00
Address
Owner United Telephone Service Address 375 S. Riverview
Name
Contractor _____ Telephone No. _____
Address _____
Electric Contractor OK Electric 214 Vine, WASSBON, Ohio
Plumbing Contractor _____
Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential Commercial Industrial XXXXX
No. dwelling units
New Construction Addition Remodel XXXXX
Brief Description of Work Install twelve receptacles with GFCI, along Top Of
fence on side and front lot lines. Total load 1500 Watts per receptacle

ISSUED BY _____ DEPT. OF BUILDING & ZONING
Building Official

It is the owners or contractors responsibility to call the Building Department for the following (X) inspections:

- _____ Footing excavation prior to placing concrete.
- _____ Footing drains and foundation prior to backfill.
- _____ Prepared sub-grade prior to placing concrete floor slab.
- _____ Sanitary sewer
- XXXXX _____ Rough-in electrical, plumbing and service framing prior to installing wall board.
- XXXXX _____ Final electrical, plumbing and heating.
- XXXX _____ Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit	\$ _____
Electrical Permit	\$ <u>35.00</u>
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demolition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other _____	\$ _____
TOTAL FEES	\$ <u>35.00</u>
LESS FEES PAID	\$ <u>-0-</u>
BALANCE DUE	\$ <u>35.00</u>

PAID
FEB - 7 1983
CITY OF NAPOLEON

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

INSPECTION RECORD

UNDERGROUND			ROUGH-IN &			FINAL		
Type	Date	By	Type	Date	By	Type	Date	By
PLUMBING	Sewer Connection		Drainage, W. & Vent			Drainage, W. & Vent		
	Building Sewer		Water Piping			Water Heater		
	Water Piping		Condensate Lines			Backflow Prevention		
			Indirect Waste					
ELECTRICAL	Floor Ducts Raceways		Rough Wiring			FINAL APPROVAL		
	Conduits & Cable		Conduits/Cable			Electric Mir. Clearance		
	Grounding & Bonding		Service Panel Switchboard			Signs		
			Subpanels					
			<input type="checkbox"/> Range <input type="checkbox"/> Dryer			FINAL APPROVAL		
			Refrigerant Piping			Duct Insulation		
MECHANICAL	Ducts/Plenums		Ducts/Plenums			Chimney(s)		
			Ventilation <input type="checkbox"/> Supply <input type="checkbox"/> Exhst.			Furnace(s)		
			Wall Construction			FINAL APPROVAL		
	Location, Set-backs, Esmt(s)		Crawl Space <input type="checkbox"/> Vent <input type="checkbox"/> Access			Fireplace Chimney		
BUILDING	Excavation		Floor System(s)			Attic <input type="checkbox"/> Vent <input type="checkbox"/> Access		
	Footings & Reinforcing		Roof System			Special Insp Reports Rec'd		
	Sub-soil Drain		Fire Wall(s)			Smoke Detector		
	Foundation Walls		Roof Cover			Demolition (sewer cap)		
	Floor Slab		Roof Drain			Building or Structure		
FINAL APPROVAL BLDG. DEPT		Certificate of Occupancy Issued		#				

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(Please print or type)

The undersigned hereby makes application for installation or replacement of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Codes.

Owner's Name United Telephone Service Address 375 E. Riverview

Electrical Contractor O.K. Electric Inc. Telephone No. 419-335-2957

Address 375 E. Riverview Napoleon, Ohio 42181

General Contractor _____ Telephone No. _____

Address _____

Location of Project 375 E. RIVERVIEW Cost of Project \$1700.00

Work Information:

Residential _____ Commercial _____ Industrial X

No. Units _____

New _____ Service Change _____ Rewiring _____ Additional Wiring X

Brief Description of Work: Add 8rd fault Rec. for Truck

Engine Warming

Size of proposed service entrance 100 Amp Number of new circuits 12

Type of proposed service entrance _____ Underground _____ Overhead _____

Require Temporary Electric _____ (Yes or No)

Total Floor Area - Commercial and Industrial only _____ sq. ft.


Additional Information: _____

PERMIT NO. 971
PERMIT FEE \$ 35.00

*Ground fault circuit interrupter protection is required on all 120-volt single phase, 15 and 20 amp. Circuits which are part of a temporary electric service: and also on bathroom, outdoor, and garage receptacles in all dwelling units. Art. 220-8 N.E.C.

*Application for permit shall be accompanied by two complete sets of plans including: Electrical layout and riser diagram. (For commercial and industrial work only).

Date 2/7/85 Applicant's Signature Mark Kraus

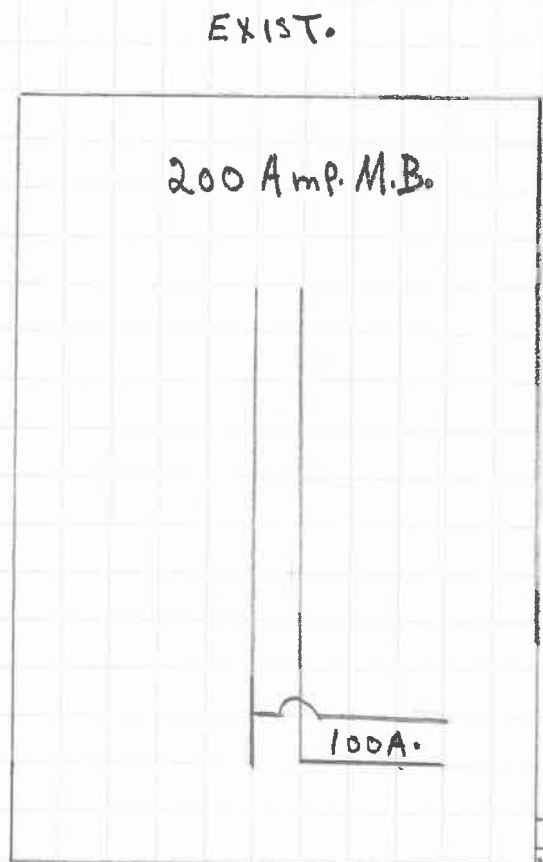


100 M.L.B.

7	20	20	1
8	20	20	2
9	20	20	3
10	20	20	4
11	20	20	5
12	20	20	6

3-#2-Cu
1/4 cond.

- 6-#12Cu
1/2" cond.
- Circ. 9
- 5-#12Cu
1/2" cond.
- Circ. 10
- 3-#12Cu
1/2" cond.
- Circ. 11
- 2-#12Cu
1/2" cond.
- Circ. 12

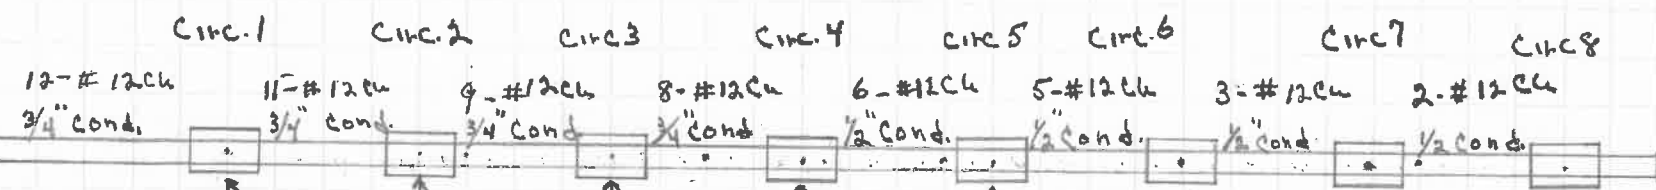

8-#12 Fault 120V. Duplex + Recs. (Typical)

Load - 1500 watts - 120 volt Each Duplex

L.T.S. Napoleon, Ohio
375 E. Riverside

