

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W- 0240 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey E. Montague
 water distribution dept. _____ finance director

Name Anthony Wayne Rest. Size of tap 3/4" Date 7-18-96 Street and No. 601 E. Riverview

Old Tap No. 2857 New Tap No. 9654 Size and Kind of Main 12" AC

Location of Main 2' North of North pavement edge Depth of Main 5'

Distance from Hydrant/Valve 128' West of Hyd 383 Distance to Curb Stop from Corp. stop to stop 54'
2'

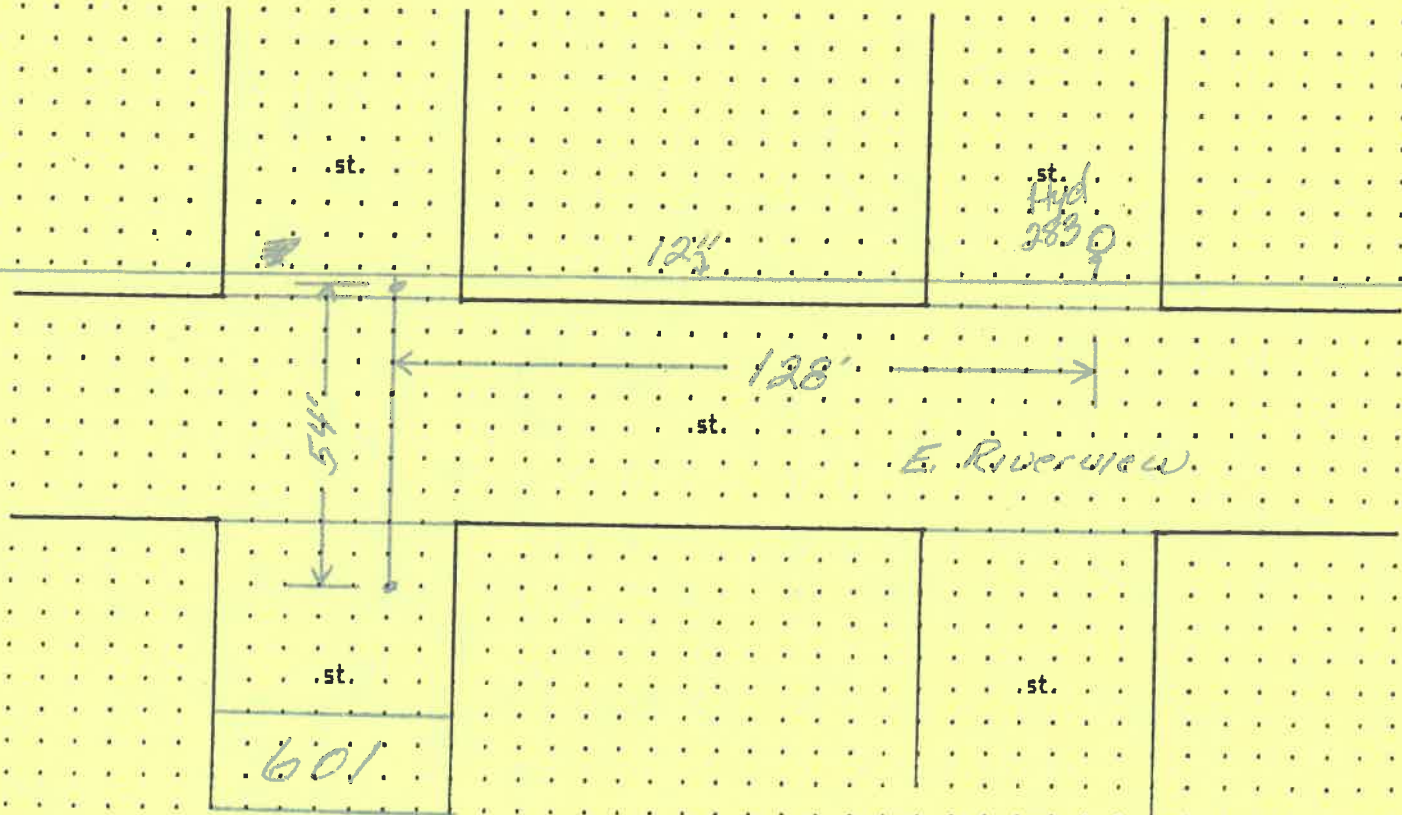

WATER TAPPING PERMIT
 issued by
The Napoleon Water Distribution Department
 255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0240 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Henry E. Montague water distribution dept. _____ finance director

Name Anthony Wayne Rest Size of tap 3/4" Date 7-18-96 Street and No. 601 E. Riverview

Old Tap No. 2857 New Tap No. 9654 Size and Kind of Main 12" AC

Location of Main 2' North of North pavement edge Depth of Main 5'

Distance from Hydrant/Valve 128' West of Hyd #283 Distance to Curb Stop from Corp. step to step 54'
2'

