

PERMIT

CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

Permit No. 292 Date July 6, 1981
Job Location Riverview & Haley, Napoleon, Ohio Valuation \$ 2,000.00
Owner City of Napoleon/Blue Jacket Ind. Address _____
Contractor Bartel's Electric Telephone No. 533-3421
Address 508 East St., Liberty Center, Ohio 43532
Electric Contractor _____
Plumbing Contractor 570 W. Riverview Ave
Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:

Residential _____ Commercial _____ Industrial X
New Construction _____ Addition _____ Remodel X
Brief Description of Work _____

ISSUED BY Richard A. Hayman DEPT. OF BUILDING & ZONING
Building Official

It is the owners or contractors responsibility to call the Building Department for the following (X) inspections:

- Footing excavation prior to placing concrete.
- Footing drains and foundation prior to backfill.
- Prepared sub-grade prior to placing concrete floor slab.
- Sanitary sewer
- Rough-in electrical, plumbing and service framing prior to installing wall board.
- Final electrical, plumbing and heating.
- Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit	\$ _____
Electrical Permit	\$ <u>18.00</u>
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demolition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other	\$ _____

TOTAL FEES \$ 18.00
LESS FEES PAID \$ -0- **PAID**
BALANCE DUE \$ 18.00 **JUL 7 1981**

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

CITY OF NAPOLEON

PERMIT
CITY OF NAPOLEON, OHIO — DEPT. OF BUILDING & ZONING
255 W. Riverview Avenue, Napoleon, Ohio 43545 (419) 592-4010

Permit No. 232 Date July 6, 1981
 Job Location Riverview & Haley, Napoleon, Ohio Valuation \$ 2,000.00
 Owner City of Napoleon/Blue Jacket Ind. Address _____
 Contractor Bartel's Electric Name _____ Address _____
 Telephone No. 533-3421
 Address 508 East St., Liberty Center, Ohio 43532
 Electric Contractor _____
 Plumbing Contractor 510 1/2 W. W. Ave
 Mechanical Contractor _____

This permit is issued for work described in the plans, specifications, and/or application submitted, as approved by the Building Commissioner of the City of Napoleon, Ohio. Work shall conform to all pertinent construction and land use Codes and Ordinances.

Work Information:
 Residential _____ No. dwelling units _____ Commercial _____ Industrial X
 New Construction _____ Addition _____ Remodel X
 Brief Description of Work _____

ISSUED BY _____ Building Official _____ DEPT. OF BUILDING & ZONING

It is the owners or contractors responsibility to call the Building Department for the following (x) inspections:

- _____ Footing excavation prior to placing concrete.
- _____ Footing drains and foundation prior to backfill.
- _____ Prepared sub-grade prior to placing concrete floor slab.
- X Sanitary sewer
- X Rough-in electrical, plumbing and service framing prior to installing wall board.
- X Final electrical, plumbing and heating.
- _____ Final building inspection, prior to occupancy.

PERMIT & FEES

Building Permit	\$ _____
Electrical Permit	\$ <u>18.00</u>
Plumbing Permit	\$ _____
Mechanical Permit	\$ _____
Demoition Permit	\$ _____
Zoning Permit	\$ _____
Sign Permit	\$ _____
Water Tap	\$ _____
Sewer Tap	\$ _____
Temp. Elec.	\$ _____
Other _____	\$ _____

TOTAL FEES \$ 18.00
 LESS FEES PAID \$ -00 **JUL 7 1981**
 BALANCE DUE \$ 18.00
 CITY OF NAPOLEON

Permit is not valid until all fees are paid in full, and shall be void if work is not started within six months of date above.

INSPECTION RECORD

UNDERGROUND		ROUGH-IN &			FINAL	
Type	Date	By	Type	Date	By	Date
PLUMBING	Sewer Connection		Drainage, W. & Vent			Drainage, W. & Vent
	Building Sewer Piping		Water Piping			Water Heater
	Water Piping		Condensate Lines			Backflow Prevention
			Indirect Waste			
ELECTRICAL	Floor Ducts Raceways		Rough Wiring			FINAL APPROVAL
	Conduits & or Cable		Conduits/ Cable			Electric Mtr. Clearance
	Grounding & or Bonding		Service Panel Switchboard			Signs
			Subpanels			
MECHANICAL	Refrigerant Piping		Refrigerant Piping			FINAL APPROVAL
	Ducts/ Plenums		Ducts/ Plenums			Duct Insulation
			Ventilation Supply			Chimney(s)
			Exhst.			Furnace(s)
BUILDING	Location, Set-backs, Esmt(s)		Wall Construction			FINAL APPROVAL
	Excavation		Crawl Space Vent Access			Fireplace Chimney
	Footings & Reinforcing		Floor System(s)			Attic Vent Access
	Sub-soil Drain		Roof System			Special Insp Reports Rec'd
	Foundation Walls		Fire Wall(s)			Smoke Detector
	Floor Slab		Roof Cover Roof Drain			Demolition (sewer cap)
						Building or Structure
FINAL APPROVAL BLDG. DEPT		1/19/88	Certificate of Occupancy Issued		#	

CITY OF NAPOLEON
BUILDING INSPECTION DEPARTMENT
APPLICATION FOR ELECTRICAL PERMIT
(Please print or type)

I, undersigned hereby makes application for installation of electrical equipment as herein specified, agreeing to do all replacement of electrical work in strict accordance with the City of Napoleon's adopted Electrical Codes.

Owner's Name BLUE JACKET INDUSTRIES Address NAPOLEON, OHIO

Electrical Contractor BARTER'S ELECTRIC Telephone No. 533-340

Address 508 EAST ST LIBERTY CENTER, OHIO 43532

General Contractor _____ Telephone No. _____

Address _____

Location of Project RIVERVIEW Cost of Project 2,000

Work Information:

Residential _____ Commercial _____ Industrial X

New X Service Change _____ Rewiring _____ Additional Wiring _____

Brief Description of Work: NEW 3 PHASE SERVICE 240V

FEED PRESENT 1 ϕ PANEL 100A

Size of proposed service entrance 200A Number of new circuits (6) - 3 ϕ

Type of proposed service entrance _____ Underground _____ Overhead X

Require Temporary Electric NO (Yes or No)

Total Floor Area - Commercial and Industrial only 3150 sq. ft.

Additional Information: _____


*Ground fault circuit interrupter protection is required on all 120-volt single phase, 15 and 20 amp. Circuits which are part of a temporary electric service; and also on bathroom, outdoor, and garage receptacles in all dwelling units. Art. 210-8 N.E.C.

*Application for permit shall be accompanied by two complete sets of plans including: Electrical layout and riser diagram. (For commercial and industrial work only).

Date 7-2-81


Applicant's Signature J. D. Swanson

NO. 292
1800

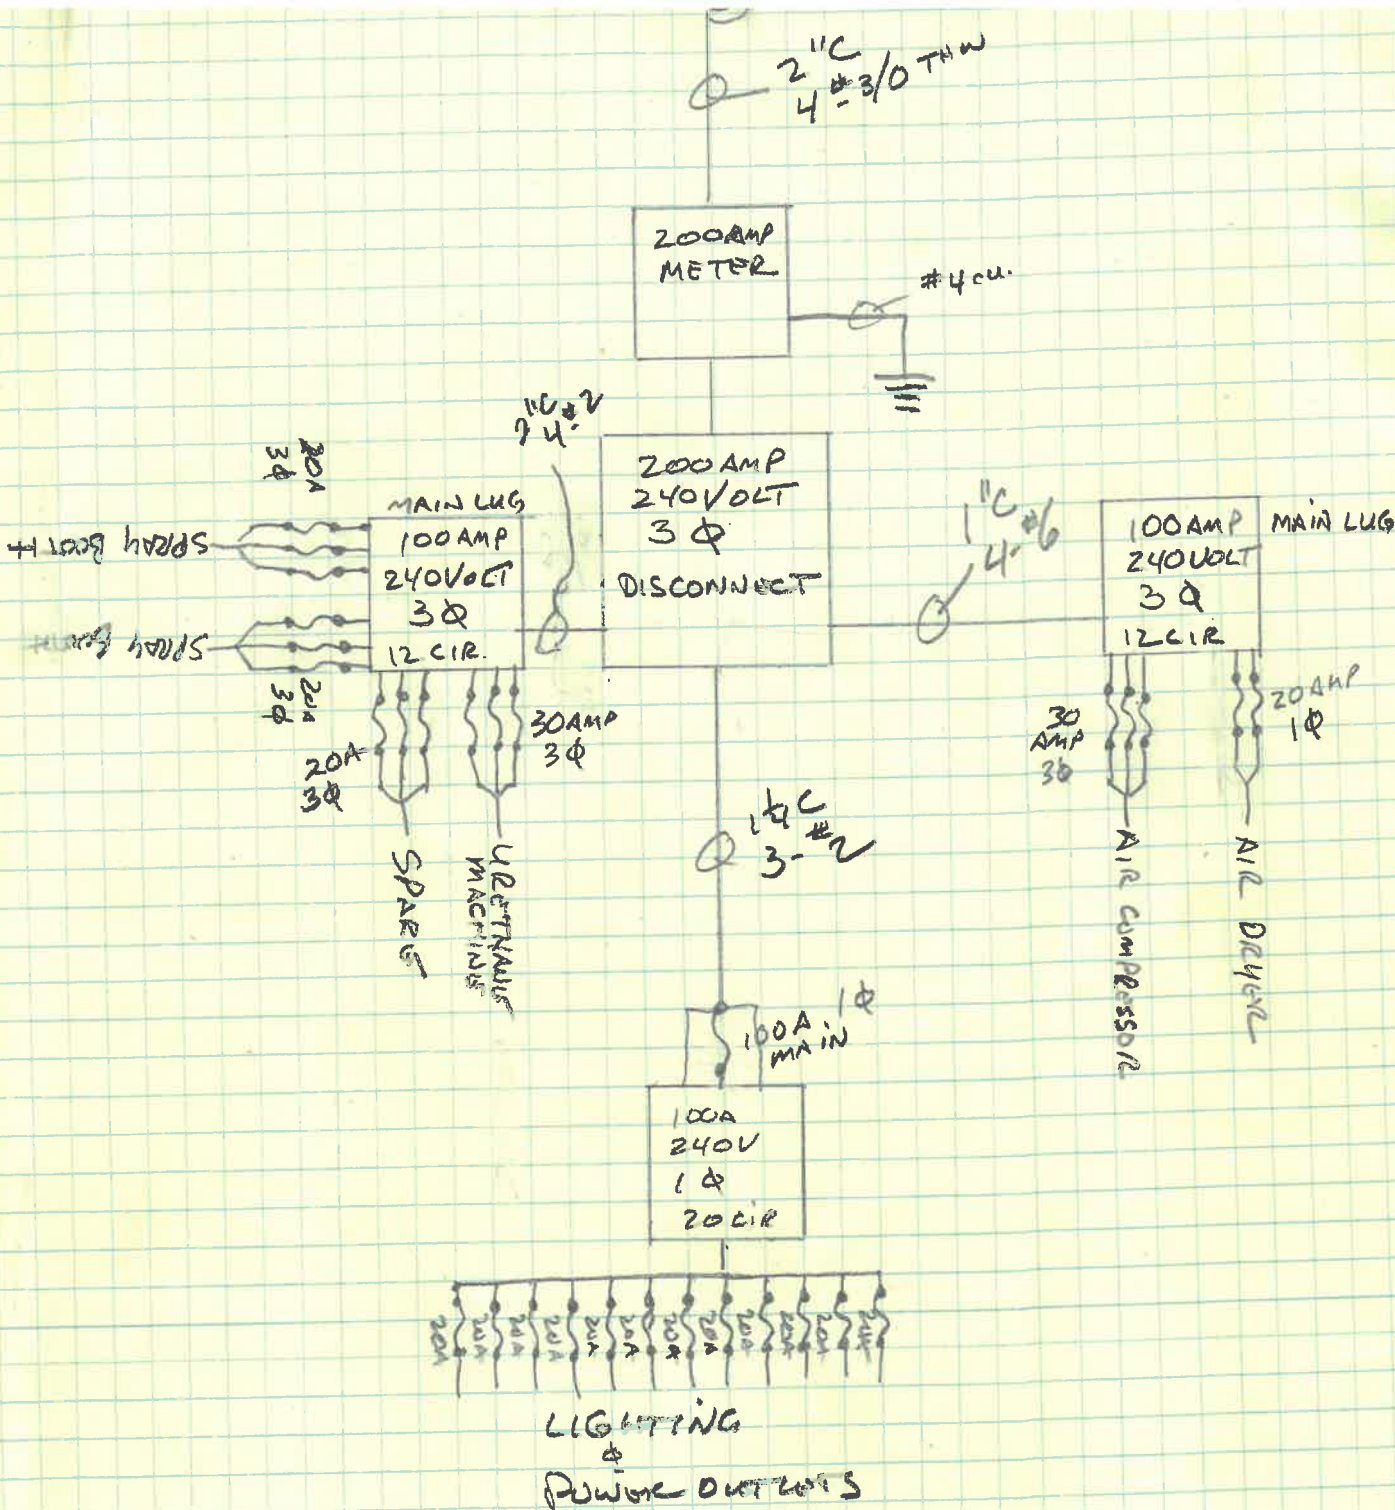

BLUE JACKET INDUSTRIES, INC.
 RIVERVIEW, ST
 NA POLEON, OHIO

 ELECTRICAL RISE &
 DRAWING
 BAETELS ELECTRIC
 LIBERTY CENTER, OHIO

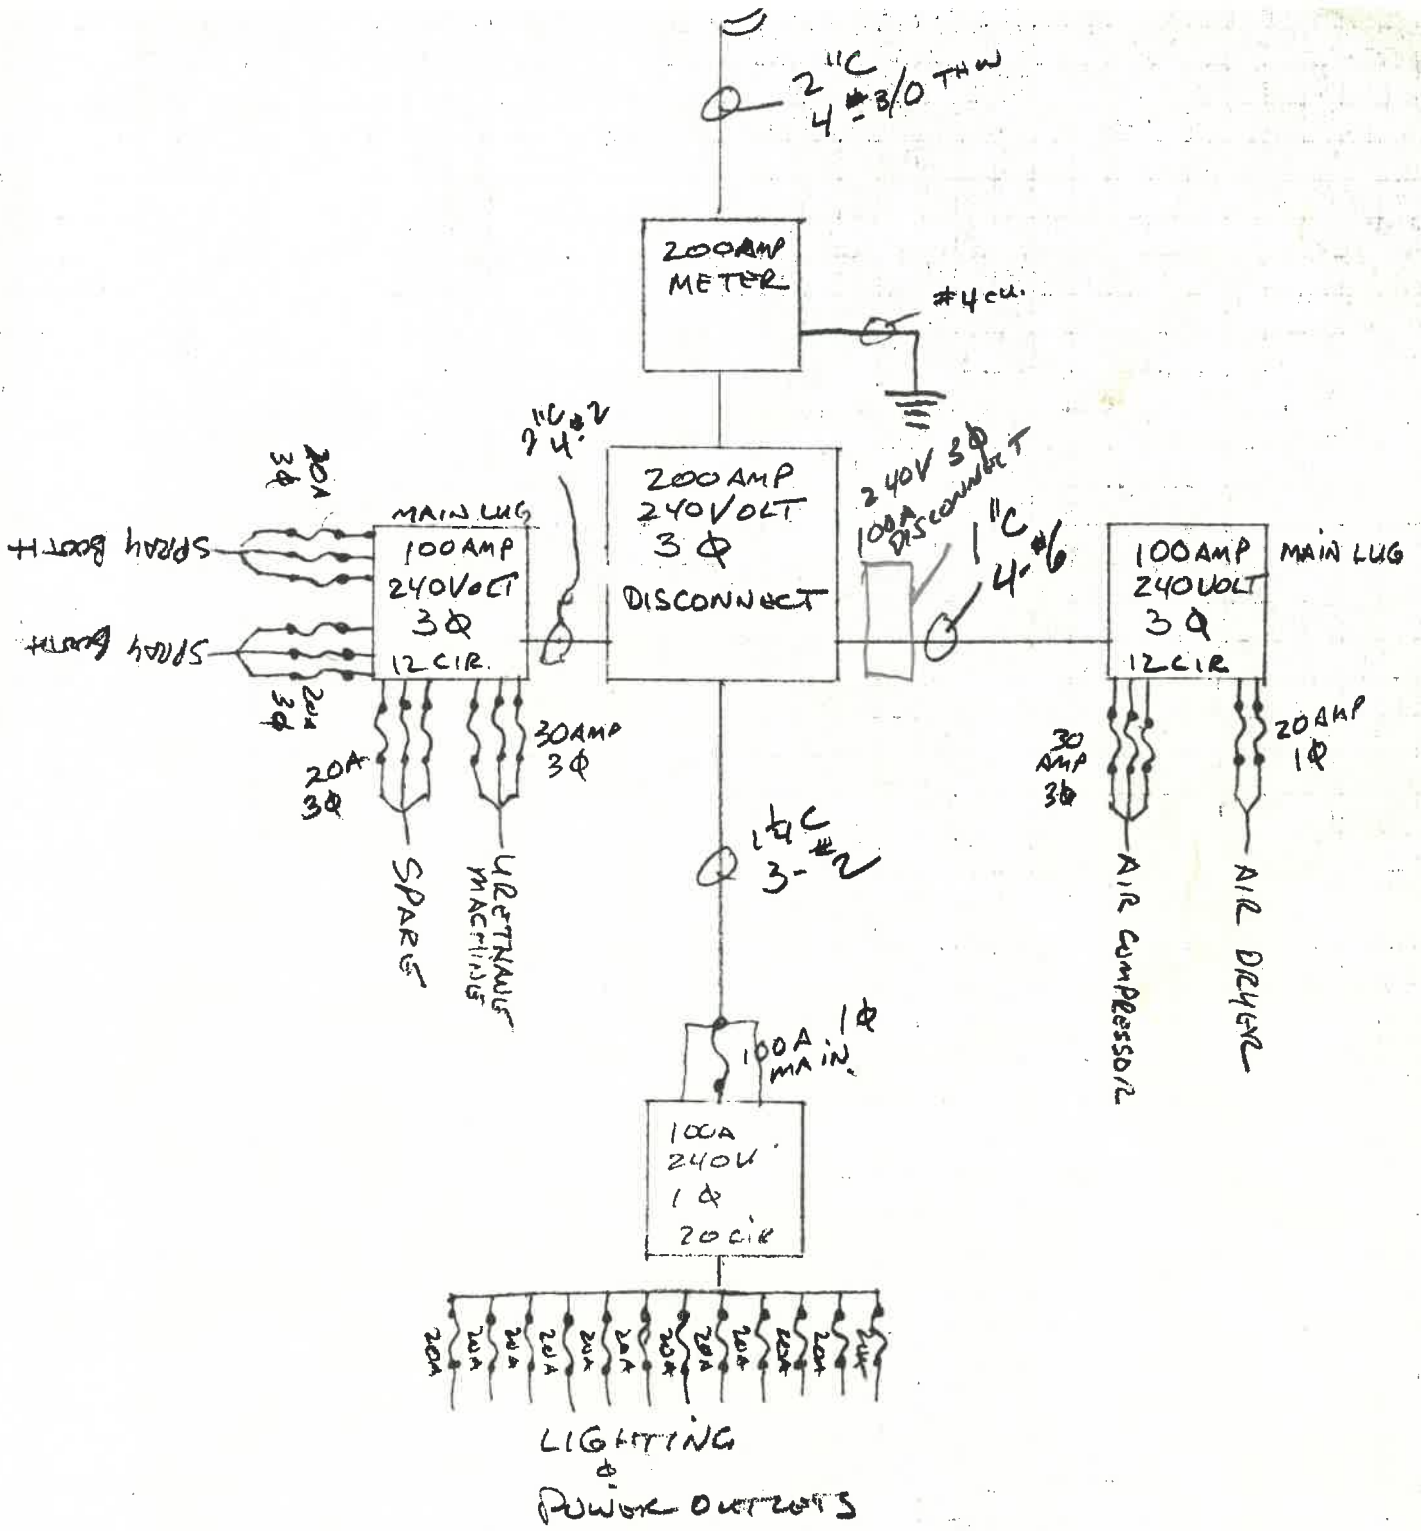

BLUE JACKET INDUSTRIES IN
 RIVERVIEW, ST
 NAPOLEON, OHIO

ELECTRICAL RISCOR
 DRAWING

BAITERS ELECTRIC
 13601 CENTER, OHIO

