

WATER TAPPING PERMIT  
 issued by  
 The Napoleon Water Distribution Department  
 255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

655 W. Riverview


Permit No. W-0238 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ \* Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Jeffrey E. Maitland  
 water distribution dept. finance director

Name Fountain @ Entrance Boat Ramp Size of tap 1 1/2" Date 7-22-96 Street and No. W. Riverview  
 Old Tap No. \_\_\_\_\_ New Tap No. 9649 Size and Kind of Main 10" DIP  
 Location of Main South edge of pavement Depth of Main 6"  
 Distance from Hydrant/Valve 193' EAST of Hyd 334 Distance to Curb Stop from Corp. 6'  
 Hyd 334

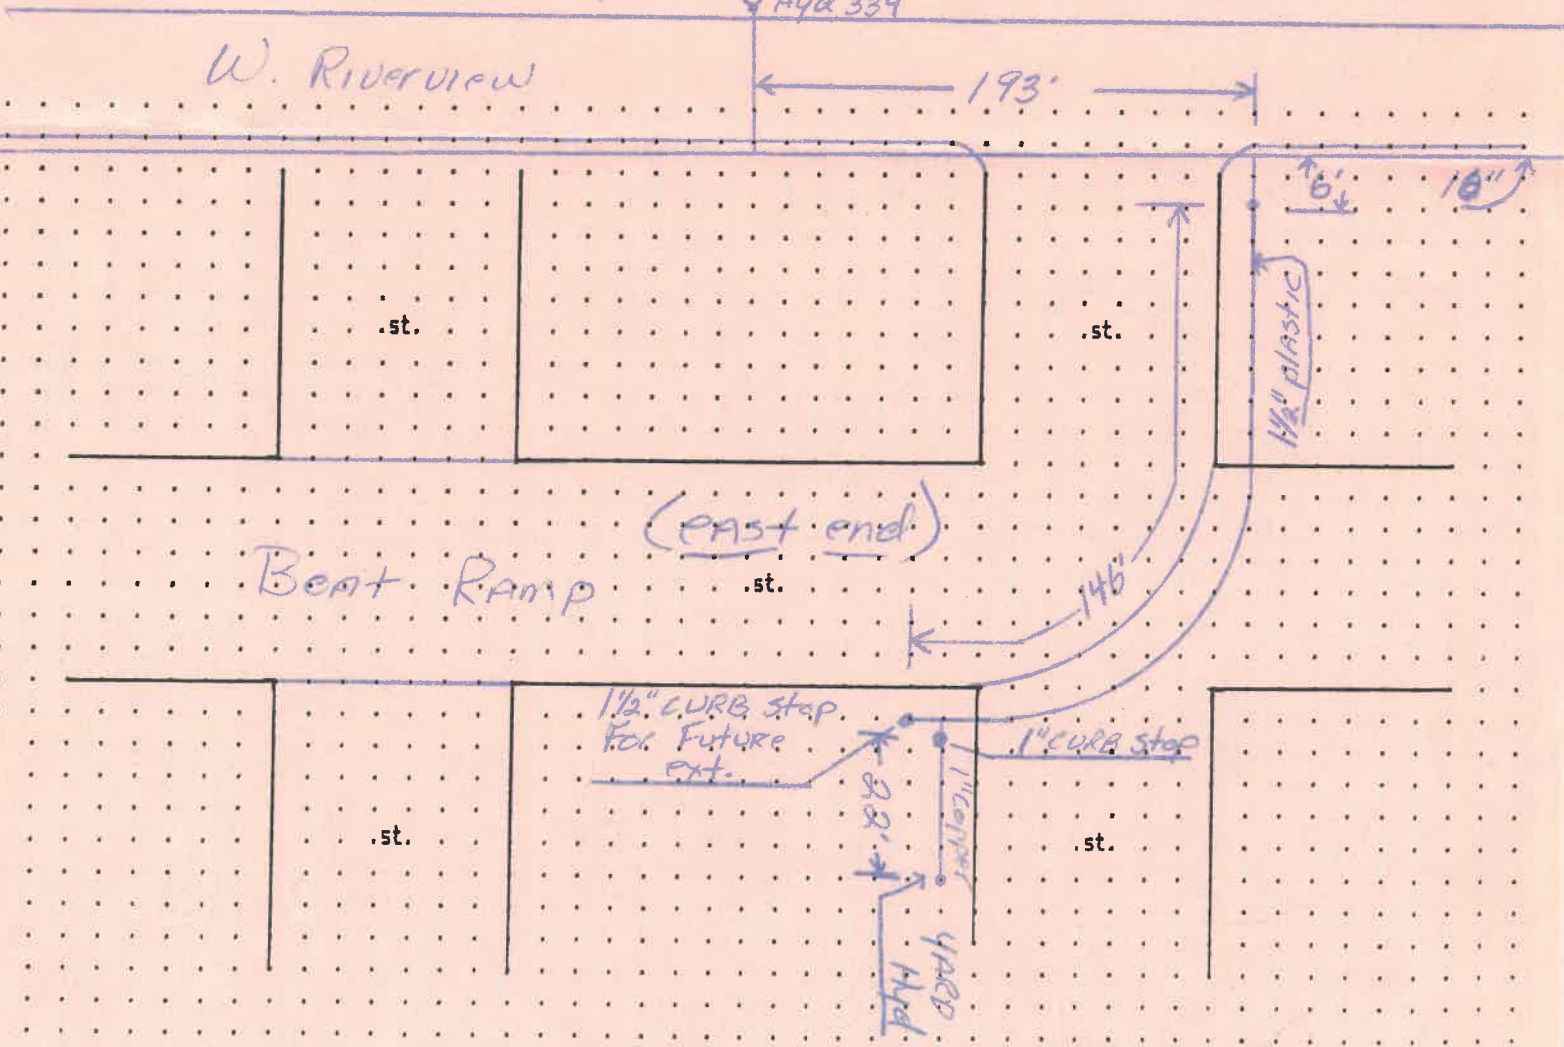

**WATER TAPPING PERMIT**  
 issued by  
**The Napoleon Water Distribution Department**  
 255 West Riverview Ave. Napoleon, Ohio 43345 Ph. 592-4010

Permit No. W-0238 Issued \_\_\_\_\_ Received of \_\_\_\_\_ (\$ \_\_\_\_\_).00

(Charge for tapping permit to supply water service to) Lot No. \_\_\_\_\_ Sub Div. \_\_\_\_\_

Street No. \_\_\_\_\_ Tap Size \_\_\_\_\_ Cost \$ \_\_\_\_\_ .00 Plumber \_\_\_\_\_

Date completed \_\_\_\_\_ Approved by Jeffrey P. Moulton water distribution dept. finance director

Name Fountain Entrance Boat Ramp Size of tap 1 1/2" Date 7-22-96 Street and No. 655 W. Riverview

Old Tap No. \_\_\_\_\_ New Tap No. 9649 Size and Kind of Main 16" DIP

Location of Main South edge of pavement Depth of Main 6'

Distance from Hydrant/Valve 193' East of Hyd #334 Distance to Curb Stop from Corp. 6'

