

P E R M I T

CITY OF NAPOLEON
255 W. RIVERVIEW AVE
NAPOLEON, OHIO 43545

DIVISION OF BUILDING & ZONING
PH (419) 592-4010
FAX (419) 599-8393

PERMIT NO: 99013 DATE ISSUED: 01-20-99 ISSUED BY: BND

JOB LOCATION: 1475 SCOTT ST EST. COST:

LOT #: PT 1 SUBDIVISION NAME: DUNN & LYTLE

OWNER: LANGE & LYTLE OGP AGENT: SELF
ADDRESS: 1820 W RIVERVIEW AVE ADDRESS:
CSZ: NAPOLEON, OH 43545 CSZ:
PHONE: 419-592-4701 PHONE:

USE TYPE - RESIDENTIAL: OTHER:

ZONING INFORMATION

DIST: LOT DIM: AREA: FYRD: SYRD: RYRD:
MAX HT: # PKG SPACES: # LOADING SP: MAX LOT COV:

BOARD OF ZONING APPEALS:

WORK TYPE - NEW: REPLMNT: ADD'N: ALTER: REMODEL:

WORK INFORMATION

SIZE - LGTH: WIDTH: STORIES: LIVING AREA SF:
GARAGE AREA SF: HEIGHT: BLDG VOL DEMO PERMIT:

WORK DESCRIPTION

SEWER INSP & 1" WA TAP


FEE DESCRIPTION PAID DATE FEE AMOUNT DUE

SEWER INSPECTION PER 100.00
WATER TAP PERMIT 650.00

TOTAL FEES DUE 750.00

DATE

APPLICANT SIGNATURE

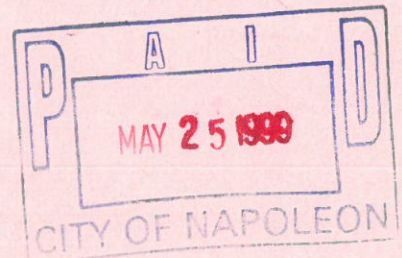

CITY OF NAPOLEON

WATER METER YOKE RELEASE FORM

THIS DOCUMENT ENTITLES THE HOLDER TO "ONE" WATER METER YOKE ASSEMBLY
(Please pickup at City Operations Department 1775 Industrial Drive).

PERMIT #: 99013

ISSUED: 01-20-99

JOB LOCATION: 1475 SCOTT ST

OWNER: LANGE & LYTLE OGP

PHONE: 419-592-4701

ADDRESS: 1820 W RIVERVIEW AVE NAPOLEON, OH 43545

CONTRACTOR: SELF

ADDRESS:

PHONE:

WATER TAP SIZE 1" 1.5" _____ 2" _____ OTHER _____

WATER METER YOKE SIZE 5/8" 3/4" _____ 1" _____ OTHER _____

NEW STRUCTURE EXISTING STRUCTURE _____ LAWN METER _____

WATER SERVICE LINE TO BE TYPE "K" COPPER OR "CTS" POLYETHELENE TUBING
OF 1" MINIMUM SIZE.

BACKFLOW DEVICE REQUIRED YES NO _____

TYPE OF BACKFLOW DEVICE REQUIRED Double check valve
assembly

WATER METER YOKE INSTALLATION IS SUBJECT TO THE FOLLOWING CONDITIONS

- 1.) MUST BE LOCATED IN AN ACCESSIBLE AREA.
- 2.) MUST BE IN AN AREA WHICH IS NOT SUBJECT TO FREEZING TEMPERATURES.
- 3.) MUST BE AT LEAST 18" ABOVE FLOOR LEVEL (NO CRAWL SPACE INSTALLATIONS).
- 4.) MUST COMPLY WITH MINIMUM MOUNTING REQUIREMENTS (DRAWING AVAILABLE)

ISSUED BY _____ RECEIVED BY _____

1-Copy to: Building Dept, Water Dept, and Utilities Dept

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #: 99013

ISSUED: 01-20-99

JOB LOCATION: 1475 SCOTT ST

SUBDIVISION NAME: _____ LOT #: _____

OWNER: LANGE & LYTLE OGP

ADDRESS: 1820 W RIVERVIEW AVE NAPOLEON, OH 43545

CONTRACTOR: SELF PHONE: _____

TAP SIZE: 1" X 1.5" _____ 2" _____ OTHER _____

AMOUNT PAID: 650.00 YOKE SIZE: 5/8"



PLUMBING CONTRACTOR: Dave Clapp PH: _____

DATE OF TAP: 6-24-99 OLD TAP #: - NEW TAP #: 9915

SIZE AND KIND OF MAIN: 16" DIP

LOCATION OF MAIN: 4' West of West curb DEPTH OF MAIN: 5 1/2'

DIST FROM HYDRANT VALVE: 177' N of Hyd¹⁹¹ DIST TO CURB STOP FROM CORP: 20'

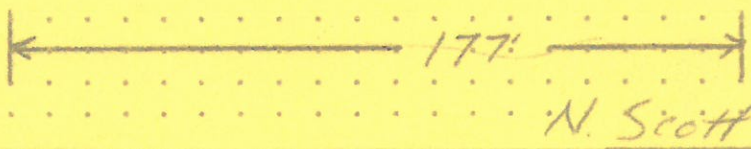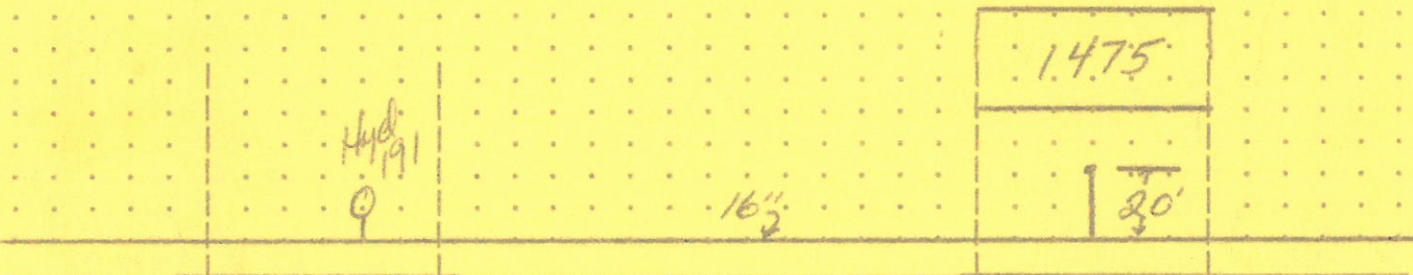

DATE APPROVED: Oct 29, 1999

BY: Jeffrey E. Mantel

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #: 99013

ISSUED: 01-20-99

JOB LOCATION: 1475 SCOTT ST

SUBDIVISION NAME: _____ LOT #: _____

OWNER: LANGE & LYTTLE OGP

ADDRESS: 1820 W RIVERVIEW AVE NAPOLEON, OH 43545

CONTRACTOR: SELF PHONE: _____

TAP SIZE: 1" X 1.5" _____ 2" _____ OTHER _____

AMOUNT PAID: 650.00 YOKE SIZE: 5/8"



PLUMBING CONTRACTOR: Dave Clopp PH: _____

DATE OF TAP: 6-24-99 OLD TAP #: - NEW TAP #: 9915

SIZE AND KIND OF MAIN: 16" DIP

LOCATION OF MAIN: 4' West of West curb DEPTH OF MAIN: 5 1/2'

DIST FROM HYDRANT ~~VALVE~~: 177' N of Hyd¹⁹¹ DIST TO CURB STOP FROM CORP: 20'

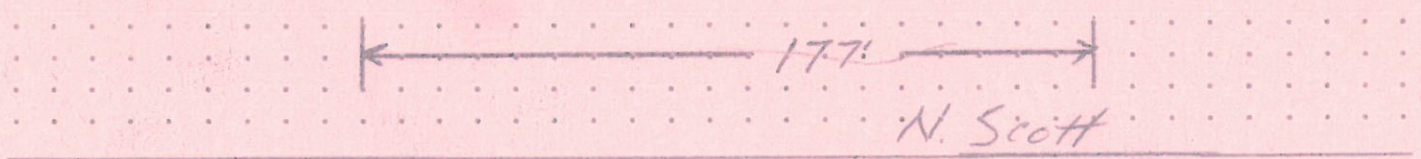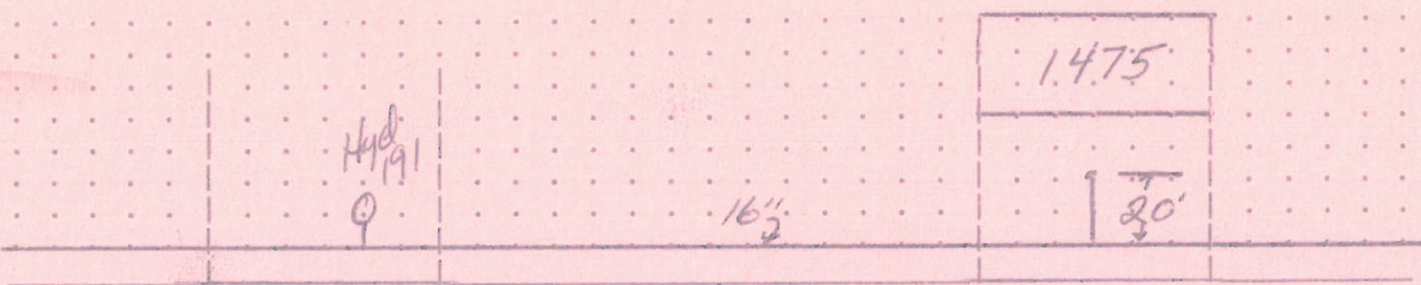

DATE APPROVED: Oct 29, 1999

BY: Ally E. Mantel