

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #:

ISSUED:

JOB LOCATION: \_\_\_\_\_

SUBDIVISION NAME: \_\_\_\_\_ LOT #: \_\_\_\_\_

OWNER: Macdonalds Restaurant

ADDRESS: 1805 Scott St

CONTRACTOR: \_\_\_\_\_ PHONE: \_\_\_\_\_

TAP SIZE: 1" \_\_\_\_\_ 1.5" \_\_\_\_\_ 2" \_\_\_\_\_ OTHER 4" Fire Tap

AMOUNT PAID: \_\_\_\_\_ YOKE SIZE: \_\_\_\_\_


PLUMBING CONTRACTOR: \_\_\_\_\_ PH: \_\_\_\_\_

DATE OF TAP: Dec. 2011 OLD TAP #: \_\_\_\_\_ NEW TAP #: \_\_\_\_\_

SIZE AND KIND OF MAIN: 16" DIP

LOCATION OF MAIN: West side of Scott, DEPTH OF MAIN: 6'

DIST FROM HYDRANT\VALVE: 110' 5" DIST TO CURB STOP FROM CORP: 2'

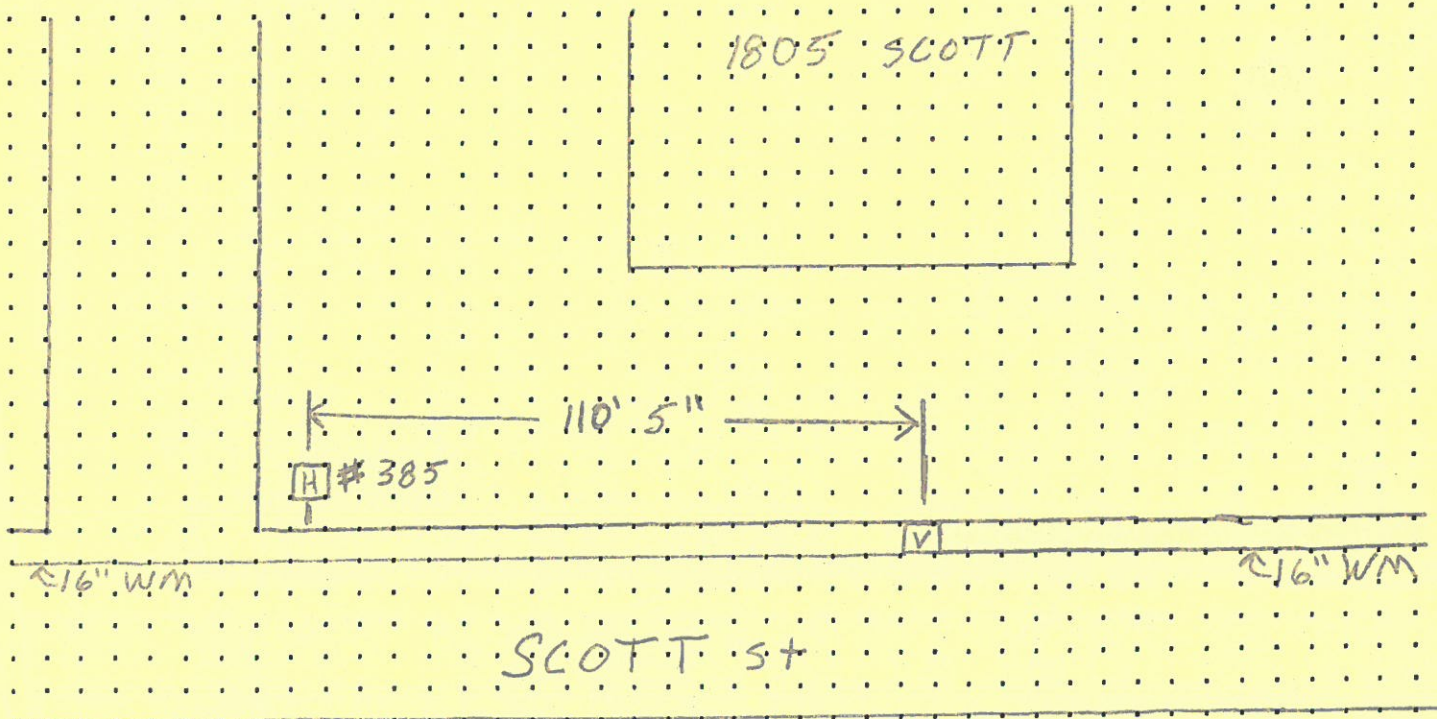

DATE APPROVED: 5-17-12 BY: Jeffrey W. [Signature]