

P E R M I T

CITY OF NAPOLEON
255 W. RIVERVIEW AVE
NAPOLEON, OHIO 43545

DIVISION OF BUILDING & ZONING
PH (419) 592-4010
FAX (419) 599-8393

PERMIT NO: 930 DATE ISSUED: 11-28-01 ISSUED BY: SKE

JOB LOCATION: 1835 SCOTT ST EST. COST:

LOT #: SUBDIVISION NAME:

OWNER: HERITAGE TOWN CENTER	AGENT: RD JONES EXCAVATING,
ADDRESS: 1835 SCOTT ST	ADDRESS: BOX 127
CSZ: NAPOLEON, OH 43545	CSZ: HARROD, OH 45850
PHONE:	PHONE: 419-648-5870

USE TYPE - RESIDENTIAL: OTHER:

ZONING INFORMATION

DIST:	LOT DIM:	AREA:	FYRD:	SYRD:	RYRD:
MAX HT:	# PKG SPACES:	# LOADING SP:	MAX LOT COV:		


BOARD OF ZONING APPEALS:

WORK TYPE - NEW: X REPLMNT: ADD'N: ALTER: REMODEL:

WORK INFORMATION

SIZE - LGTH:	WIDTH:	STORIES:	LIVING AREA SF:
GARAGE AREA SF:	HEIGHT:	BLDG VOL DEMO PERMIT:	

WORK DESCRIPTION
WATER METER SET

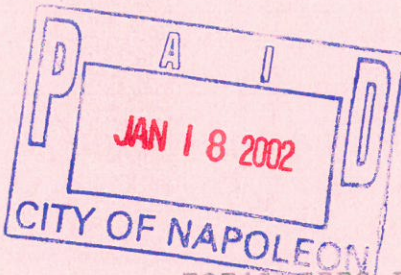FEE DESCRIPTION	PAID DATE	FEE AMOUNT DUE
WATER TAP PERMIT		198.00
		
TOTAL FEES DUE		198.00

DATE

APPLICANT SIGNATURE

CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #:

ISSUED:

JOB LOCATION: WAL-MART Super Center

SUBDIVISION NAME: Heritage Town Center LOT #: _____

OWNER: FAMOUS HAIR Bldg #2

ADDRESS: 1835 Scott St.

CONTRACTOR:

PHONE:

TAP SIZE: 1" X 1.5" _____ 2" _____ OTHER _____

AMOUNT PAID: _____ YOKE SIZE: _____


PLUMBING CONTRACTOR: _____ PH: _____

DATE OF TAP: 11-12-01 OLD TAP #: _____ NEW TAP #: 0197

SIZE AND KIND OF MAIN: 4" C-900

LOCATION OF MAIN: West edge of bldg DEPTH OF MAIN: 5'

DIST FROM HYDRANT\VALVE: 329' S of 4" VALVE DIST TO CURB STOP FROM CORP: 4'

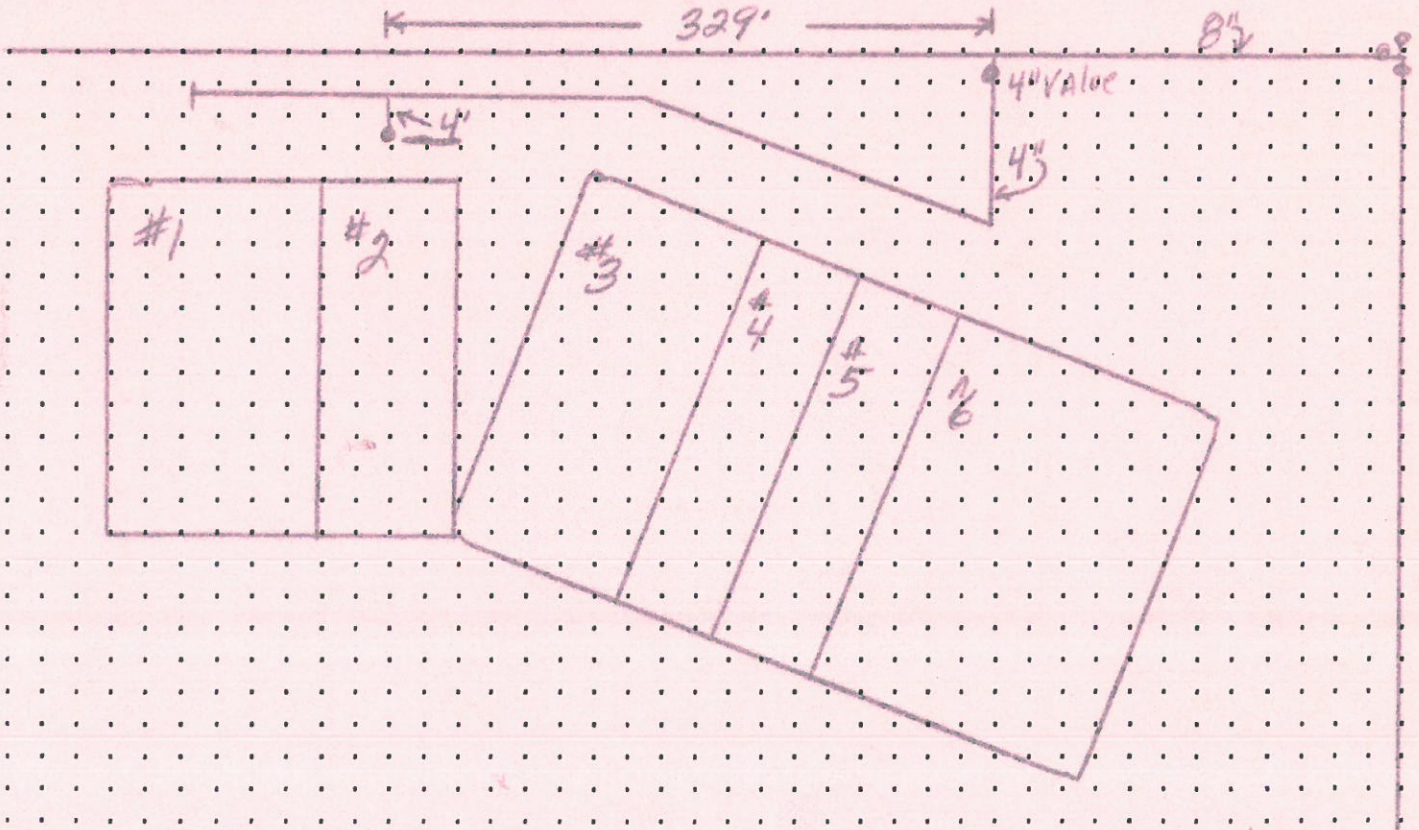

DATE APPROVED: Nov 29, 2001

BY: Jill E. Mantel

CITY OF NAPOLEON

WATER METER YOKE RELEASE FORM

THIS DOCUMENT ENTITLES THE HOLDER TO "ONE" WATER METER YOKE ASSEMBLY
(Please pickup at City Operations Department 1775 Industrial Drive).

PERMIT #: 930

ISSUED: 11-28-2001

JOB LOCATION: 1835 SCOTT ST

OWNER: HERITAGE TOWN CENTER

PHONE:

ADDRESS: 1835 SCOTT ST NAPOLEON, OH 43545

CONTRACTOR: RD JONES EXCAVATING, INC.

ADDRESS: BOX 127 HARROD, OH 45850

PHONE: 419-648-5870

WATER TAP SIZE 1" X 1.5" _____ 2" _____ OTHER _____

WATER METER YOKE SIZE 5/8" X 3/4" _____ 1" _____ OTHER _____

NEW STRUCTURE X EXISTING STRUCTURE _____ LAWN METER _____

WATER SERVICE LINE TO BE TYPE "K" COPPER OR "CTS" POLYETHELENE TUBING
OF 1" MINIMUM SIZE.

BACKFLOW DEVICE REQUIRED YES X NO _____

TYPE OF BACKFLOW DEVICE REQUIRED DCVA

WATER METER YOKE INSTALLATION IS SUBJECT TO THE FOLLOWING CONDITIONS

- 1.) MUST BE LOCATED IN AN ACCESSIBLE AREA.
- 2.) MUST BE IN AN AREA WHICH IS NOT SUBJECT TO FREEZING TEMPERATURES.
- 3.) MUST BE AT LEAST 18" ABOVE FLOOR LEVEL (NO CRAWL SPACE INSTALLATIONS).
- 4.) MUST COMPLY WITH MINIMUM MOUNTING REQUIREMENTS (DRAWING AVAILABLE)

ISSUED BY _____ RECEIVED BY _____

1-Copy to: Building Dept, Water Dept, and Utilities Dept