

P E R M I T

CITY OF NAPOLEON  
255 W. RIVERVIEW AVE  
NAPOLEON, OHIO 43545

DIVISION OF BUILDING & ZONING  
PH (419) 592-4010  
FAX (419) 599-8393

PERMIT NO: 936

DATE ISSUED: 11-28-01

ISSUED BY: SKE

JOB LOCATION: 1865 SCOTT ST

EST. COST:

LOT #:

SUBDIVISION NAME:

OWNER: HERITAGE TOWN CENTER  
ADDRESS: 1865 SCOTT ST  
CSZ: NAPOLEON, OH 43545  
PHONE:

AGENT: RD JONES EXCAVATING,  
ADDRESS: BOX 127  
CSZ: HARROD, OH 45850  
PHONE: 419-648-5870

USE TYPE - RESIDENTIAL:

OTHER:

ZONING INFORMATION

DIST: LOT DIM: AREA: FYRD: SYRD: RYRD:  
MAX HT: # PKG SPACES: # LOADING SP: MAX LOT COV:

BOARD OF ZONING APPEALS:


WORK TYPE - NEW: X REPLMNT: ADD'N: ALTER: REMODEL:

WORK INFORMATION

SIZE - LGTH: WIDTH: STORIES: LIVING AREA SF:  
GARAGE AREA SF: HEIGHT: BLDG VOL DEMO PERMIT:

WORK DESCRIPTION  
WATER METER SET

FEE DESCRIPTION	PAID DATE	FEE AMOUNT DUE
WATER TAP PERMIT		198.00

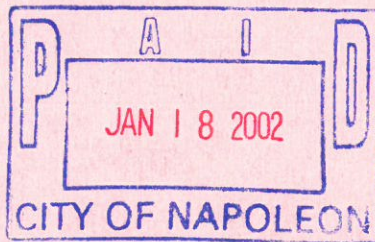

TOTAL FEES DUE 198.00

-----  
DATE

-----  
APPLICANT SIGNATURE



CITY OF NAPOLEON WATER TAPPING PERMIT FORM

PERMIT #:

ISSUED:

JOB LOCATION: Wal-Mart Super Center

SUBDIVISION NAME: Heritage Town Center LOT #: \_\_\_\_\_

OWNER: SHASTAR + Bldg #6

ADDRESS: 1865 Scott St

CONTRACTOR: \_\_\_\_\_ PHONE: \_\_\_\_\_

TAP SIZE: 1"  1.5" \_\_\_\_\_ 2" \_\_\_\_\_ OTHER \_\_\_\_\_

AMOUNT PAID: \_\_\_\_\_ YOKE SIZE: \_\_\_\_\_


PLUMBING CONTRACTOR: \_\_\_\_\_ PH: \_\_\_\_\_

DATE OF TAP: 11-12-01 OLD TAP #: — NEW TAP #: 01101

SIZE AND KIND OF MAIN: 4" C-900

LOCATION OF MAIN: West edge of bldg DEPTH OF MAIN: 5'

DIST FROM HYDRANT\VALVE: 139' S of 4" valve DIST TO CURB STOP FROM CORP: 4'

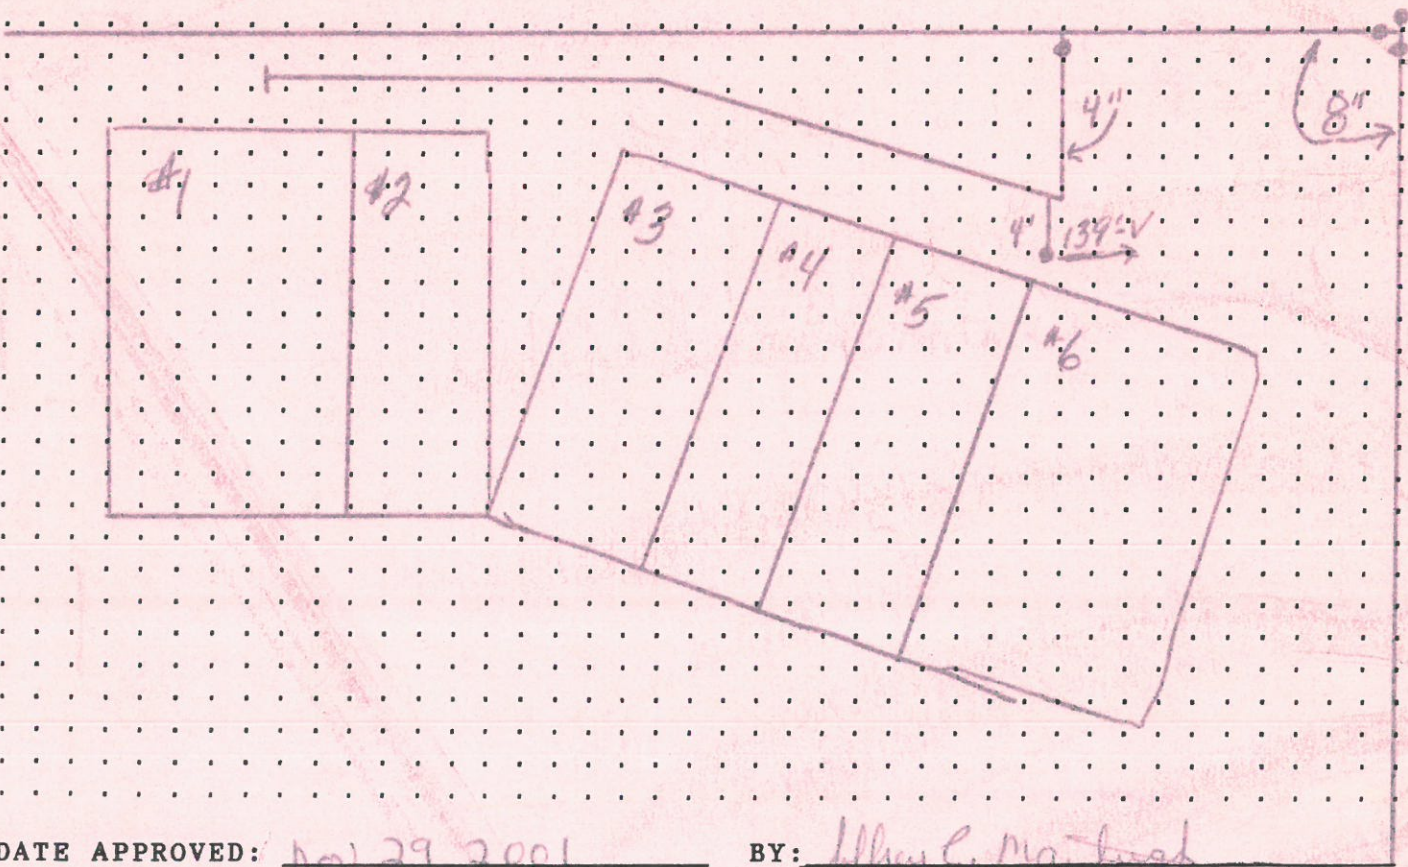

DATE APPROVED: Nov 29, 2001

BY: Jeffrey C. Martin



CITY OF NAPOLEON

WATER METER YOKE RELEASE FORM

THIS DOCUMENT ENTITLES THE HOLDER TO "ONE" WATER METER YOKE ASSEMBLY  
(Please pickup at City Operations Department 1775 Industrial Drive).

PERMIT #: 936

ISSUED: 11-28-2001

JOB LOCATION: 1865 SCOTT ST

OWNER: HERITAGE TOWN CENTER

PHONE:

ADDRESS: 1865 SCOTT ST NAPOLEON, OH 43545

-----  
CONTRACTOR: RD JONES EXCAVATING, INC.

ADDRESS: BOX 127 HARROD, OH 45850

PHONE: 419-648-5870

WATER TAP SIZE 1"  1.5" \_\_\_\_\_ 2" \_\_\_\_\_ OTHER \_\_\_\_\_

WATER METER YOKE SIZE 5/8"  3/4" \_\_\_\_\_ 1" \_\_\_\_\_ OTHER \_\_\_\_\_

NEW STRUCTURE  EXISTING STRUCTURE \_\_\_\_\_ LAWN METER \_\_\_\_\_

WATER SERVICE LINE TO BE TYPE "K" COPPER OR "CTS" POLYETHELENE TUBING  
OF 1" MINIMUM SIZE.

BACKFLOW DEVICE REQUIRED YES  NO \_\_\_\_\_

TYPE OF BACKFLOW DEVICE REQUIRED DCVA

-----  
WATER METER YOKE INSTALLATION IS SUBJECT TO THE FOLLOWING CONDITIONS

- 1.) MUST BE LOCATED IN AN ACCESSIBLE AREA.
- 2.) MUST BE IN AN AREA WHICH IS NOT SUBJECT TO FREEZING TEMPERATURES.
- 3.) MUST BE AT LEAST 18" ABOVE FLOOR LEVEL (NO CRAWL SPACE INSTALLATIONS).
- 4.) MUST COMPLY WITH MINIMUM MOUNTING REQUIREMENTS (DRAWING AVAILABLE)

ISSUED BY \_\_\_\_\_ RECEIVED BY \_\_\_\_\_

1-Copy to: Building Dept, Water Dept, and Utilities Dept