

18150

**CITY OF NAPOLEON**  
**BUILDING CONSTRUCTION PERMIT**  
 (1, 2 or 3 Family Dwelling)

Owner Name Roy Mann

Address 404 East Front Street

Builder Name Self

Address Same Tel. 592-4436

**Lot Information:**

Street No. 611 Stout Street

Lot Part of h Subdivision Scott's 1st Addn

Lot Dimensions ..... Lot Area ..... Sq. Ft.

Yard Set Back: Front ..... Rear .....

Side ..... Side .....

Zoning "FP" Intended use of Building: Installing on the northside of the existing dwelling a new 200AMP service entrance with the distribution panel located below the meter. Also installing new plumbing.

**Building Information:**

Single  Double ..... Multiple ..... New Construction ..... Addition ..... Remodel

Size: Length ..... Width ..... No. of Stories 2

Floor Area: 1st Floor ..... 2nd Floor ..... 3rd Floor ..... Basement .....

Unfinished Attic ..... Garage .....

Foundation: Piers ..... Full Basement ..... Part Basement .....

Concrete ..... Block .....

Walls: Frame ..... Block ..... Brick ..... Other .....

Electrical: Wiring 200AMP Electric Heating --- Electrical Appliances ---

Plumbing: Fixtures or Traps X (5) Warm Air Heating -- Hot Water Heating --

Additional Information: This permit requires compliance with the attached addendum marked exhibit "A" and made a part here-of.

Date 11-30-75 Applicant Signature Roy Mann

4/9/76 FINAL PLUMBING TESTED AND APPROVED BY Owner - Builder - Agent  
CONTRACTOR (PAUL WALTERS) BY AWP

4/22/76 SERVICE AND PANEL DISAPPROVED BY HOWES AWP

Inspection Record: 5/15/76 SERVICE ONLY INSPECTED AND APPROVED BY HOWES

Work Started ..... Foundations ..... Plumbing, Heating .....

Set Back, Side Lines ..... Plumbing (Rough In) ..... And Air Conditioning .....

Excavation ..... Erecting Frame ..... Roof .....

Footing ..... Electrical Work 12/4/75 disapproved by Howes. .....

Comments: 4/9/76 INFORMED KEN LANG OF HIGH METER BASE. AWP.

4/23/76 MR. MANN IN OFFICE TODAY. INFORMED OF ALL VIOLATIONS OF 4/22. AWP.

Certificate of Occupancy Issued .....

Permit No.	<u>432-75</u>			
Issued	<u>11/28/75</u>			
By	<u>[Signature]</u> Building Inspector			
Valuation	<u>\$200.00</u>			
	<b>Fees</b>	<b>Base</b>	<b>Plus</b>	<b>Total</b>
Construction	<u>--</u>	<u>--</u>	<u>--</u>	<u>--</u>
Plumbing	<u>\$3.00</u>	<u>\$5.00</u>	<u>\$8.00</u>	<u>\$16.00</u>
Electrical	<u>\$3.00</u>	<u>\$4.75</u>	<u>\$7.75</u>	<u>\$15.75</u>
Heating	<u>---</u>	<u>---</u>	<u>---</u>	<u>---</u>
Water Tap	<u>---</u>	<u>---</u>	<u>---</u>	<u>---</u>
Sewer Tap	<u>---</u>	<u>---</u>	<u>---</u>	<u>---</u>
Temporary Elec.	<u>---</u>	<u>---</u>	<u>---</u>	<u>---</u>
<b>TOTAL</b>	<b>\$6.00</b>	<b>\$9.75</b>	<b>\$15.75</b>	<b>\$31.50</b>



CITY OF NAPOLEON  
Engineering Department  
255 Riverview Avenue  
NAPOLEON, OHIO 43545

DATE	Dec. 9, 1975	JOB NO.	432-75
PROJECT	New Plumbing For Existing Dwelling		
LOCATION	Call Start Start		
CONTRACTOR	Mann	OWNER	Mann
WEATHER	_____	TEMP.	_____ °at AM _____ °at PM
PRESENT AT SITE			

TO Roy Mann  
404 East Front St.  
Napoleon, Ohio, 43545

THE FOLLOWING WAS NOTED:

In accordance with City Ordinance No. 1116, sub-section 7.4, no plumbing system shall be used until the final inspection has been approved and tested. Testing of plumbing systems shall be in accordance with Chapter BB-51, Section BB-51-73, of O.B.C.

- Attached you will find a copy of Sec. BB-51-73 pertaining to approved method of testing both waste and water lines.

- Contact the Engineering Dept when ready for inspection.

~~NOTE: SERVICE AND PANEL DISCONNECTED BY INSPECTOR BEFORE OBTAINING PERMIT~~  
Note - Because ~~of the~~ <sup>SYSTEM SERVICE WILL INSPECTED AND APPROVED BY</sup> before obtaining a plumbing permit, I am requiring the plumbing system to be tested and approved prior to hook-up of the new 200 AMP. electric meter service.

COPIES TO Mann.

FIELD REPORT

SIGNED Thomas W. Brennan  
Building Inspector



CITY OF NAPOLEON

Engineering Department

ELECTRICAL INSPECTION FIELD REPORT

255 Riverview Avenue Napoleon, Ohio 43545

(Please Print or Type)

Date 12-4-75

Permit No. 432-75

Type of Inspection Eled Serv.

Type of Occupancy Dwelling

Project Name Roy Mann

Address 611 Stout Street

City Napoleon State Ohio

Approved

Violation

Electrical Contractor

Remarks:

Code Reference

A Panel boards installed in damp or wet locations shall be suitable for the conditions

1975

Art. 384-17

Art. 373-2

Art. 300-1(a,b,c)

B Service conductors clearance from windows, doors, porches, fire escapes or similar locations.

Art. 320-24(c)

Compliance Time Prior to Service Conn.

Inspectors Signature

Copies To: Roy Mann









1.75 1st 10 circuits  
6.00 back of circuits @ 60 each  
7.75 Total

11/26/75 Ken Lange  
Approved Location  
AWP

CITY OF NAPOLEON  
ENGINEERING DEPARTMENT  
APPLICATION FOR ELECTRICAL PERMIT  
(PLEASE PRINT OR TYPE)

The undersigned hereby makes application for the installation, replacement or alteration of electrical equipment as herein specified, agreeing to do all such work in strict accordance with the City of Napoleon's adopted Electrical Code for 1, 2 and 3 Family Buildings.

Owner's Name x Roy Mann Address x 404 East Front  
Contractor's Name x Roy Mann Address x 404 East Front Tel x 592 4436

LOT INFORMATION:

Location of Project 611 East MAIN Lot # \_\_\_\_\_  
Subdivision \_\_\_\_\_ Zoning District \_\_\_\_\_

BUILDING INFORMATION:

Single Family  Double Family \_\_\_\_\_ Multiple Family \_\_\_\_\_  
New Construction \_\_\_\_\_ Existing \_\_\_\_\_ Addition \_\_\_\_\_  
Replacement \_\_\_\_\_ Remodel \_\_\_\_\_ Service Change   
Size: Total Square Foot Per Floor \_\_\_\_\_ No. of Stories 2

DESCRIPTION OF WORK

Size of Service 200 AMP. Service Change Only Yes (Yes or No)  
Total Number of New Circuits 20 Total Number of New Circuits Excluding Appliance Circuits \_\_\_\_\_

APPLIANCE CIRCUITS: (Indicate quantity)

Electric Range \_\_\_\_\_ Range Hood \_\_\_\_\_ Clothes Dryer \_\_\_\_\_ Dishwasher \_\_\_\_\_  
Air Conditioner \_\_\_\_\_ Attic Fan Blower \_\_\_\_\_ Room Exhaust Fan \_\_\_\_\_  
Disposal \_\_\_\_\_ Hot Water Heater \_\_\_\_\_ Electric Oven \_\_\_\_\_  
Require Temporary Electric \_\_\_\_\_ (Yes or No)

Note: G.F.C. required for all temporary circuits with approved ground rod at service.





APPLICATION FOR PERMIT SHALL BE ACCOMPANIED BY TWO COMPLETE SETS OF PLANS INCLUDING: ELECTRICAL LAY-OUT AND RISER DIAGRAM.


ESTIMATED COST OF COMPLETED PROJECT: x \$1560.28

DATE x 11-20-75 APPLICANT'S SIGNATURE x Roy Mann  
OWNER-CONTRACTOR-AGENT




# 1/2 INCH PIPES - ELBOWS - TRAPS

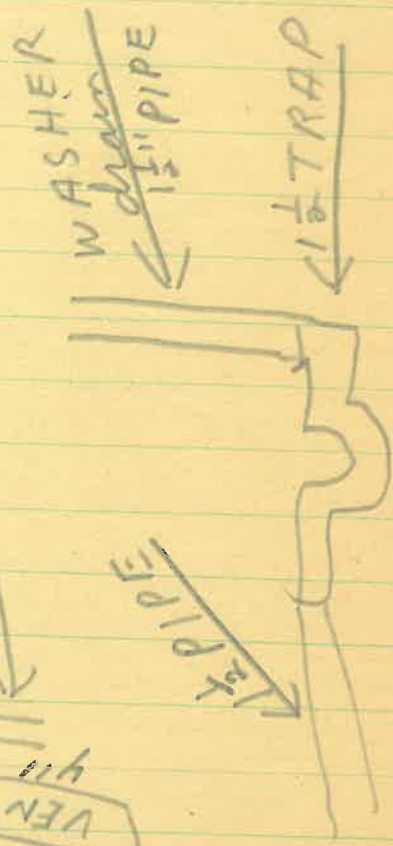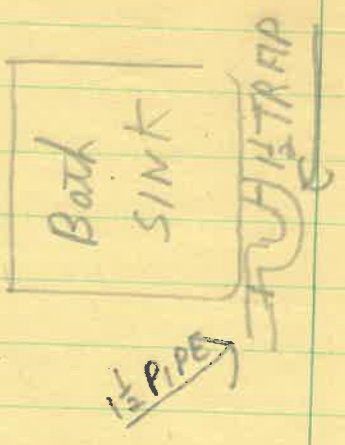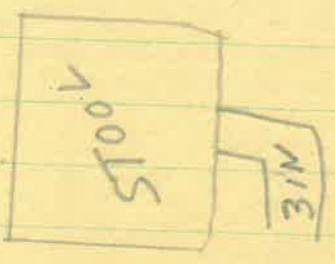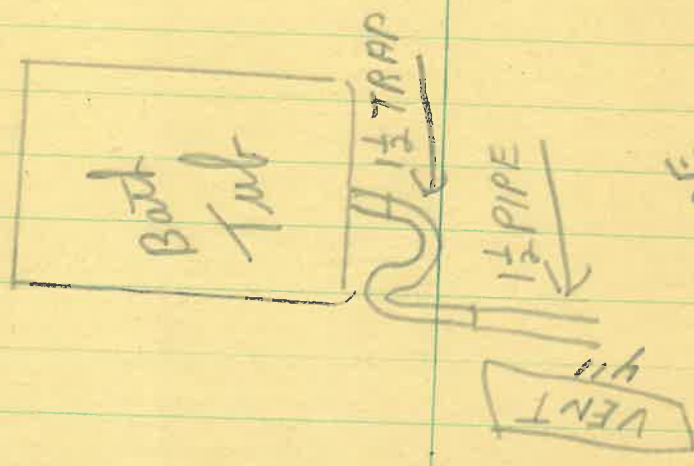

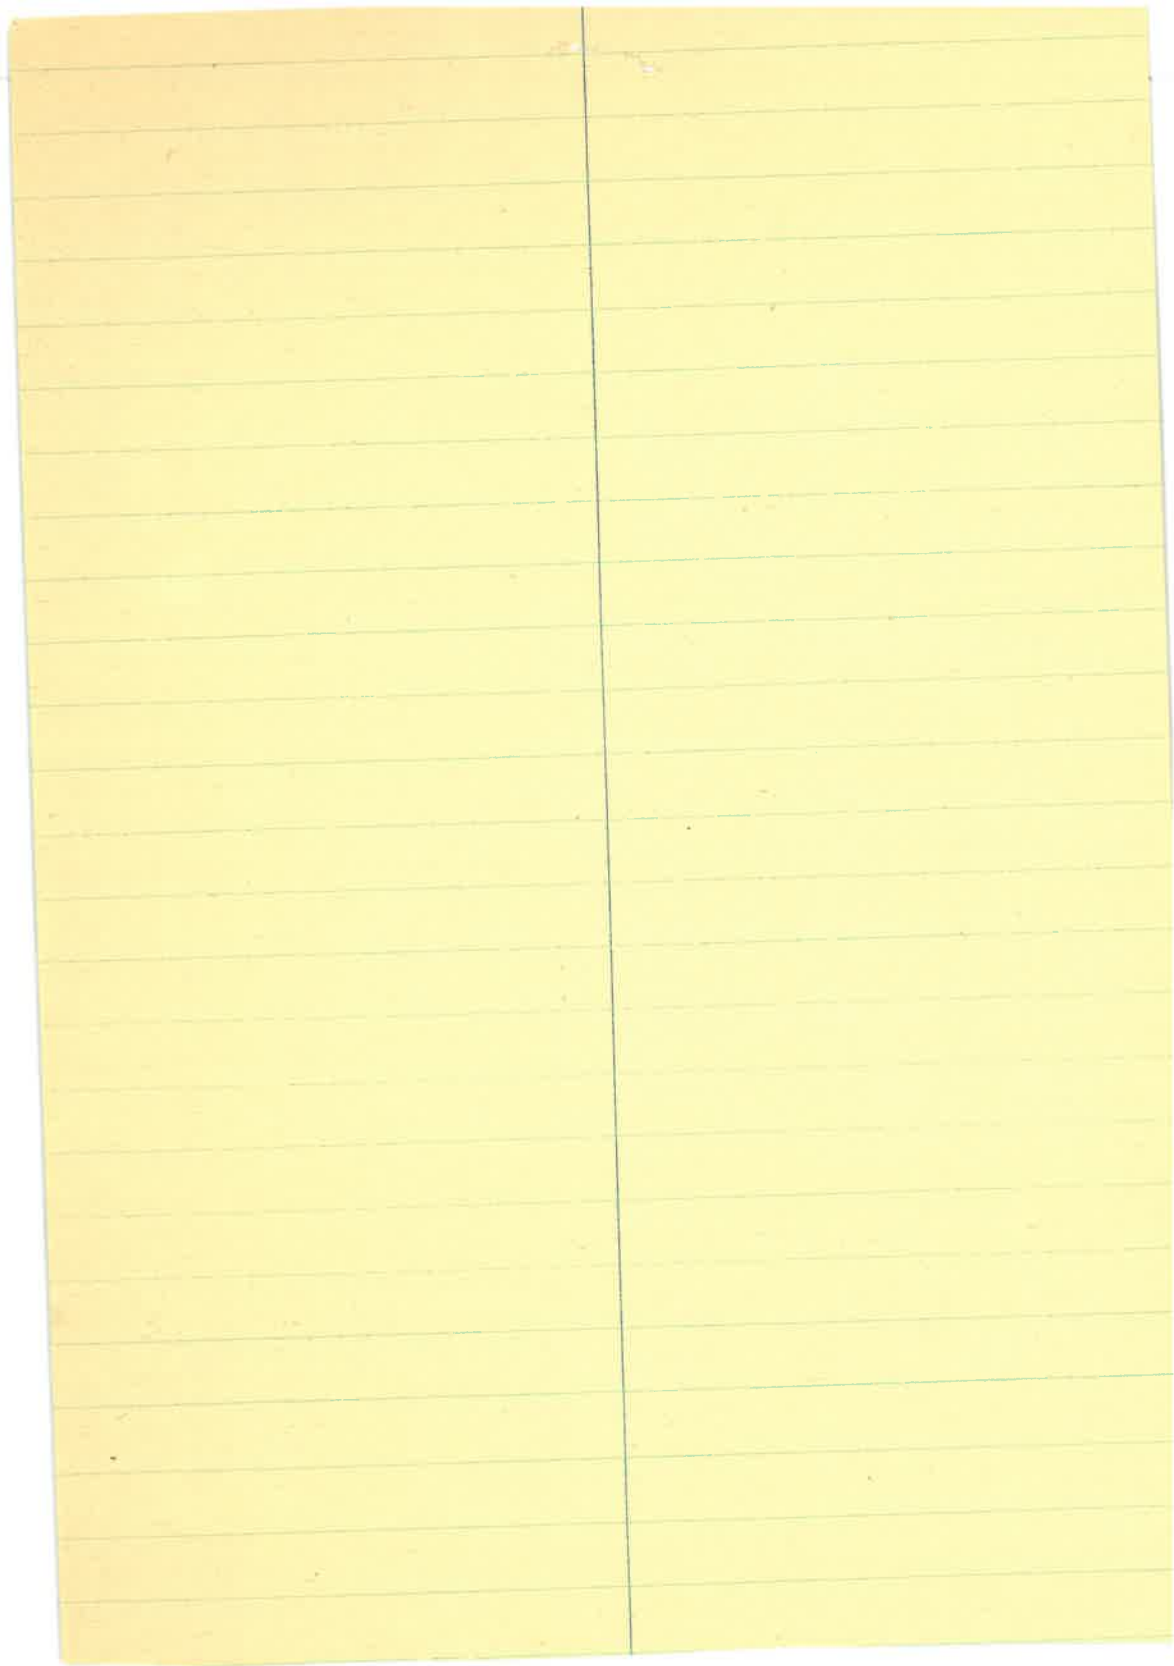

ROY MANN  
5924436

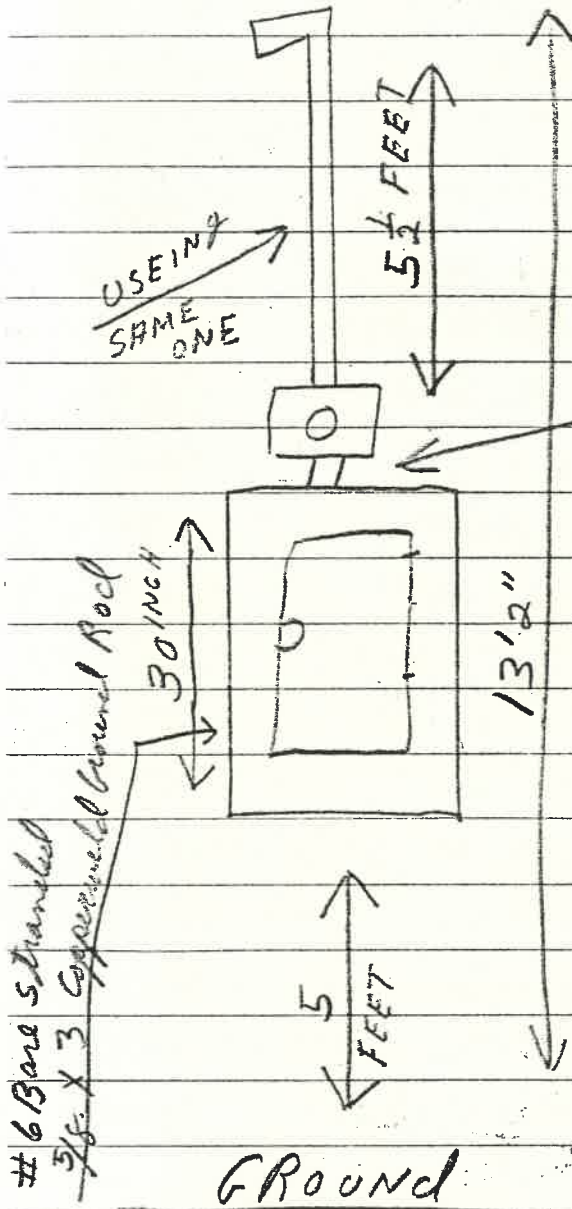

USE IN  
SAME  
ONE

Wire FROM METER TO  
Box No. 4

#6 Bare stranded  
3/8" X 3 Copper Ground Rod

Service EQUIPMENT  
200A. MAIN 120/240

SPACE FOR  
20 Single-Circuit Breaker  
OR  
40 Two-Circuit 120V Breaker  
OR  
Ten 240V Breaker

GROUND

