

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Pn. 592-4010

Permit No. W-0534 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by _____
water distribution dept. _____ finance director _____

Name Beck Bldgs. Size of tap 1" Date 12-6-94 Street and No. 620 Stout Apt. C

Old Tap No. — New Tap No. 94181 Size and Kind of Main 4" C-900

Location of Main NORTH edge of lot Depth of Main 4'

Distance from ~~Hydrant/Valve~~ corner of Bldg. A - 50' Distance to Curb Stop from Corp. 5'

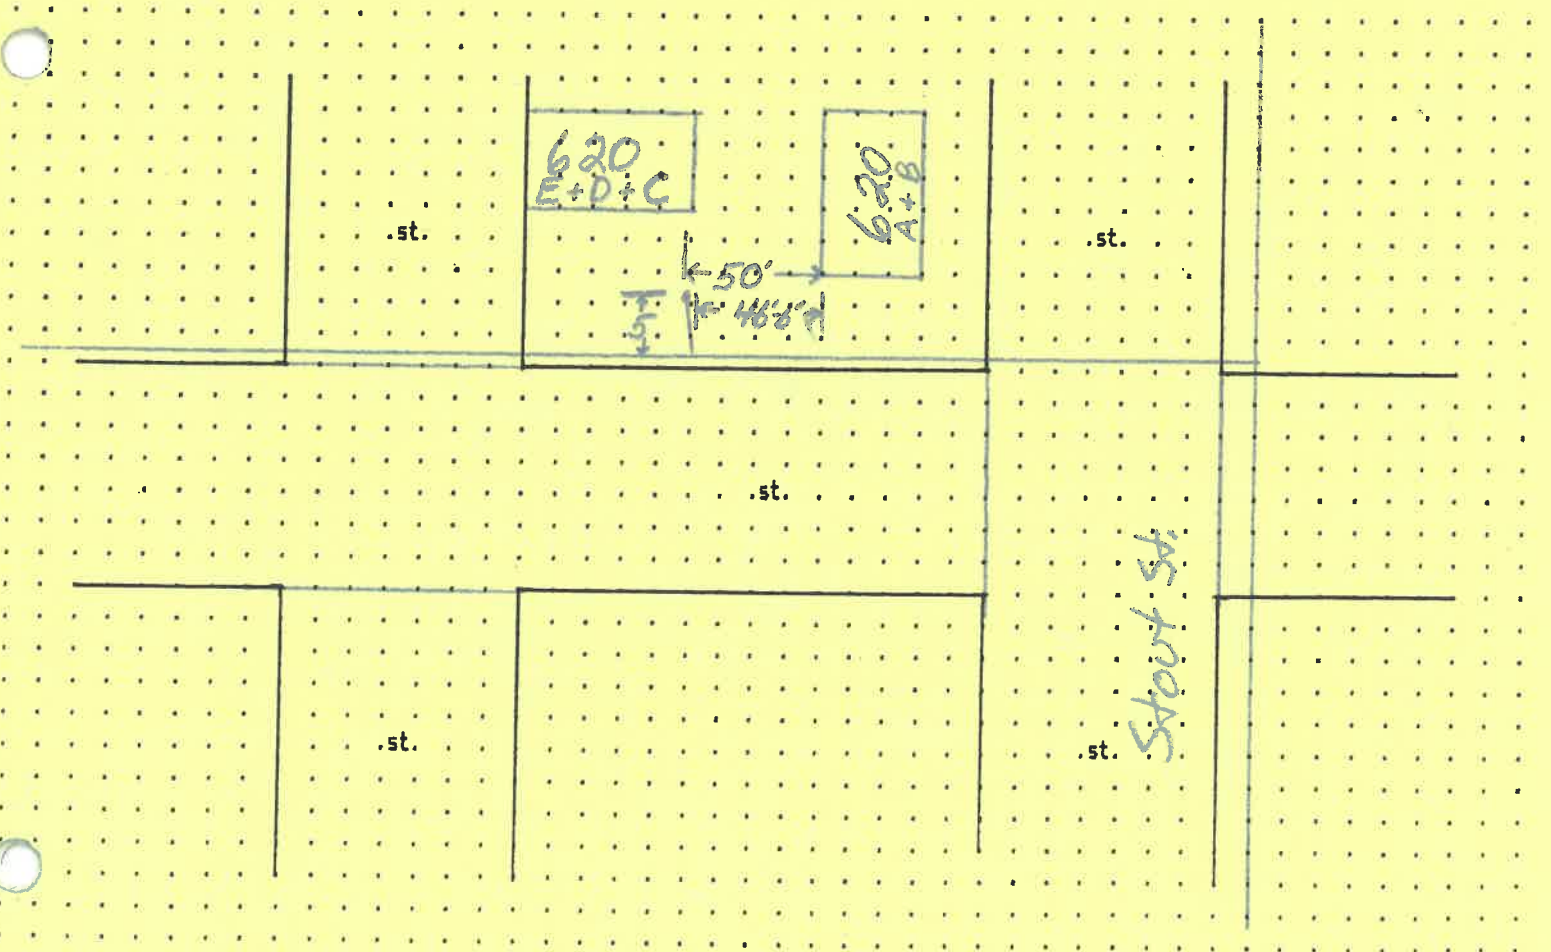

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0535 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by _____
water distribution dept. _____ finance director _____

Name Beck Bldgs Size of tap 1" Date 12-6-94 Street and No. 620 Stout Apt D

Old Tap No. _____ New Tap No. 94182 Size and Kind of Main 4" C-900

Location of Main North edge of lot Depth of Main 4'

Distance from ^{corner} Hydrant/Valve of Bldg. A - 51' Distance to Curb Stop from Corp. 5'

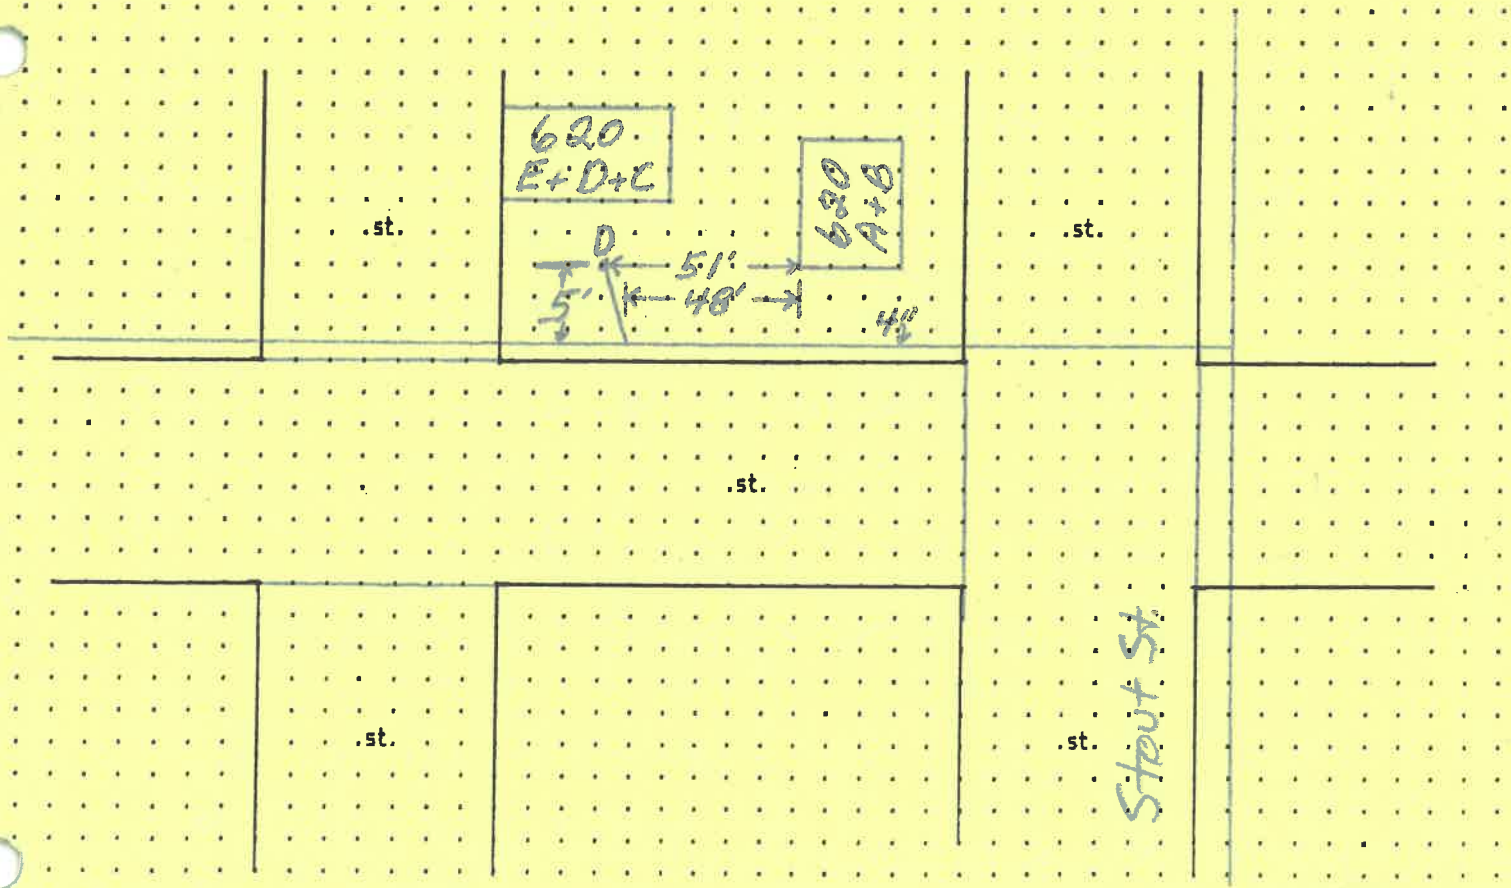

WATER TAPPING PERMIT

issued by

The Napoleon Water Distribution Department

255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0528 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by _____
water distribution dept. _____ finance director _____

Name Beck Builders Size of tap 1" Date 12-6-94 Street and No. 620 Stout Apt E

Old Tap No. _____ New Tap No. 94183 Size and Kind of Main 4" C-900

Location of Main North edge of lot Depth of Main 4'

Distance from ~~Hydrant Valve~~ ^{corner} of Bldg. A - 52' Distance to Curb Stop from Corp. 5'

