

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W- 0187 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey E. Mantel
water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 7-29-97 Street and No. 1129 Sycamore

Old Tap No. 4309 New Tap No. 9725 Size and Kind of Main 8" C-900

Location of Main 5' South of South curb Depth of Main 5'

Distance from Hydrant/Valve 185' East of Hyd 468 Distance to Curb Stop from Corp. 6'

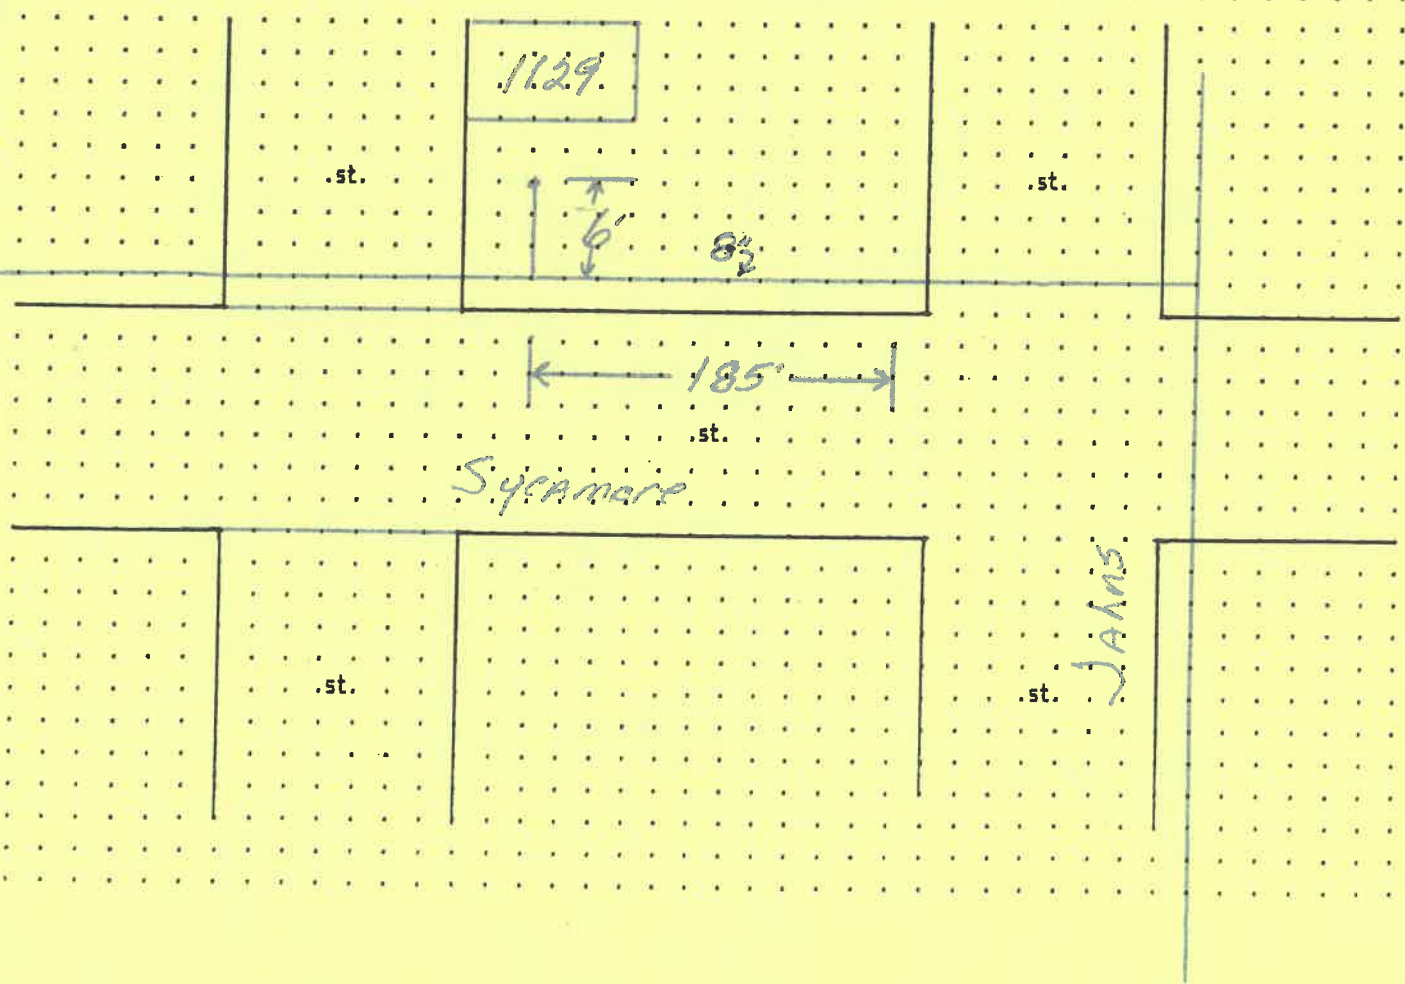

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W-0187 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____


Date completed _____ Approved by Jeffrey E. Mantel water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 7-29-97 Street and No. 1129 Sycamore

Old Tap No. 4309 New Tap No. 9725 Size and Kind of Main 8" C-900

Location of Main 5' South of South curb Depth of Main 5'

Distance from Hydrant/Valve 185' East of Hyd 468 Distance to Curb Stop from Corp. 6'

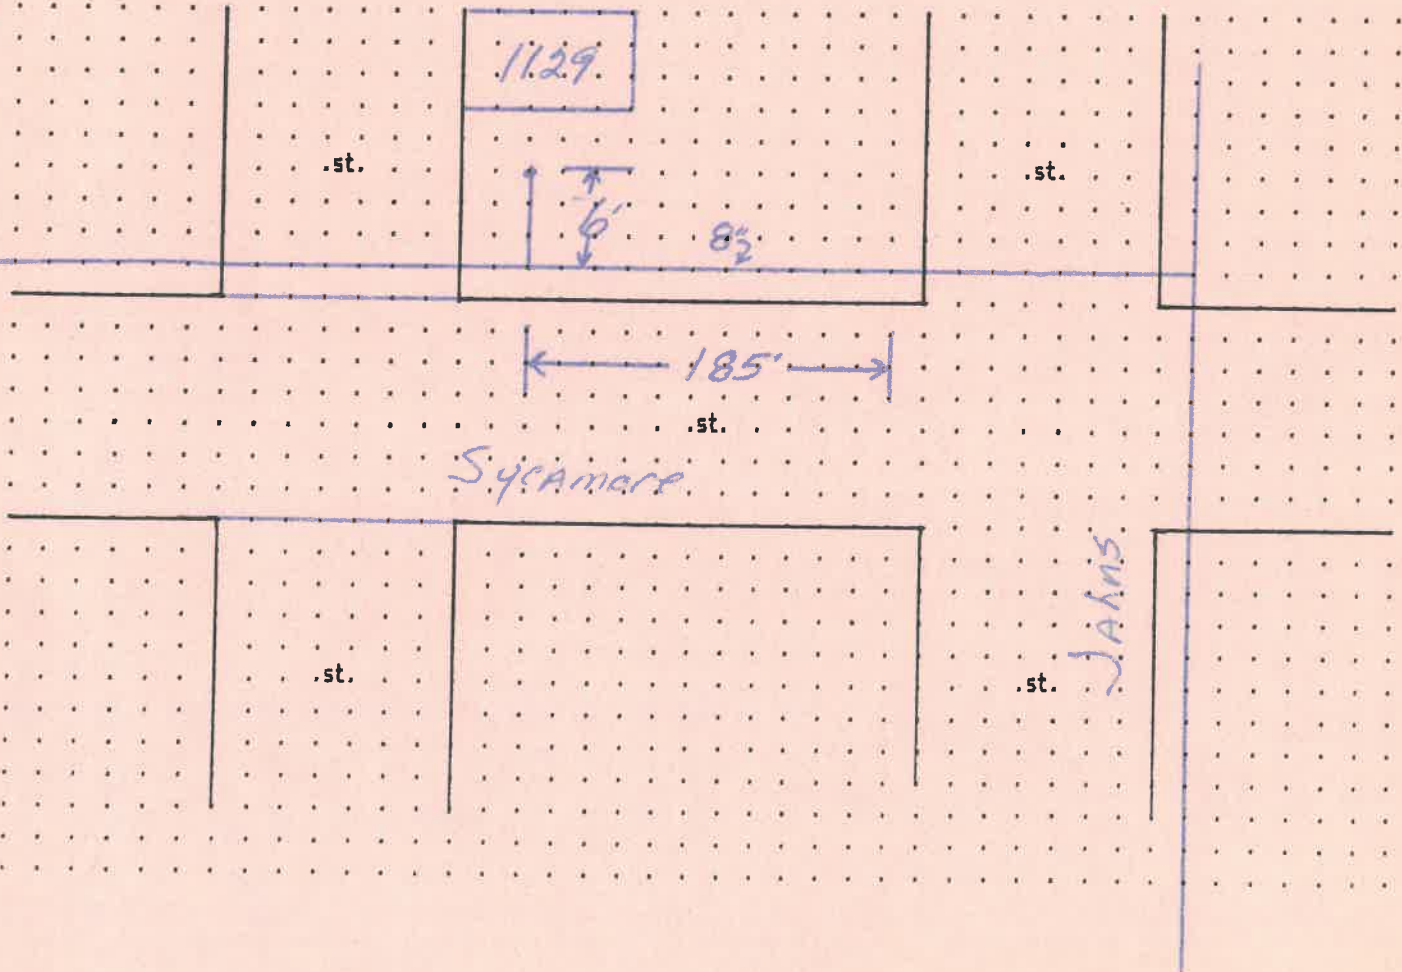

#1129 Sycamore → #1115 Sycamores



Richard Luzny — (419) 592-8000

480 Briarcliff Drive
Napoleon, OH 43545
Phone 419-592-9516



H.N. 1129 Sycamore
East to Hurst
8" clay Downstream

- 21' Top LT.
- 77.8' Top RT.
- 79.9' Top LT.
- 142.4' Top LT.
- 245.5' Top RT.
- 252.9' Top LT.
- 363' Top bottom of pipe
- 388' M.H. guess from Top @ ?
- 363' to were M.H. was @ ?