


RECEIVED
MAY 10 1999
CITY OF NAPOLEON

TRAIL DRIVE

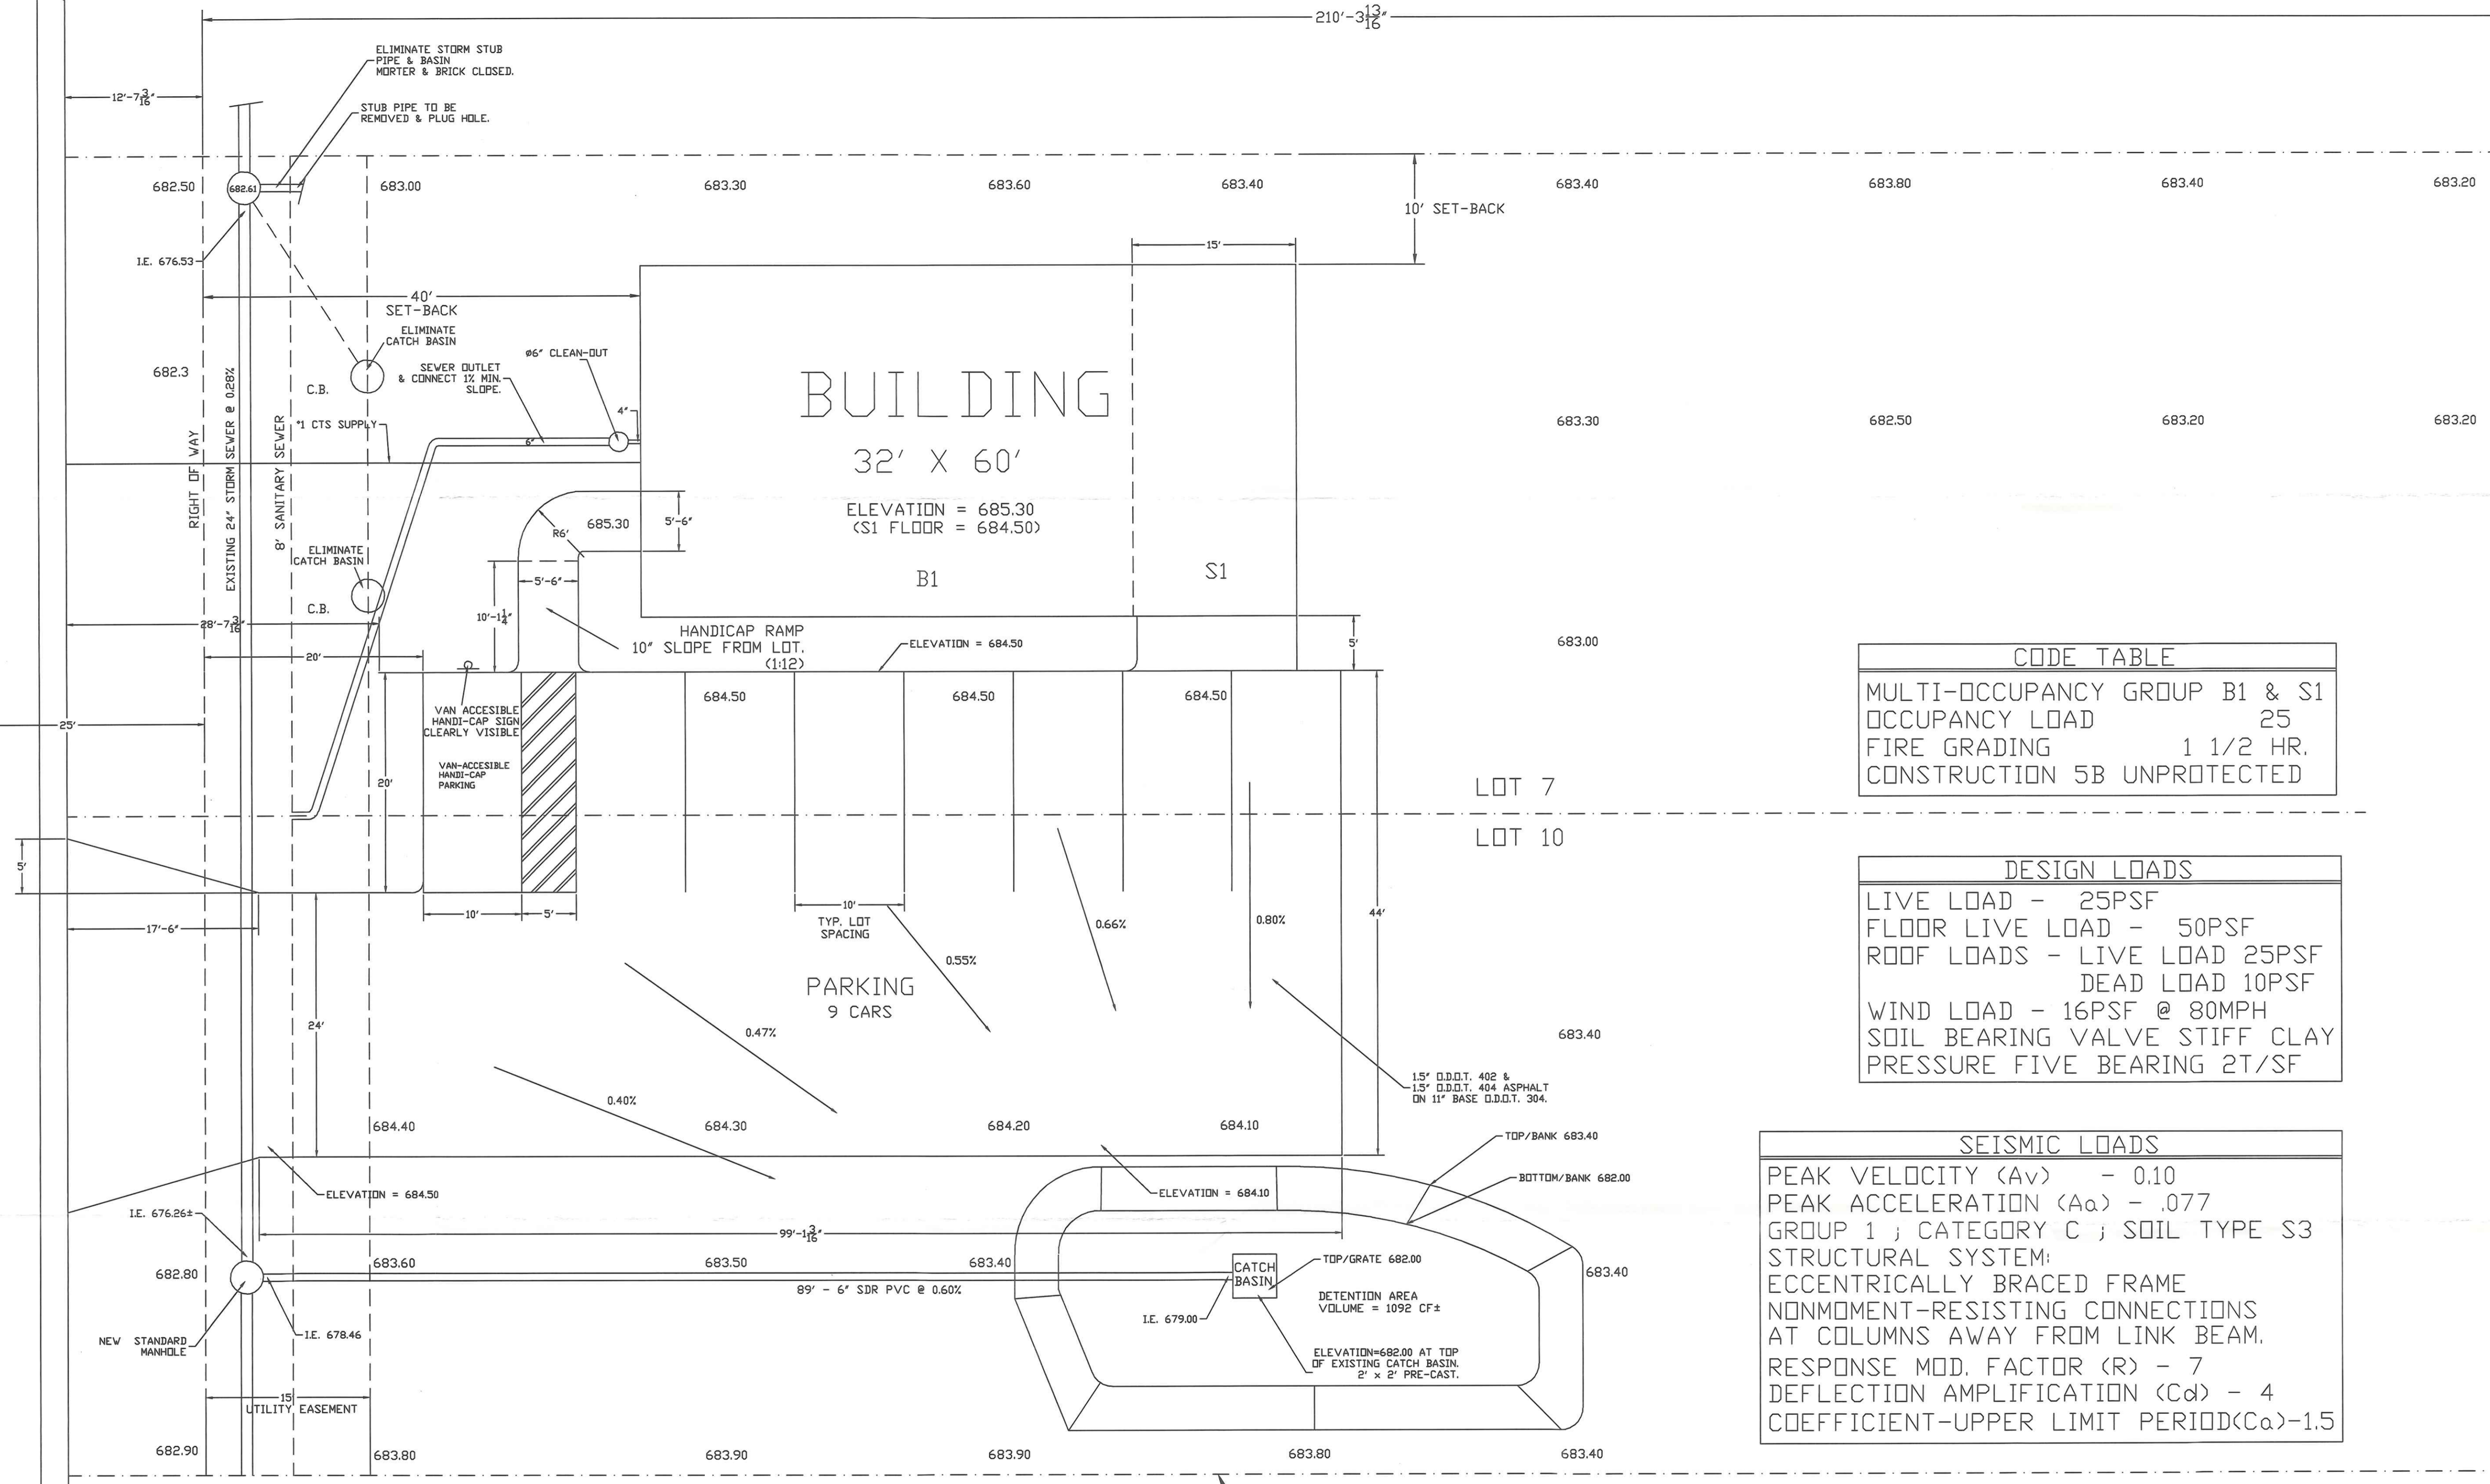


| CODE TABLE | |
|-------------------------------|----------------|
| MULTI-OCCUPANCY GROUP B1 & S1 | |
| OCCUPANCY LOAD | 25 |
| FIRE GRADING | 1 1/2 HR. |
| CONSTRUCTION | 5B UNPROTECTED |


| DESIGN LOADS | |
|-----------------|--------------------|
| LIVE LOAD | - 25PSF |
| FLOOR LIVE LOAD | - 50PSF |
| ROOF LOADS | - LIVE LOAD 25PSF |
| | - DEAD LOAD 10PSF |
| WIND LOAD | - 16PSF @ 80MPH |
| SOIL BEARING | VALVE STIFF CLAY |
| PRESSURE | FIVE BEARING 2T/SF |

| SEISMIC LOADS | |
|-------------------------------------|---------------------------------|
| PEAK VELOCITY (Av) | - 0.10 |
| PEAK ACCELERATION (Aa) | - .077 |
| GROUP 1 ; CATEGORY C ; SOIL TYPE S3 | |
| STRUCTURAL SYSTEM: | ECCENTRICALLY BRACED FRAME |
| | NONMOMENT-RESISTING CONNECTIONS |
| | AT COLUMNS AWAY FROM LINK BEAM. |
| RESPONSE MOD. FACTOR (R) | - 7 |
| DEFLECTION AMPLIFICATION (Cd) | - 4 |
| COEFFICIENT-UPPER LIMIT PERIOD(Co) | -1.5 |

| INDEX | |
|----------------------|-------|
| SITE PLAN | PG.1 |
| SITE PLAN DETAILS | PG.1A |
| FOUNDATION PLAN | PG.2 |
| FLOOR PLAN | PG.3 |
| ELEVATIONS | PG.4 |
| WALL & ROOM DETAILS | PG.5 |
| PLG.,HTG.,AC DETAILS | PG.6 |
| ELECTRICAL DETAILS | PG.7 |

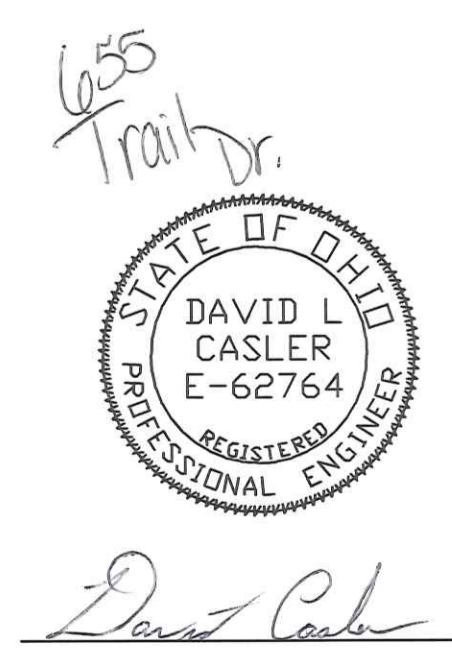

| DESCRIPTION: | | |
|------------------------|-----------------------------|---------------------|
| SITE PLAN | | |
| TYPE: DENTAL OFFICE | | |
| REV: A | DRAWN BY: D. CASLER | SCALE: 1/8" = 1' |
| DATE: 4/29/99 | PREPARED FOR: R. PARSELL | SHEET: 1 OF 7 |

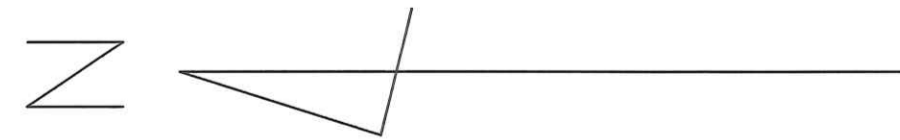

LOT LINE