

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010


Permit No. W-0189 Issued _____ Received of _____ (\$ _____) .00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ " Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by Jeffrey C. Montague water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 7-30-97 Street and No. 712 Tyler
Old Tap No. 2276 New Tap No. 9727 Size and Kind of Main 8" C-900
Location of Main 6' East of East curb Depth of Main 5'
Distance from Hydrant/Valve 160' North of Hyd 39 Distance to Curb Stop from Corp. 12'

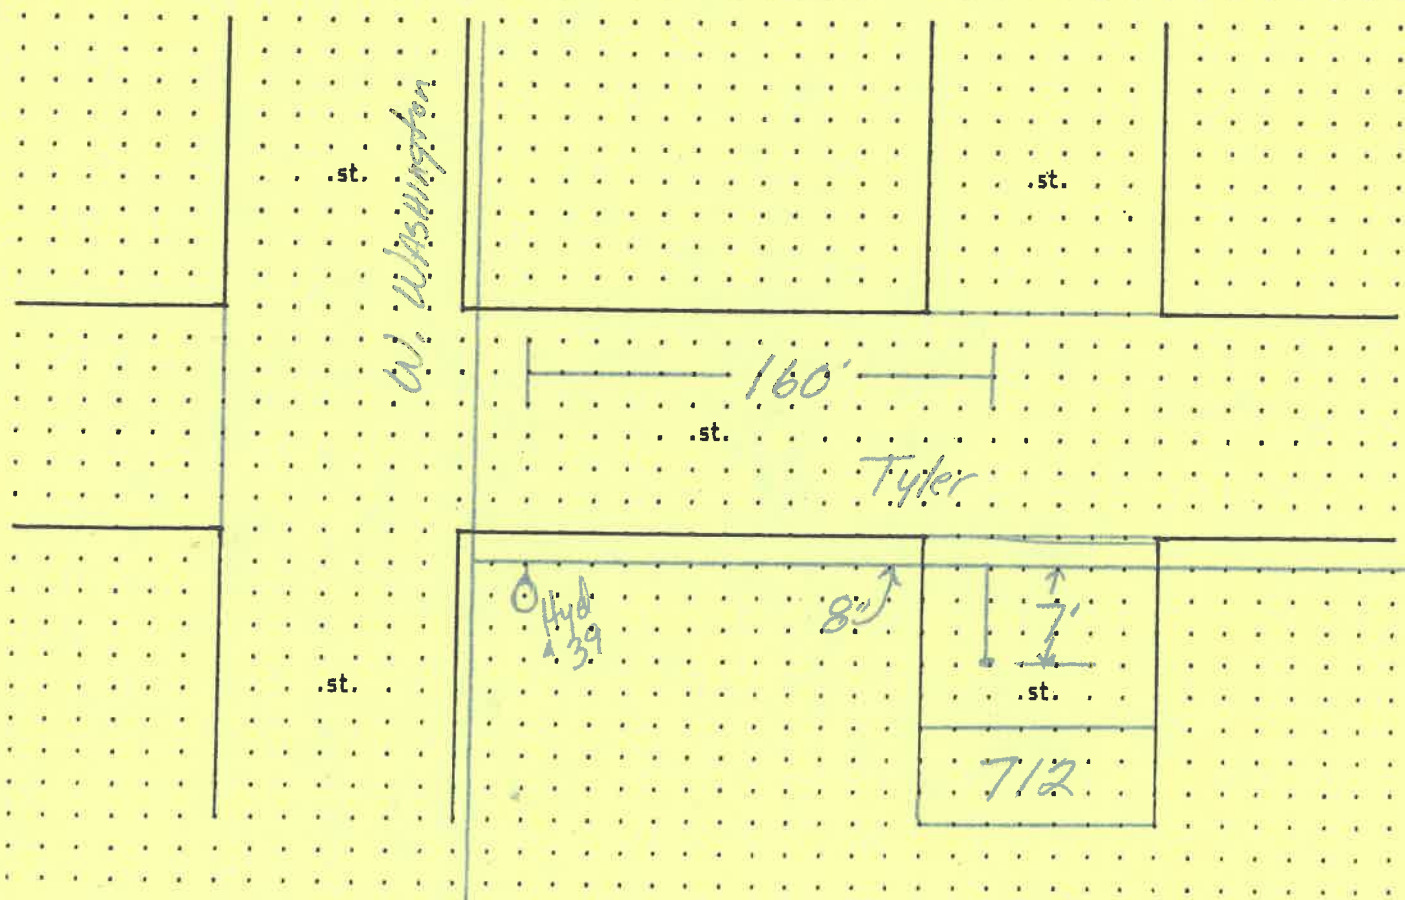

WATER TAPPING PERMIT
issued by
The Napoleon Water Distribution Department
255 West Riverview Ave. Napoleon, Ohio 43545 Ph. 592-4010

Permit No. W- 0189 Issued _____ Received of _____ (\$ _____).00

(Charge for tapping permit to supply water service to) Lot No. _____ Sub Div. _____

Street No. _____ Tap Size _____ * Cost \$ _____ .00 Plumber _____

Date completed _____ Approved by J. E. M. [Signature] water distribution dept. _____ finance director

Name _____ Size of tap 1" Date 7-30-97 Street and No. 712 Tyler

Old Tap No. 2276 New Tap No. 9727 Size and Kind of Main 8" C-900

Location of Main 6' East of East curb Depth of Main 5'

Distance from Hydrant/Valve 160' North of Hyd 39 Distance to Curb Stop from Corp. 12'

